

## KE1247-01

### SECONDARY TRANSFORMER BUSHING COVER



### WHY KADDAS

PROTECTS SECONDARY BUSHINGS AGAINST ANIMAL INTERACTION

INSTALLED WITH WITH ZIP TIES TO SECURE COVER  
IN PLACE (ZIP TIES NOT INCLUDED)


EASILY INSTALLED AND REUSABLE FOR ROUTINE MAINTENANCE

IEEE 1656 & ASTM TESTED

V-0 FLAMMABILITY CLASSIFICATION

UV RESISTANT

**Birdguard™ Products Deliver a Triple Win**

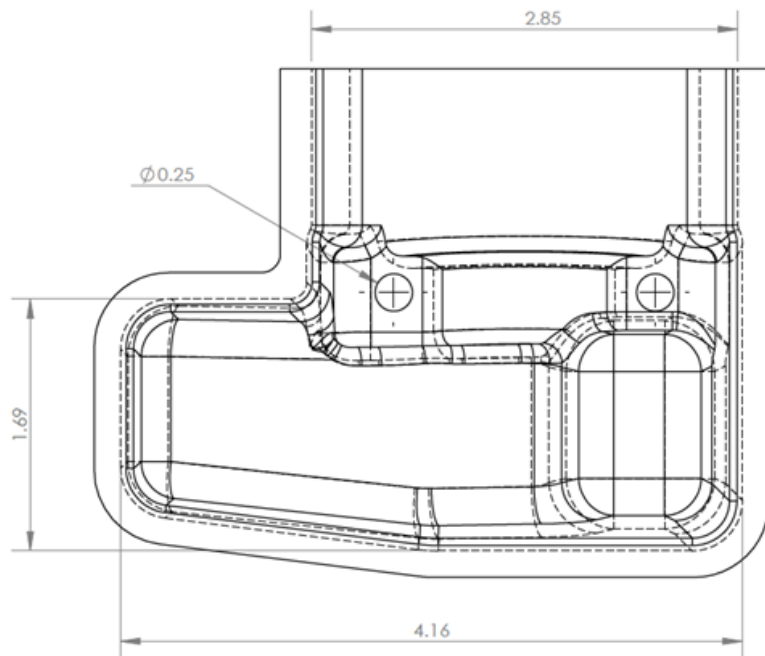

## MATERIAL TESTING INFORMATION

| ASTM TEST                      | DESCRIPTION                          | SPECIFICATIONS    |
|--------------------------------|--------------------------------------|-------------------|
| ELECTRICAL DIELECTRIC STRENGTH | D-149-09 (TESTED IN OIL)             | PASS → 49KV       |
| ELECTRICAL DIELECTRIC STRENGTH | D-149-09 (TESTED IN AIR)             | PASS → 72KV       |
| ELECTRICAL DIELECTRIC STRENGTH | D-3638-12                            | PASS → 600 V      |
| TENSILE STRENGTH               | D-638-10 (BEFORE EXPOSURE)           | PASS 6570 PSI     |
| TENSILE STRENGTH               | D-638-10 (AFTER XENON ARC EXPOSURE)  | PASS 6480 PSI     |
| TENSILE IMPACT                 | D-1822-13 (BEFORE EXPOSURE)          | 78.4 FT-LBS/IN SQ |
| TENSILE IMPACT                 | D-1822-13 (AFTER XENON ARC EXPOSURE) | 69.3 FT-LBS/IN SQ |
| FLAMMABILITY                   | D-3801 (UL94)                        | PASS              |