



Flo-Tel™ xd


UK office
Elfab Limited
Alder Road, North Shields,
Tyne and Wear, NE29 8SD
UNITED KINGDOM
E: uksales@osecoelfab.com
T: +44 (0)191 293 1234
osecoelfab.com

CE 2903


II 2 G Ex d IIC 120°C Gb -40°C ≤ Ta ≤ 100°C IP66/IP67
II 1 D Ex ta IIC 120°C Gb -40°C ≤ Ta ≤ 100°C IP66/IP67
II 1 G Ex ia IIC 120°C Gb -40°C ≤ Ta ≤ 100°C IP66/IP67
II 1 D Ex ia IIC 120°C Gb -40°C ≤ Ta ≤ 100°C IP66/IP67

Installation (GB)
Installation (F)
Einbauanleitung (D)
Installazione (I)
Installatie (NL)
Instalação (P)
Instalacion (E)
Installation (S)
Montavimo (LT)


1

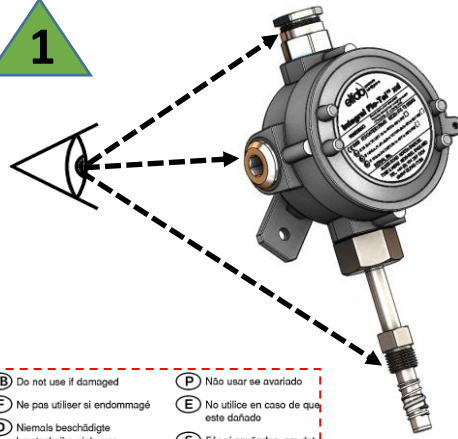


2

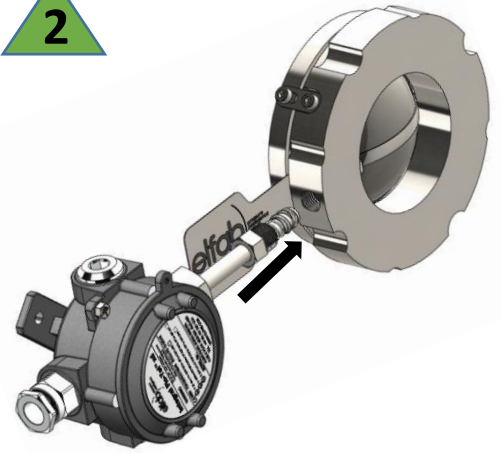

3

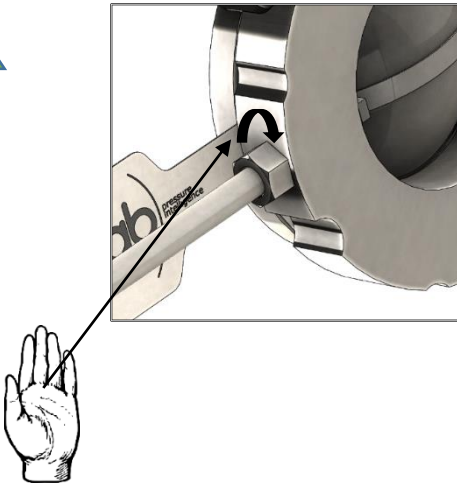


4

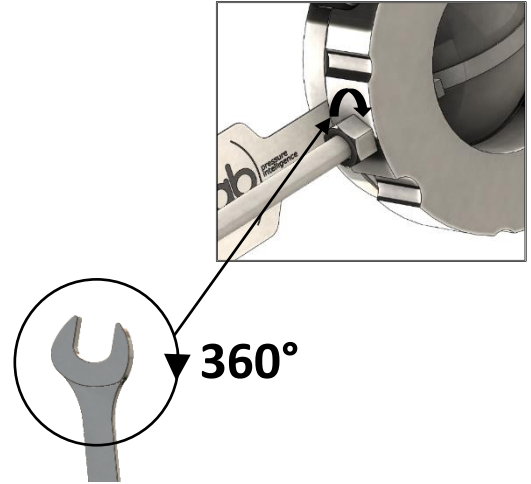


5

INSTALLATION 1 REED SWITCH ONLY CONNECTED

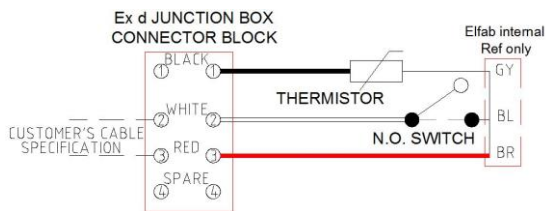

IS BARRIER: INSTALL 1
Ui = <28V
Ii = <84mA
Pi = 0.55W
Ci = 0
Li = 0

INSTALLATION 2 REED SWITCH AND THERMISTOR CONNECTED

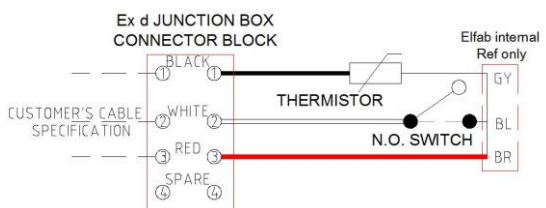

IS BARRIER: INSTALL 2
Ui = 3.9V
Ii = 2mA
Pi = 7.8mW
Ci = 0
Li = 0

(6)

