




OMNTEC
Advanced Tank Monitoring & Leak Detection



1. Open the camera app
2. Focus the camera on the QR code by gently tapping the code
3. Follow the instructions on the screen to view PDF file

LU3-NYS

INSTALLATION GUIDE

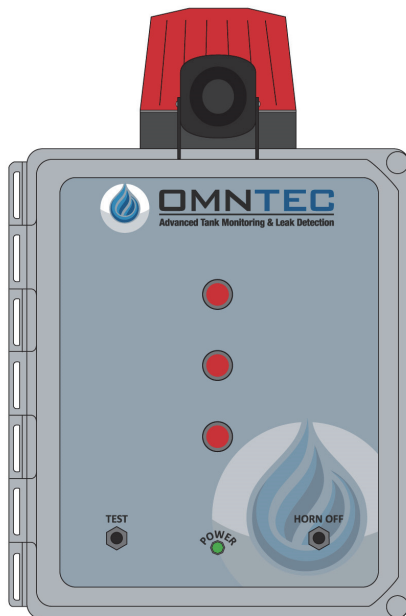

THREE CHANNEL ALARM PANEL

Revision 2638


Document No. LU3-NYS

TABLE OF CONTENTS

LU3-NYS SPECIFICATIONS.....	3
DIMENSIONS FOR MOUNTING AND KNOCKOUTS.....	4
LU3-NYS CONTROLLER CONNECTION DIAGRAM.....	5
LS-ASC SENSOR.....	6
L-1 SENSOR.....	7
RA-SERIES REMOTE HIGH-LEVEL ALARM.....	8
LOG SHEET.....	9
WARRANTY.....	10

LU3-NYS

THREE CHANNEL ALARM PANEL

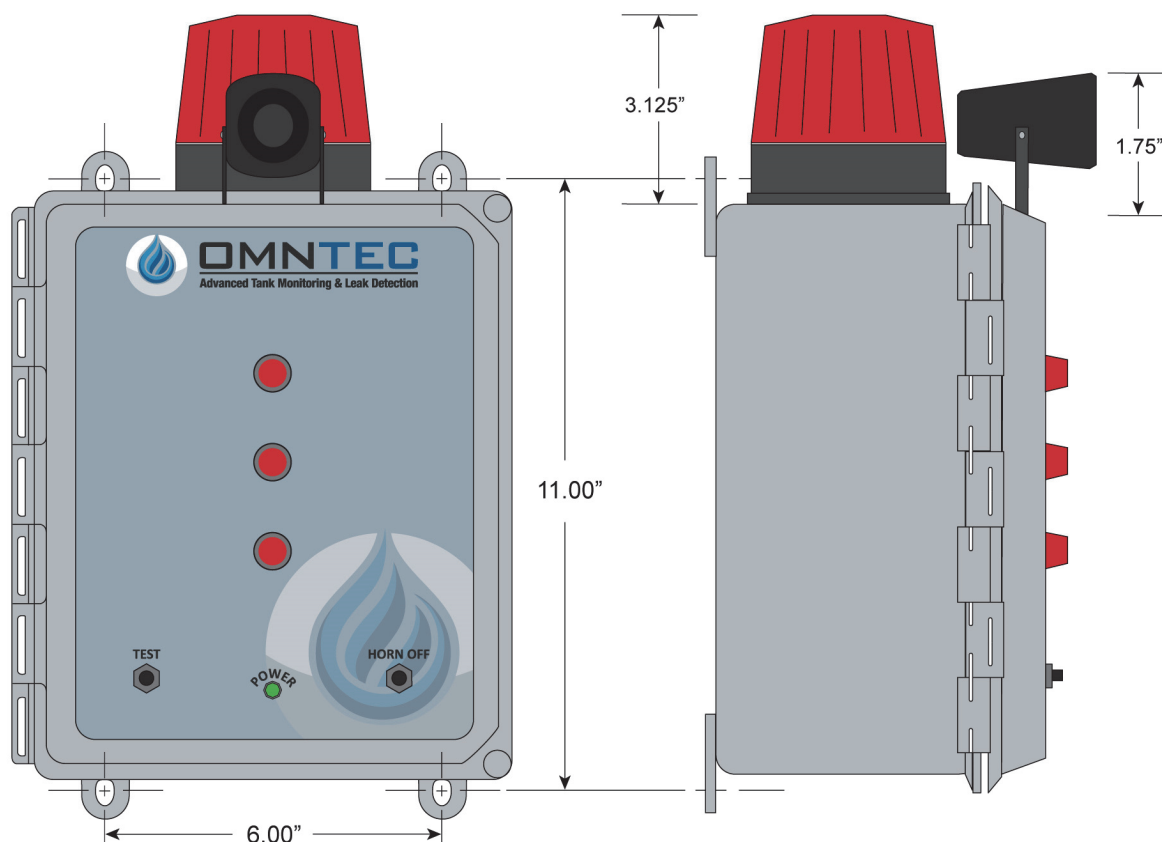

LU3-NYS SPECIFICATIONS

POWER INPUT

85-125 VAC, 47-440 Hz
16 Watts maximum

POWER TO SENSORS

13.80 VDC @ 13 mA

RELAY OUTPUT

(3) SPST normally open dry contacts 0.5 AMPS, 120 AC/DC switches when an alarm condition occurs

WEIGHT

6 LBS.

DIMENSIONS

(W) 9" x (H) 10.5"

SENSOR CABLE

Shielded 22 AWG UL-E118830 CM
Maximum length 2000 feet

ENCLOSURE

NEMA 4X

OPERATING TEMPERATURE

-40° to 140° F

AUDIO/VISUAL CONSOLE

AUDIBLE ALARM - 110 dB multi-frequency horn with 30 second timeout

RED LIGHT - Indicates liquid alarm

STROBE LIGHT - Common alarm strobe for all alarm conditions

TEST BUTTON - When pressed will test system lights and horn

GREEN LIGHT (POWER) - Indicates the power is on

HORN OFF BUTTON - Silences the audible alarm when pressed

SENSORS

(2) L-1 High level sensor

(1) LS-ASC Liquid sensor

OPTIONAL ACCESSORIES

RA-3 Audio/visual remote annunciator

RLY-RA Series Relay outputs

LABELS

Provided with controller




OMNTEC


Advanced Tank Monitoring & Leak Detection

LU3-NYS

DIMENSIONS FOR MOUNTING AND KNOCKOUTS

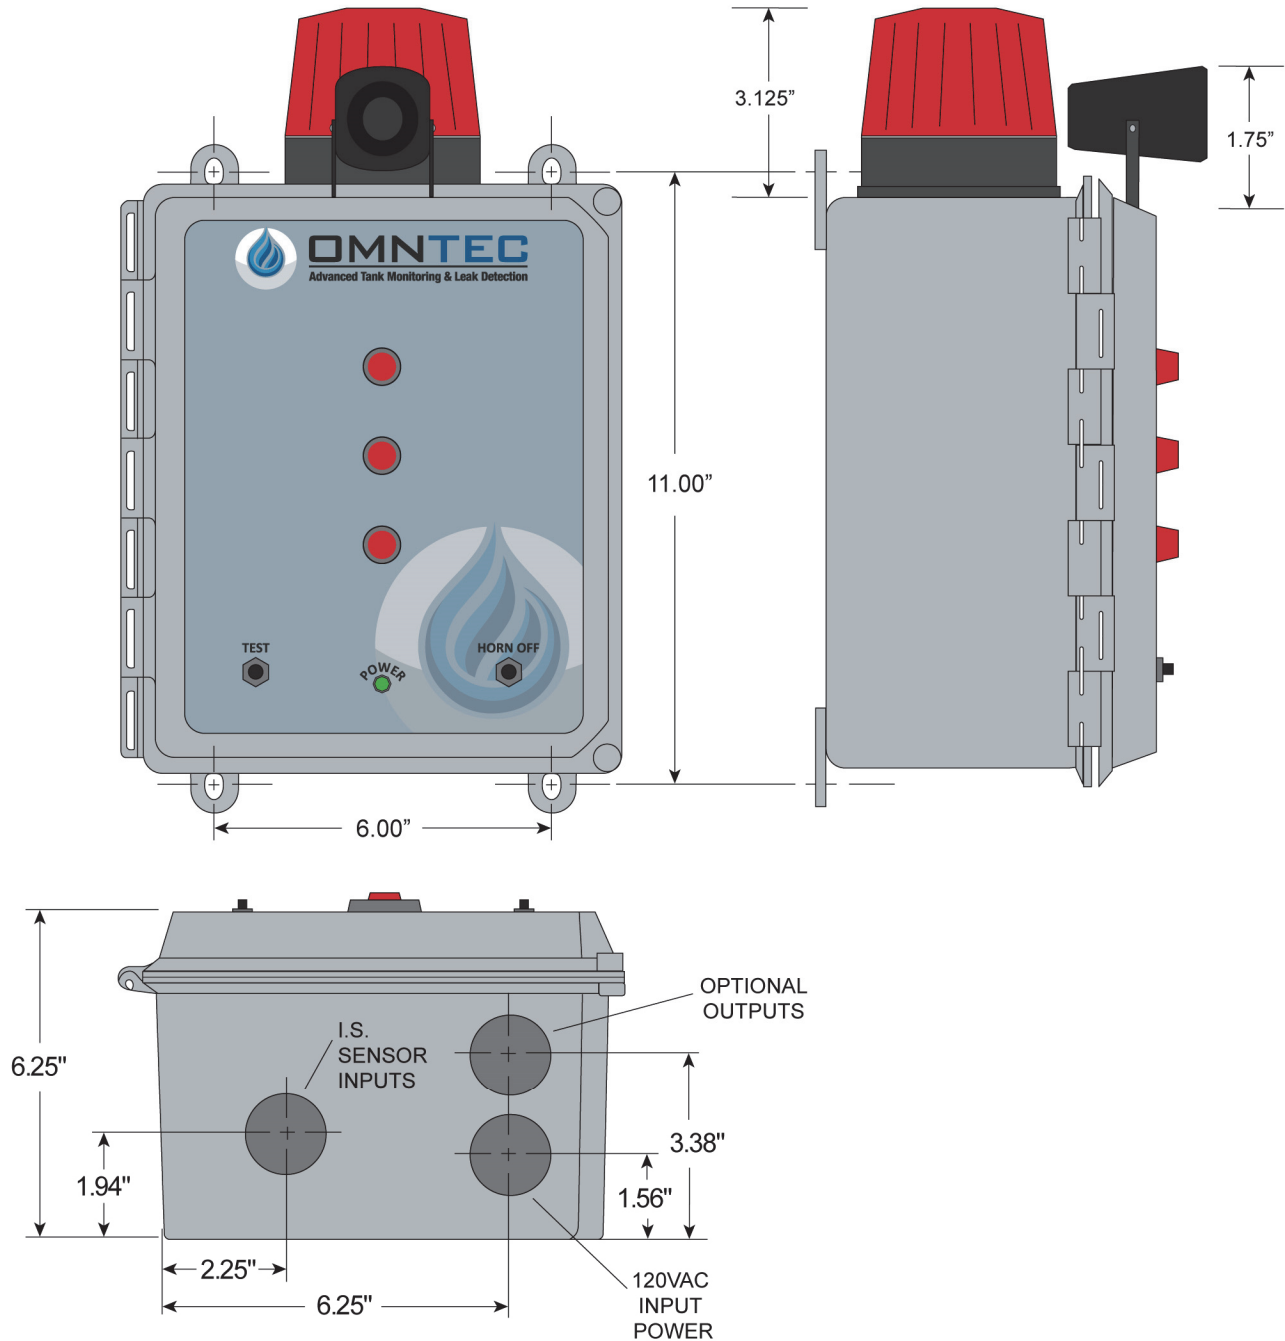

LU3-NYS CONTROLLER CONNECTION DIAGRAM

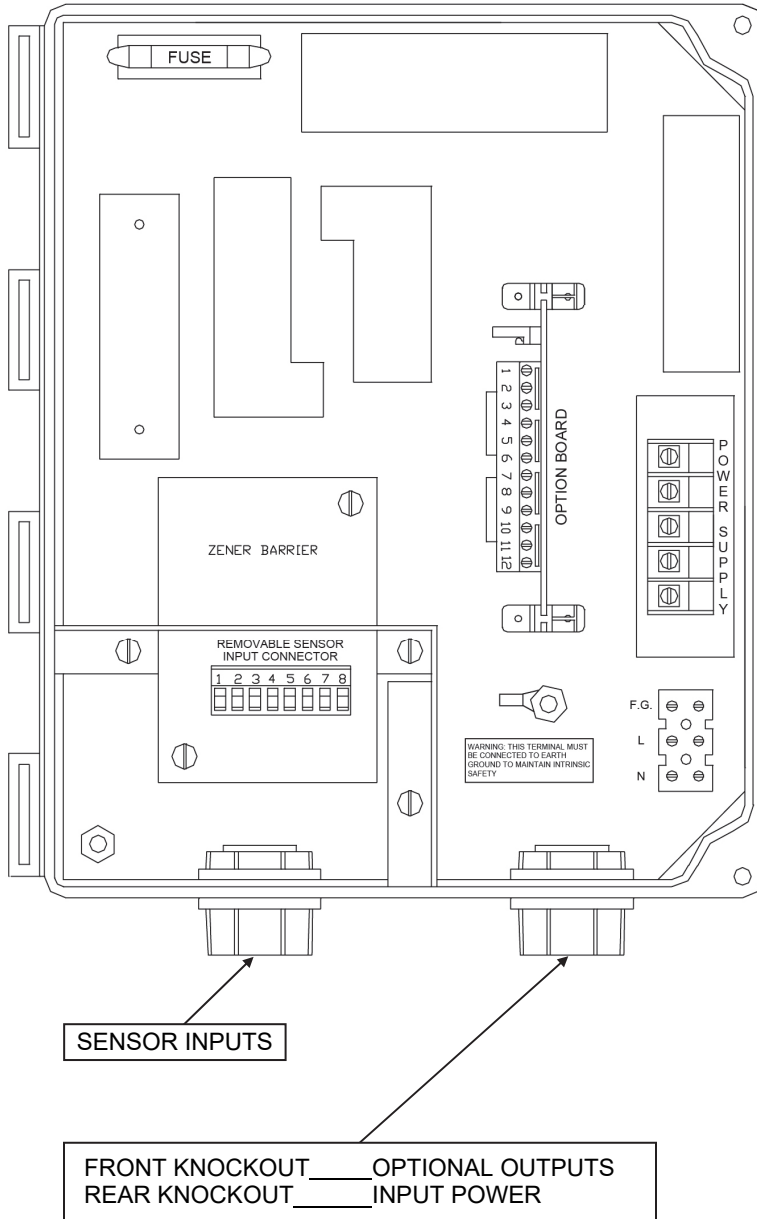

COLOR CODE

CABLES FROM SENSORS TO REMOVABLE SENSOR INPUT CONNECTORS

1	RED	SENSOR #1
2	WHITE	
3	RED	SENSOR #2
4	WHITE	
5	RED	SENSOR #3
6	WHITE	
7	BLACK	FROM SENSOR #1 - #3
8	SHIELD DRAIN	

WIRES TO OPTION BOARD

WIRES FROM RA-SERIES REMOTE

1	GREEN	- HORN
2	RED	+ HORN
3	BLACK	GROUND
4	WHITE	SENSOR #1
5	ORANGE	SENSOR #2
6	BLUE	SENSOR #3

WIRES FROM RELAY OUTPUTS

7	COMMON	SENSOR #3
8	NORMALLY OPEN	
9	COMMON	SENSOR #2
10	NORMALLY OPEN	
11	COMMON	SENSOR #1
12	NORMALLY OPEN	

POWER INPUT

120VAC WIRES TO POWER SUPPLY

F.G.	FIELD GROUND
L	LINE
N	NEUTRAL

NOTE: To maintain proper shielding, BLACK sensor wires and SHIELD DRAINS should **not** be connected together at sensors.




OMNTEC

Advanced Tank Monitoring & Leak Detection

LS-ASC SENSOR

NON-PRODUCT DISTINGUISHING OPTIC SENSOR

PRINCIPLES OF OPERATION

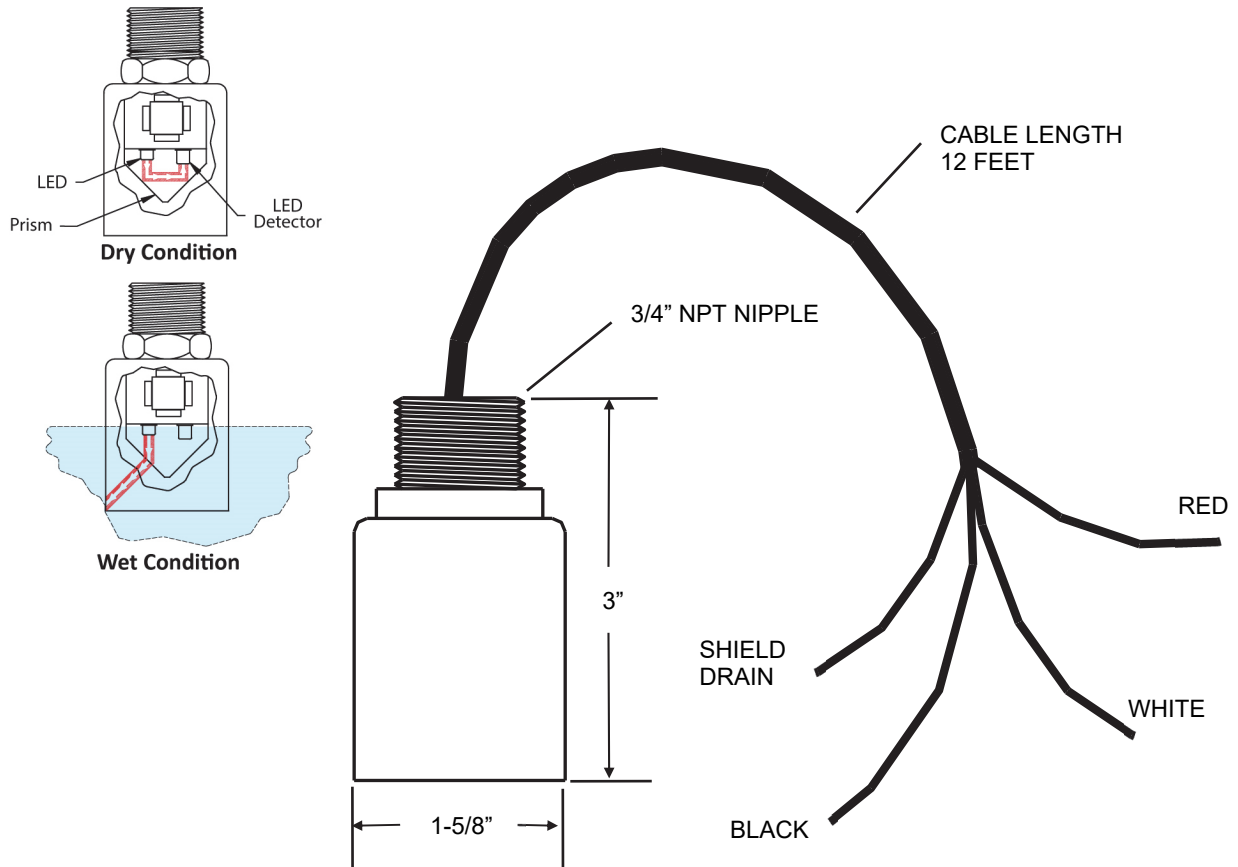

LS-ASC SPECIFICATIONS

U.L. LISTED 5L04

Intrinsically safe Class I, Group D Hazardous Locations when connected in accordance with control drawing nos. L1, L2, L3, L4, L6, L9

OPERATING TEMPERATURE

-40° to 70° C

POWER

2 VDC @ 13 mA

WEIGHT

1/2 pound

PRINCIPLES OF OPERATION

LIQUIDS (ex: fuel, water) – Photo optic

DRY CONDITION – Normally closed light beam

ALARM CONDITION – Opens (refracts) normally closed light beam

SENSOR CABLE

Shielded 22 AWG UL-E118830 CM

Maximum length 2000 feet

RESPONSE TIME


Immediate



OMNTEC

Advanced Tank Monitoring & Leak Detection

L-1 SENSOR LIQUID LEVEL OPTIC SENSOR

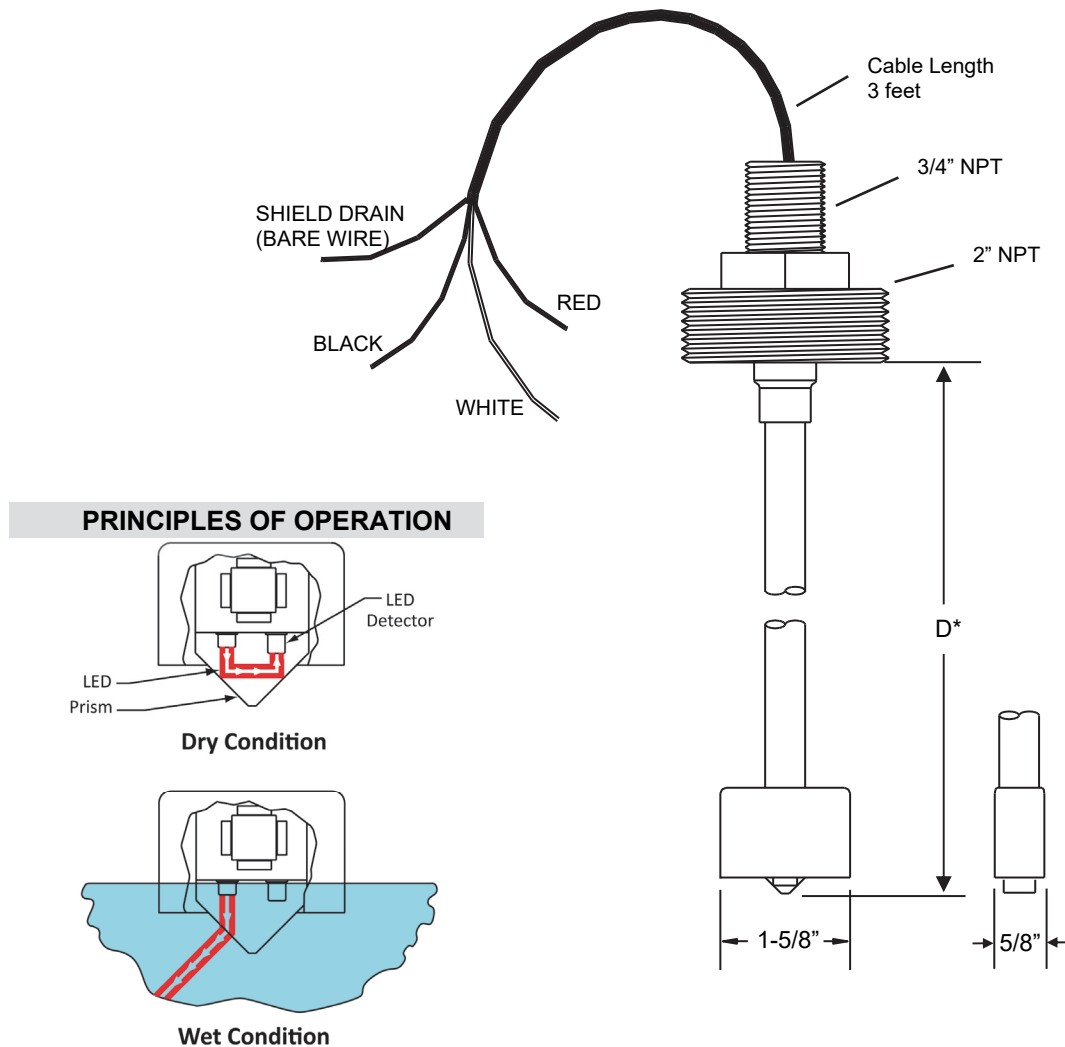

L-1 SPECIFICATIONS

U.L. LISTED 5L04

Intrinsically safe Class I, Group D Hazardous Locations when connected in accordance with Control Drawing nos. L1, L2, L3, L4, L6, L9

OPERATING TEMPERATURE

-40° to 70° C

POWER

2 VDC @ 13 mA

WEIGHT

2 pounds

PRINCIPLES OF OPERATION

LIQUIDS (ex: fuel, water) – Photo optic

DRY CONDITION – Normally closed light beam

ALARM CONDITION – Opens (refracts) normally closed light beam

SENSOR CABLE

Shielded 22 AWG UL-E118830 CM


Maximum length 2000 feet

RESPONSE TIME


Immediate

RA-SERIES REMOTE HIGH-LEVEL ALARM

RA-1

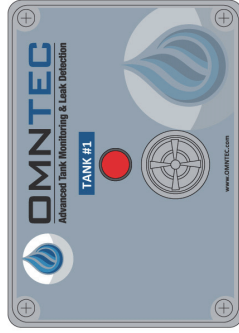

RA-2

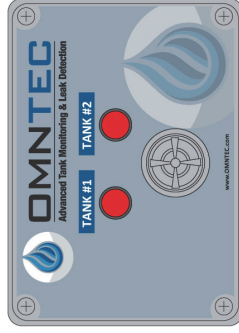





RA-3



RA-4





INTERNAL WIRING COLOR CODE

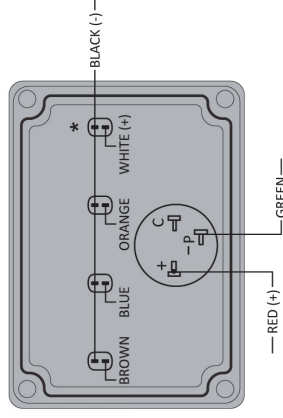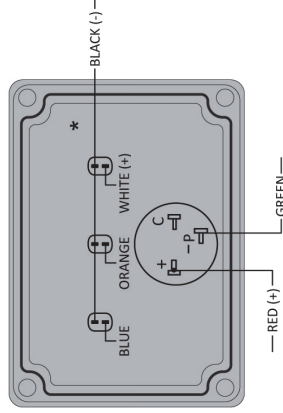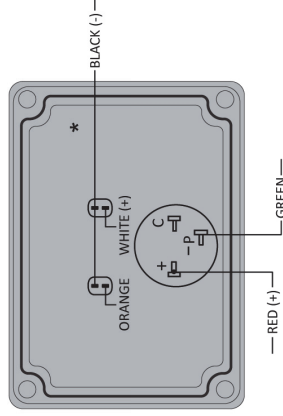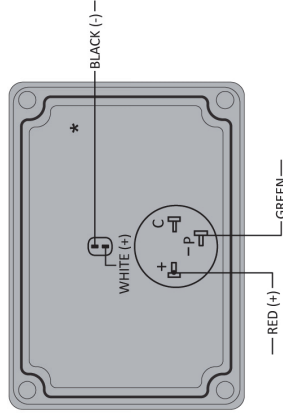

*Warning Label Placed Here

WARNING: LOW VOLTAGE INPUTS ONLY

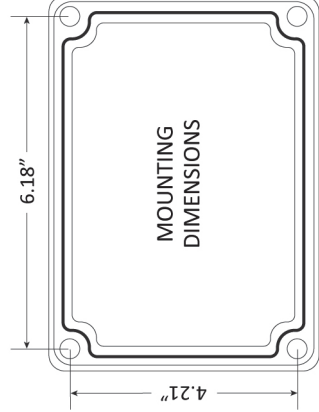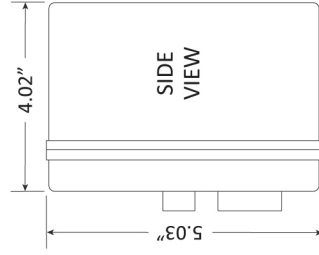

SPECIFICATIONS

Audible Alarm	95 dB pulsing horn
Red Light	Liquid-high-level alarm
Response Time	Immediate
Power Input	12VDC @200mA maximum from controller
Wire	22 AWG minimum
Weight	1 lb.

Note: It is recommended that knockouts be placed in the bottom of enclosure.



LOG SHEET

[illegible]

WARRANTY

The seller OMNTEC® Mfg., Inc. warrants to buyer defects when properly installed, and maintained by user. The seller's sole obligation is to repair or replace parts found to be defective, or non-conforming for one year and only after evaluation by factory. The liability of the seller shall not exceed the price paid for the components found to be defective. The above warranty is exclusive of all other warranties whether implied or expressed. Seller assumes no obligation for special or, indirect damages incurred by user.

All standard tank gauging systems are free of defects when properly installed and maintained by user. Warranty on tank gauging systems will only be effective after proper documentation has been submitted by the buyer to OMNTEC Mfg., Inc. The seller's sole obligation is to repair or replace parts found to be defective, or non-conforming for one year and only after evaluation by factory. Technical support must be contacted for a Return Material Authorization (RMA #) prior to sending any potentially defective parts. The liability of the seller shall not exceed the price paid for the components found to be defective. The above warranty is exclusive of all other warranties whether implied or expressed. Seller assumes no obligation for special or indirect damages incurred by user.

All standard replacement parts, "add-ons", or spare parts are free of defects when properly installed and maintained by user. The seller's sole obligation is to repair or replace parts found to be defective or non-conforming for 90 days and only after evaluation by factory. The liability of the seller shall not exceed the price paid for the components found to be defective. The above warranty is exclusive of all other warranties whether implied or expressed. Seller assumes no obligation for special or indirect damages incurred by user.

Equipment not covered by this warranty includes but is not limited to: custom equipment and control systems.