



GENERAL NOTES:

1. ELECTRICAL CONTRACTOR SHALL PROVIDE CIRCUITRY USING MINIMUM 24" DEEP TRENCH OR DIRECTIONAL BORING AS REQUIRED BY EXISTING ROADWAYS OR SIDEWALKS. ALL CIRCUITRY SHALL BE DIRECT BURIED, EXCEPT UNDER ROADWAYS, SIDEWALKS AND DRIVEWAY APRONS, WITH #4 AWG COPPER PHASE CONDUCTORS AND ONE #6 AWG GROUND CONDUCTOR. ALL CIRCUITRY TO BE ROUTED ADJACENT TO CURB WITH SAME CENTER LINE DIMENSION FROM BACK OF CURB AS LIGHT POLE BASE.
2. ELECTRICAL CONTRACTOR SHALL PROVIDE ALL LIGHTING UNIT BASES. SEE DETAILS FOR REQUIREMENTS. TOP OF BASES SHALL BE 3" ABOVE TOP OF ADJACENT CURB. VERIFY ALL LOCATIONS AND BASE ELEVATIONS WITH FIELD ENGINEER PRIOR TO INSTALLATION. OFFSET BASES AS REQUIRED TO AVOID CONFLICTS WITH ANY UNDERGROUND INFRASTRUCTURE OR HANDICAPPED RAMPS IN SIDEWALKS.
3. COORDINATE ALL UNDERGROUND UTILITIES WITH OTHER TRADES. COORDINATE WITH CIVIL ENGINEER FOR EXACT POLE PLACEMENT WITH WATER AND SEWER LINE PLACEMENT. TYPICAL.

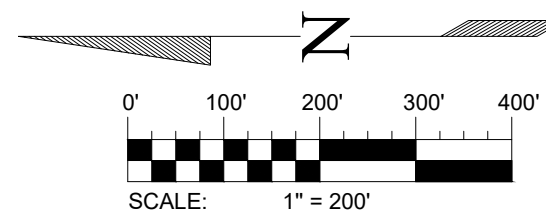

OVERALL PLAN

1" = 200' -0"

NOTES: DETAIL 1/E100

1. EXISTING STREET LIGHTING FEEDPOINT AT EXISTING LIFT STATION.



PROJECT NO.	25596
DATE	2/10/2026
DRAWN BY	JUB
CHECKED BY	JUB

REVISIONS	DATE	DATE



IMPROVEMENT DISTRICT NO. NH-4
 NEW HAVEN OF REILES ACRES 4TH ADDITION
 REILES ACRES, ND

**OVERALL ELECTRICAL
 PLAN**

E100