


REBOTEC TRIALS




Updated: Jan 21st/25



MIX COMPOSITION

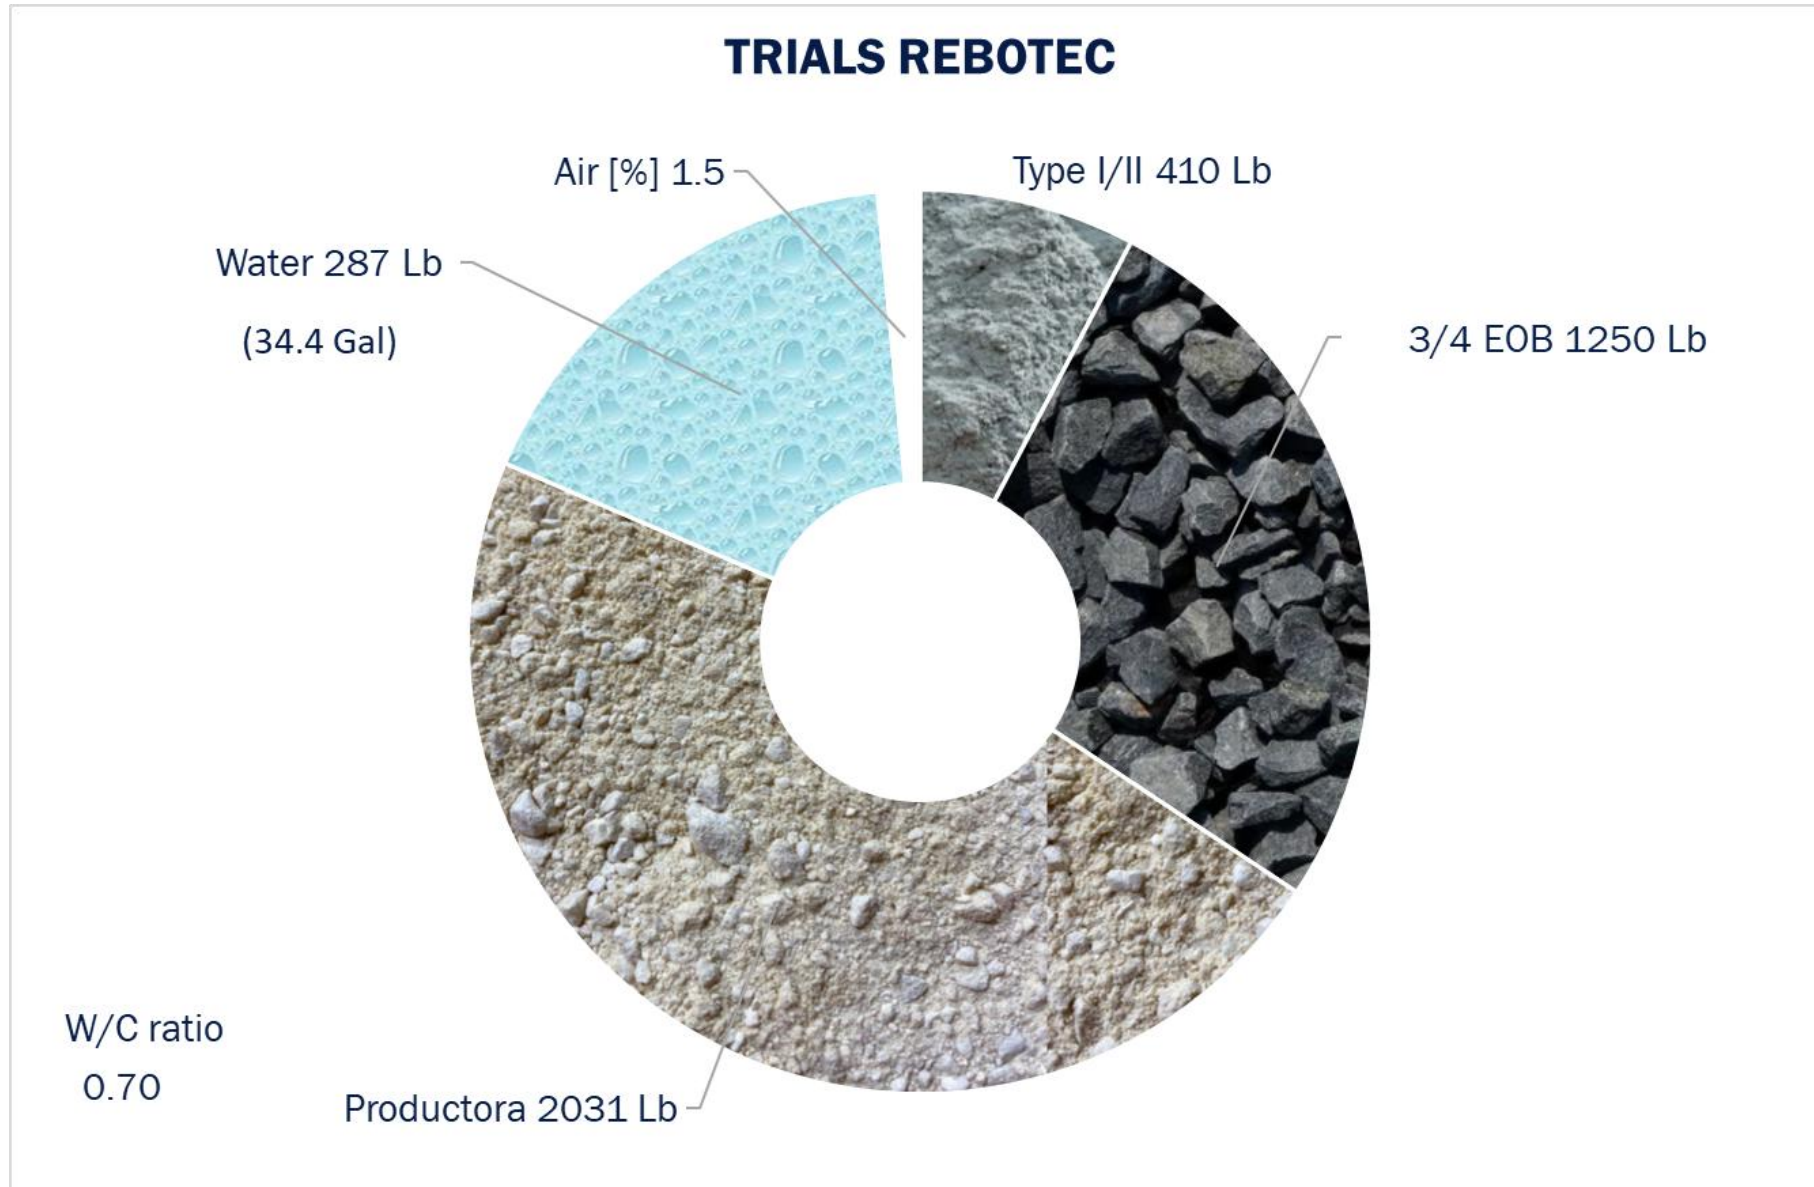

STRENGTH RESULTS

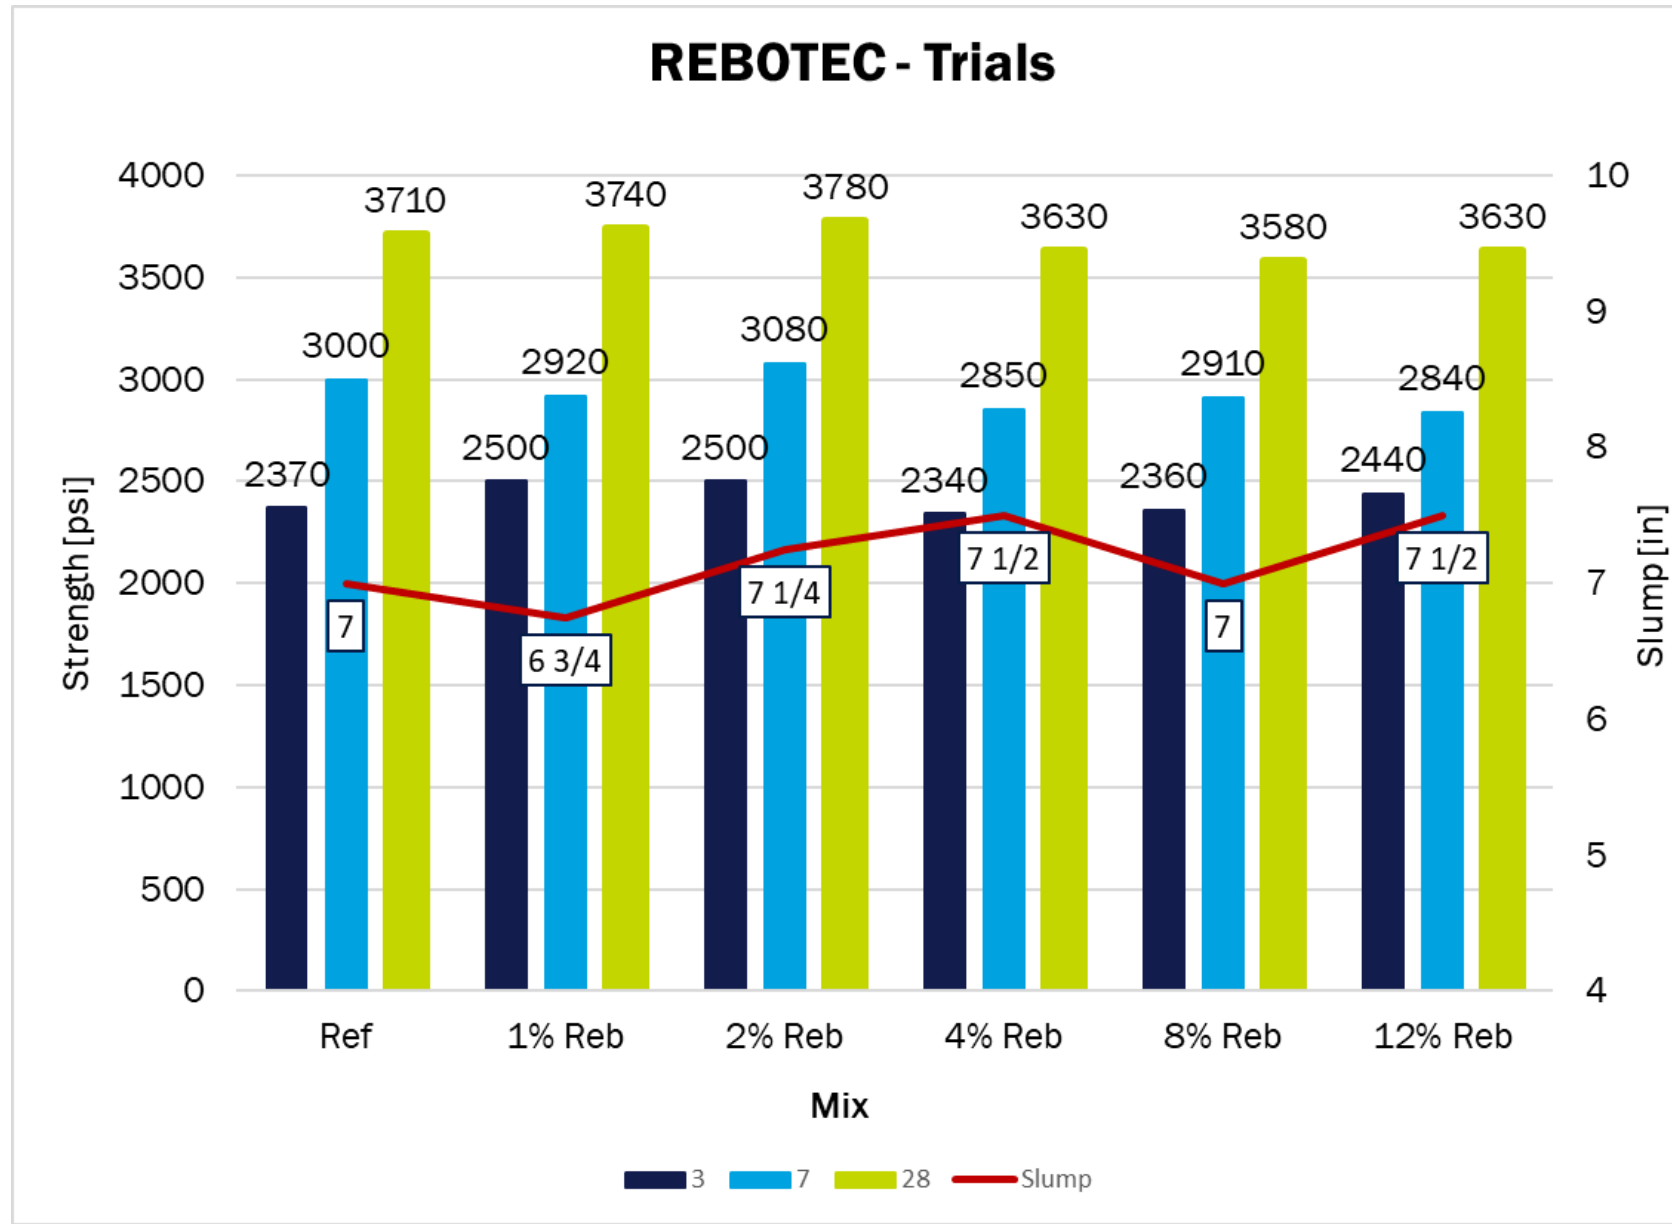

PERMEABILITY RESULTS - ASTM C1202



Fecha	Mezcla	Canal	Muestra	Status	Elapsed time	Coulombs (adjusted)	Predicted Coulombs (adjusted)
feb/5/25	Referencia	1	1-C1-B	Overflow			7920
feb/5/25		2	1-C1-T	Overflow			8852
feb/5/25	1% Rebotec	3	2-C1-B	Overflow			8309
feb/5/25		4	2-C1-T	Overflow			8515
feb/5/25	2% Rebotec	5	3-C1-B	Overflow			5691
feb/5/25		6	3-C1-T	Measured			5903
feb/5/25	4% Rebotec	7	4-C1-B	Overflow			6077
feb/5/25		8	4-C1-T	Measured			5803
feb/18/25	8% Rebotec	1	5-C1-B	Overflow	4:12	5383	8185
feb/18/25		2	5-C1-T	Overflow	2:02	2401	8587
feb/18/25	12% Rebotec	3	6-C1-B	Overflow	2:58	3649	8369
feb/18/25		4	6-C1-T	Overflow	2:03	2434	8588

RESISTIVITY RESULTS - AASHTO T358



Reading	Ref		1% Rebotec		2% Rebotec		4% Rebotec		8% Rebotec		12% Rebotec	
	1	2	3	4	5	6	7	8	9	10	11	12
1	5.0	5.2	3.8	4.4	4.2	4.7	4.2	4.3	4.1	4.7	4.5	4.8
2	4.9	4.7	4.1	4.1	4.8	4.0	4.5	4.3	4.2	4.8	4.3	4.4
3	4.9	4.7	3.7	4.3	4.9	3.9	4.2	4.3	4.4	4.5	4.3	4.3
4	4.9	4.5	3.9	4.5	4.8	4.3	4.5	4.2	4.1	4.9	4.3	4.5
5	5.0	5.0	3.9	4.2	4.2	4.6	4.2	4.4	4.1	4.8	4.7	4.9
6	5.0	4.8	4.0	4.2	4.8	4.2	4.4	4.2	4.1	5.0	4.4	4.6
7	5.0	4.8	4.0	4.5	5.1	3.9	4.2	4.4	4.4	4.6	4.3	4.6
8	4.8	4.5	3.8	4.6	4.8	4.3	4.3	4.2	4.1	4.7	4.4	4.5
Average	4.9	4.8	3.9	4.4	4.7	4.2	4.3	4.3	4.2	4.8	4.4	4.6