

Emergency Lights & Exit Signs Automated Inspection and Reporting



Eliminate Mandatory Monthly Physical Testing

- Streamline Operations
- Reduce Labor Hours
- Improve Safety
- Flexible Wireless Communications

Meets the monthly and annual testing requirements for NFPA 101 7.9 IFC & Joint Commission


Automates Testing of Emergency Lights & Exit Signs

Self-test monthly for 30 seconds

Self-test annually for 90 minutes

Configurable database of tests and failures

Cloud Based Solution

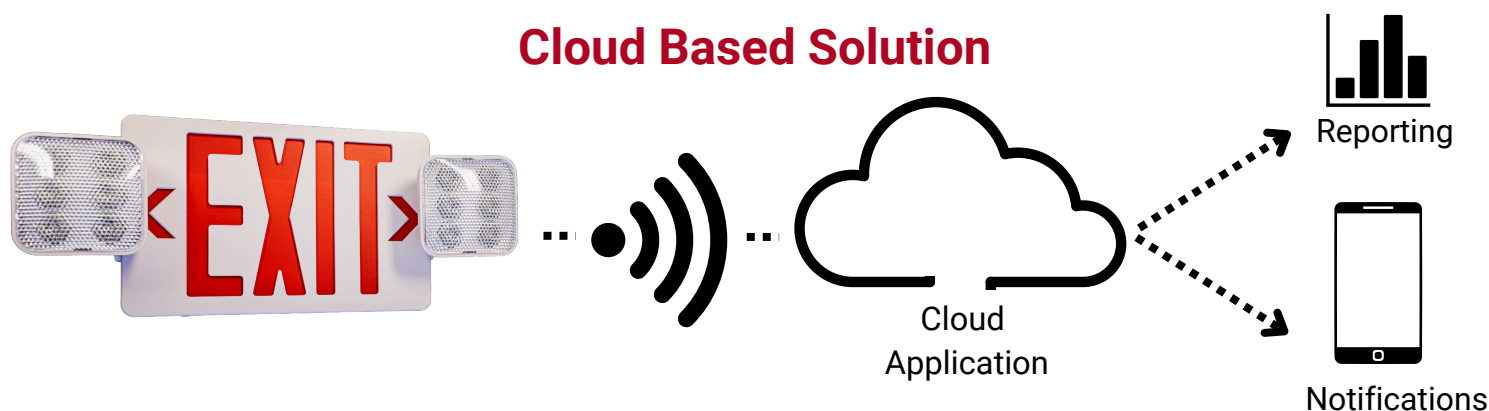


Technical Description

- 90+ Minutes of Battery Back-Up
- NI-CD Batteries
- Super Bright 2.4 Watt LED Lamps
- Accepts 120/277 VAC
- Energy Efficient
- Compatible with FXI Extinguisher Monitoring

Wireless Solution

- Flexible IT Options
- Secure encrypted communications
- Minimal network impact
- API for facilities software

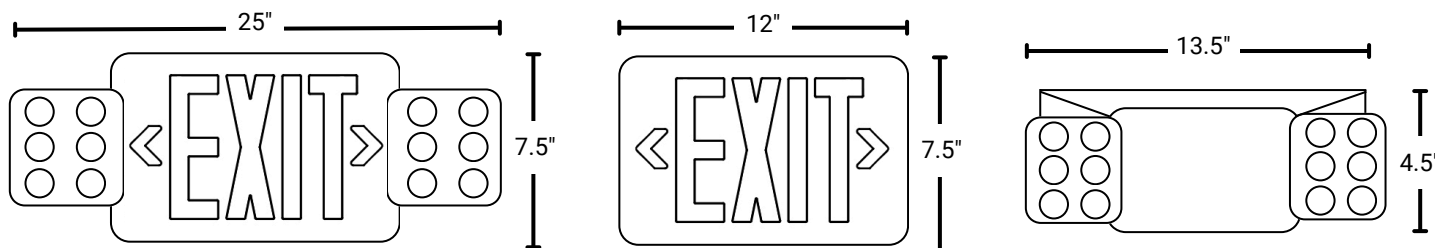

KELTRON

Keltron IoT Corporation
Rockland, MA
3.25

Automated Emergency and Exit Sign Inspection and Reporting

EL-AIR™

781-894-8710
KeltronCorp.com