




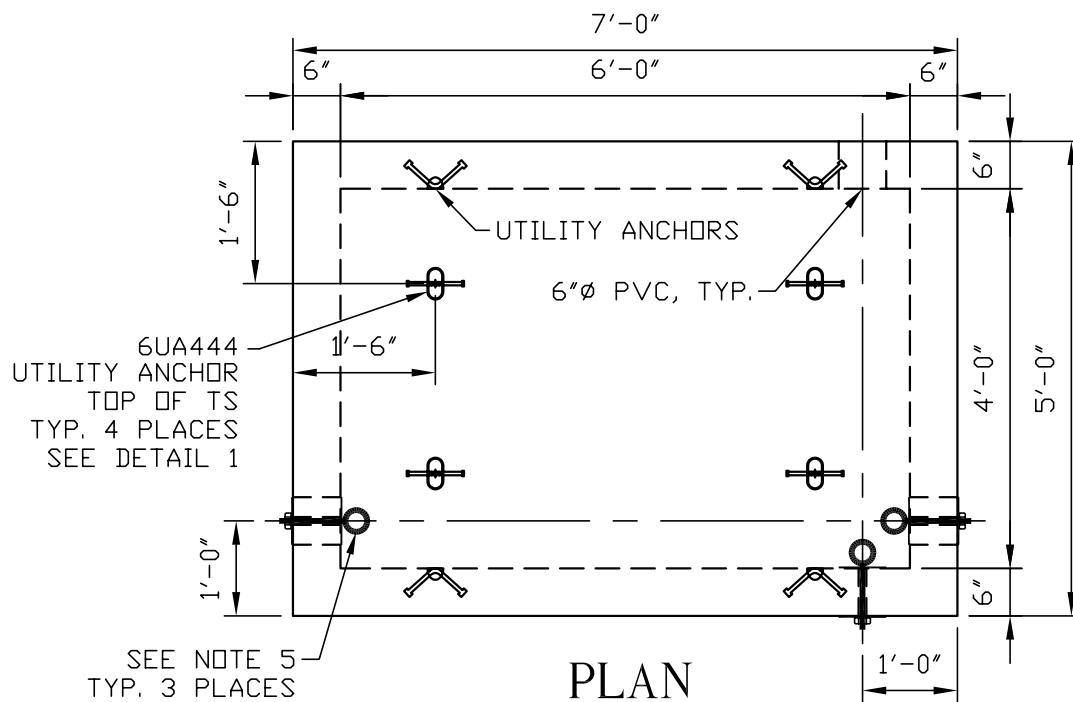


PLAN

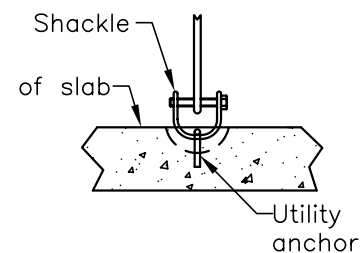

DETAIL 1



DETAIL 2

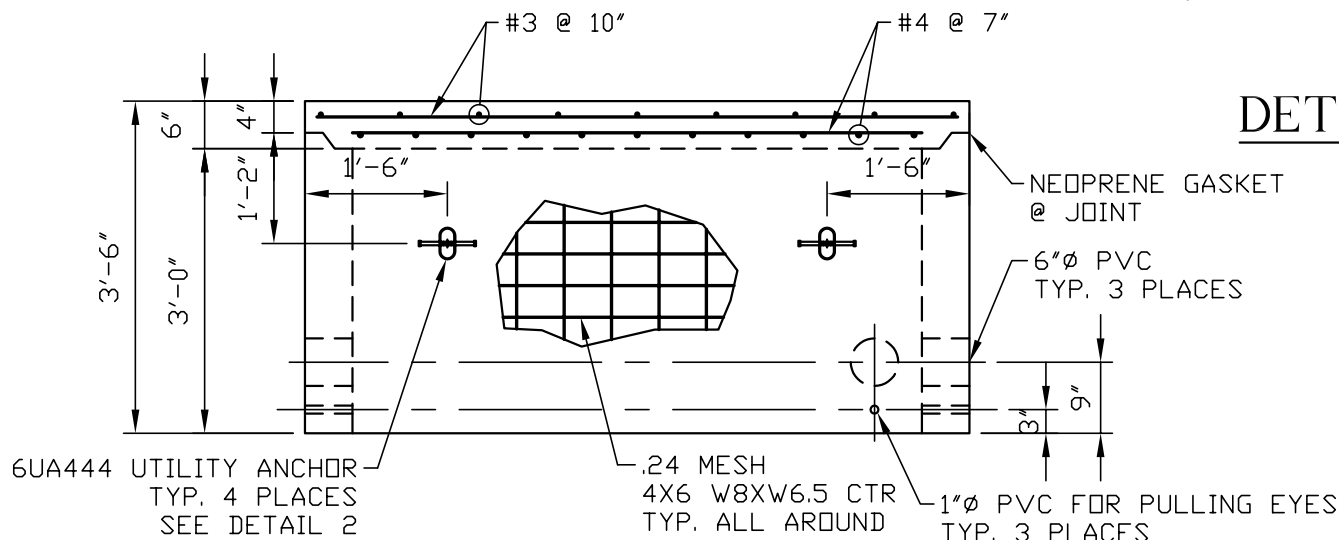

ELEVATION

GENERAL NOTES:

1. Live Load H-10
2. Concrete Strength $f'_c = 5000$ psi.
3. Reinforcing Steel: ASTM A615 (rebar) grade 60
4. Cover to reinforcing: $1\frac{1}{2}$ " u.n.o.
5. Pulling eye to be $\frac{3}{4}$ " x 8" galvanized eyebolt with 2" eye. Eyebolt to extend through 1" PVC with a 6" galvanized steel washer on both sides and fastened on the outside with a 2" galvanized steel nut.

TOP SLAB 0.65 CUBIC YARDS - 1.32 TONS

RISER 1.29 CUBIC YARDS - 2.61 TONS

GRASSY AREA PULL BOX

CONTRACTOR:

Contract No.

ENGINEER:

Date

JOB:

Drawing No.

LOCATION:

BX6X4X3GPB
Revision



Concrete Systems Inc.

9 Commercial St., Hudson, NH, 03051

Phone 603-889-4163

Fax 603-889-0039