




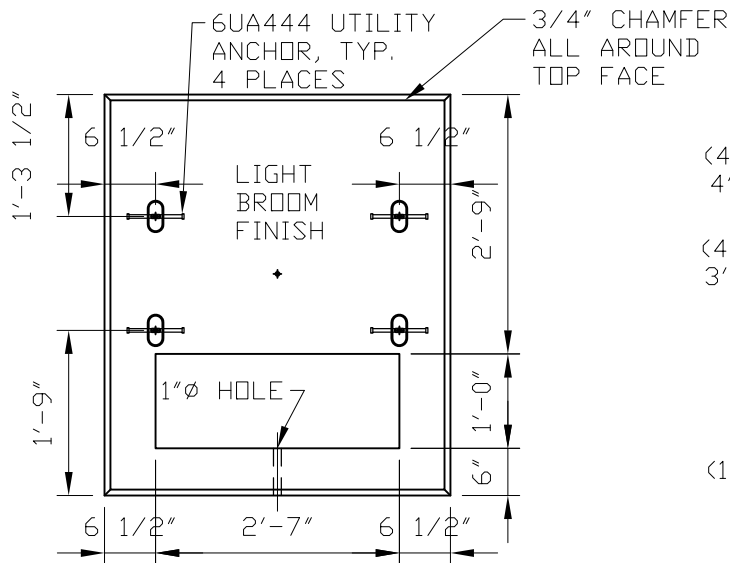


PLAN

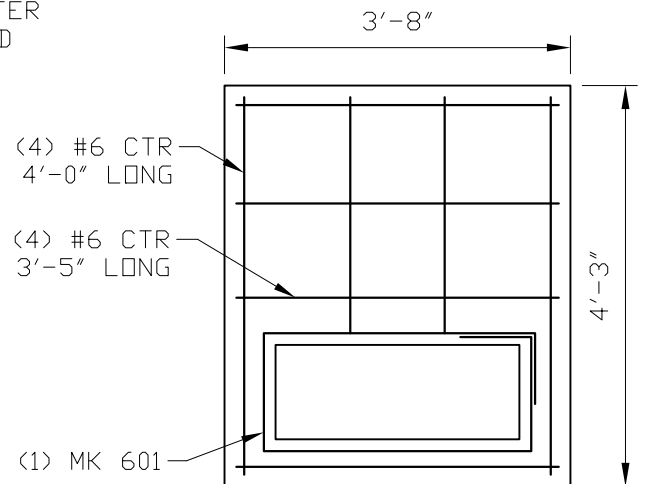

SECTION

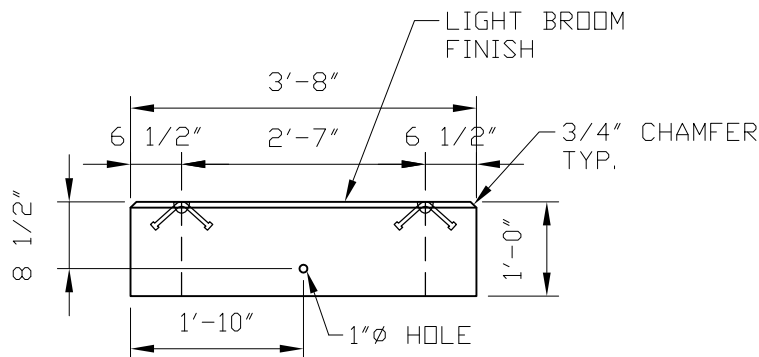

ELEVATION

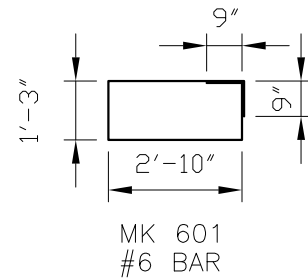

BENDING
SCHEDULE

GENERAL NOTES:

1. Concrete Strength $f'_c = 5000$ psi.
2. Reinforcing Steel: ASTM A615 (rebar) grade 60
3. Cover to reinforcing: 3" u.n.o.

0.48 CUBIC YARDS - 0.98 TONS

SINGLE PHASE TRANSFORMER PAD
TYPE 53-102 (25 TO 75 KVA)

CONTRACTOR:

Contract No.

ENGINEER:

Date

JOB:

Drawing No.

LOCATION:

BS53102TP

Revision

04/20/2012



Concrete Systems Inc.
9 Commercial St., Hudson, NH, 03051
Phone 603-889-4163
Fax 603-889-0039