



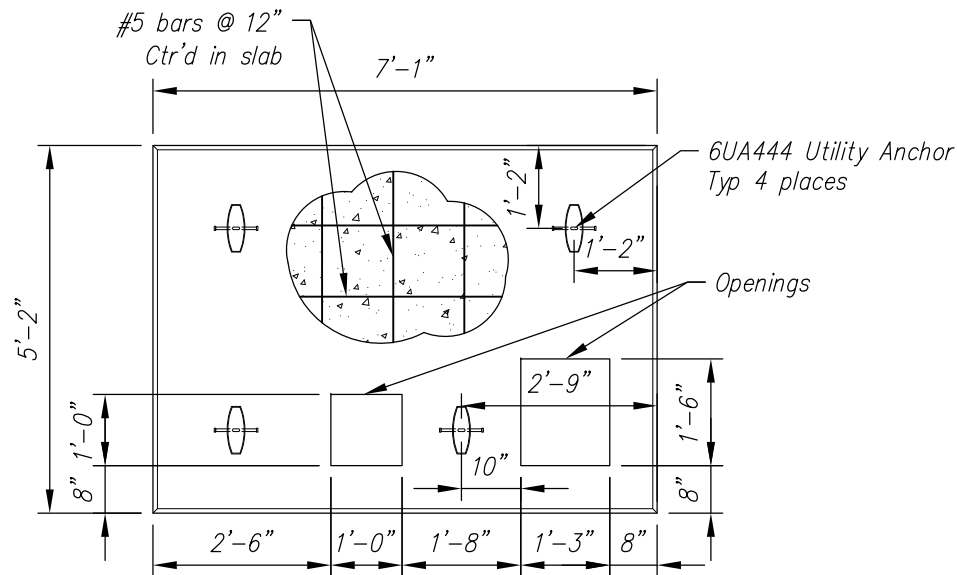


PLAN

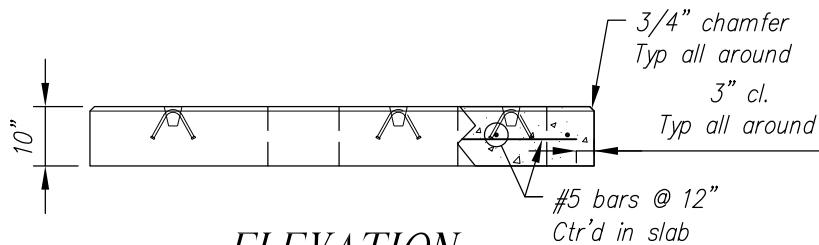

ELEVATION

GENERAL NOTES:

1. Concrete: Strength $f'_c = 5000$ psi
2. Reinforcing: ASTM A615 GR 60 plain reinforcing

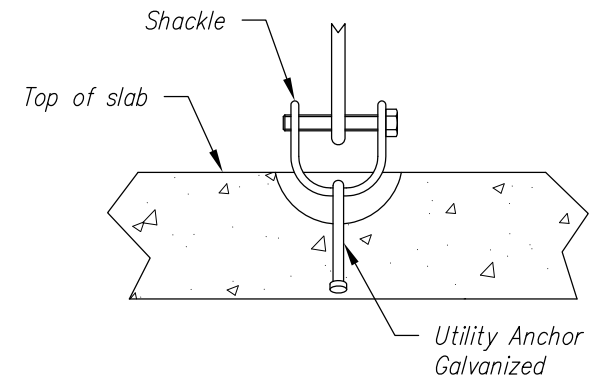

LIFTING DETAIL

CSI
Concrete Systems Inc.
9 Commercial St., Hudson, NH, 03051
Phone 603-889-4163
Fax 603-889-2417

STATE AGENCY

Drawn By
AAK
Concrete Cu. Yd.
1.05
Approved By

Date
04/04/2013
Weight in Tons
2.10
Date

A

NATIONAL GRID 25-35kV TRANSFORMER PAD (75-300kVA)
Drawing No. NG62X85TP

REV
0

Quantity:

Project No:

SHEET 1 OF 1