



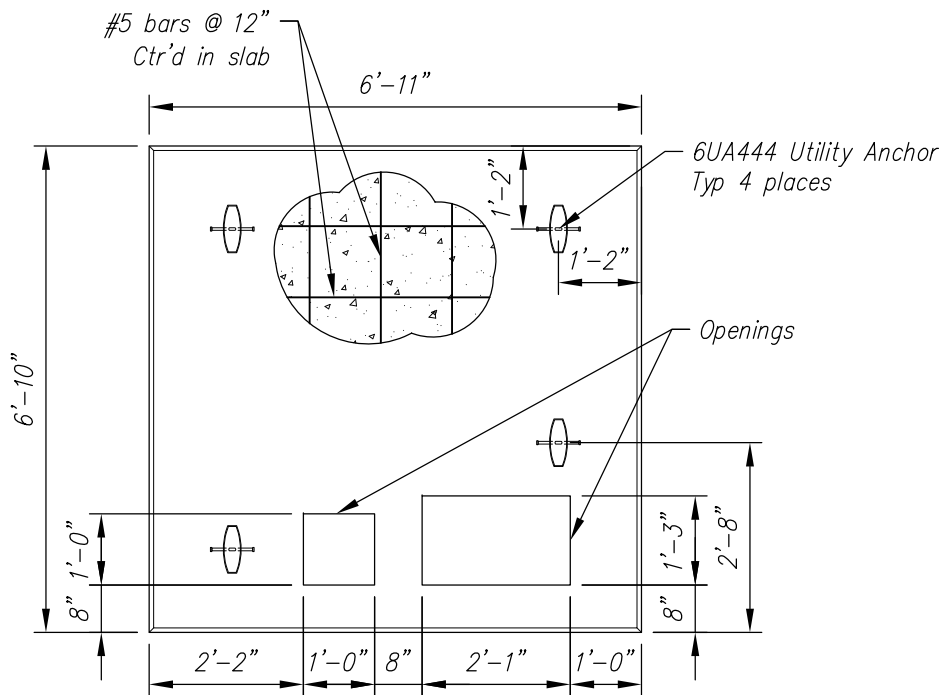


PLAN

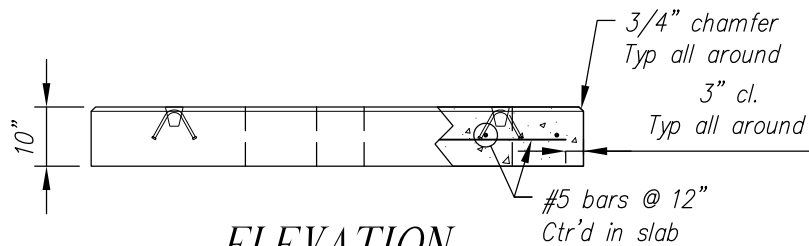

ELEVATION

GENERAL NOTES:

1. Concrete: Strength $f'_c = 5000$ psi
2. Reinforcing: ASTM A615 GR 60 plain reinforcing

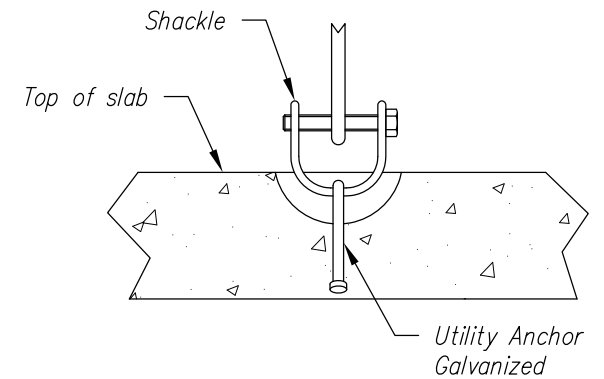

LIFTING DETAIL



Concrete Systems Inc.
9 Commercial St., Hudson, NH, 03051
Phone 603-889-4163
Fax 603-889-2417

STATE AGENCY

Drawn By

AAK

Concrete Cu. Yd.

1.35

Approved By

Date

04/04/2013

Weight in Tons

2.75

Date

A

NATIONAL GRID 15KV TRANSFORMER PAD (750-2500kVA)

Drawing No.

NG82X83TP

REV

0

Quantity:

Project No:

SHEET 1 OF 1