



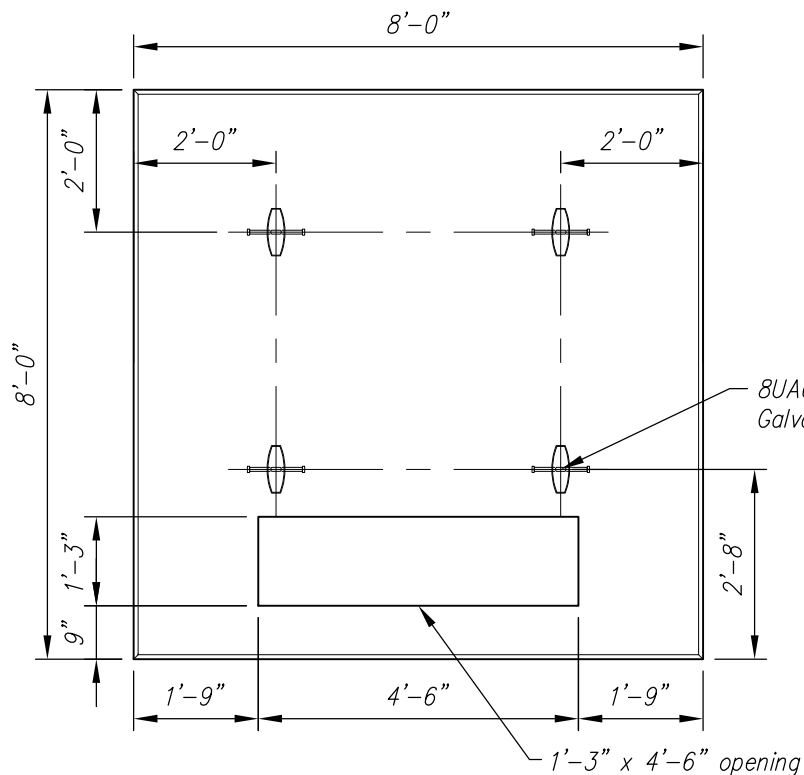

PLAN

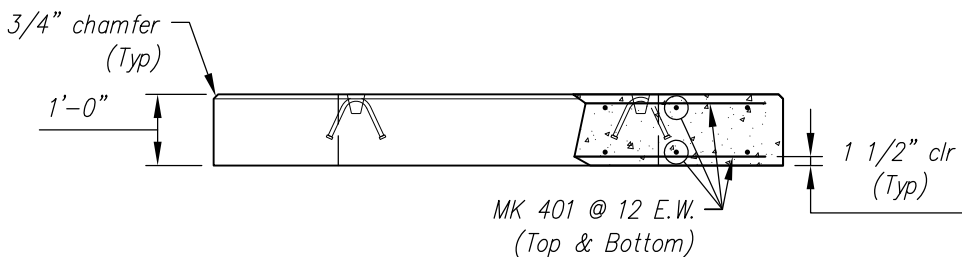

ELEVATION

GENERAL NOTES:


1. Designed for H-20 load.
2. Concrete Strength $f'_c = 5000$ psi.
3. Reinforcing Steel: ASTM A615 (rebar) grade 60
4. Cover to reinforcing: 1 1/2" u.n.o.
5. Exclusions: Inserts/penta bolts for plywood covering (by others).

BILL OF MATERIALS / EMBEDS

CSI ID#	DESCRIPTION	QTY	UM	COMMENTS
EM-00115	8UA671 UTILITY ANCHOR GALV	4	EA	
RM-00013	REBAR #4 BLACK- GR 60	166	LB	
MX-FA5000SC20	MIX DSGN 20% FLY ASH 5000 SELF COMPACT	2.17	CY	

Rebar Schedule

MK	QTY	LENGTH
401 #4	32	7' - 9"

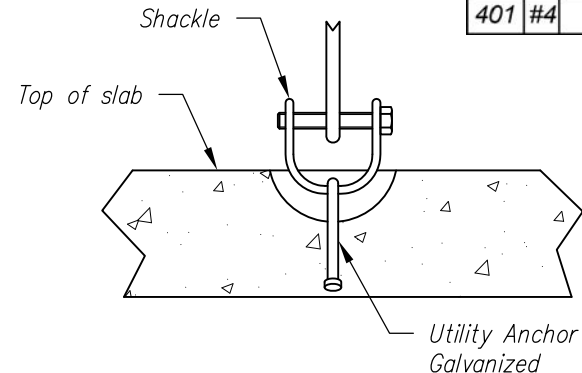

LIFTING DETAIL



Concrete Systems Inc.
9 Commercial St., Hudson, NH, 03051
Phone 603-889-4163
Fax 603-889-2417

STATE AGENCY

Drawn By
AAK
Concrete Cu. Yd.
2.17
Approved By

Date
05/09/2013
Weight in Tons
4.40
Date

NSTAR ELECTRIC

A

96"x96"x12" NSTAR TRANSFORMER PAD (500 TO 2500KVA)
Drawing No. NS96X96TP

REV
0

Quantity:

Project No:

SHEET 1 OF 1