


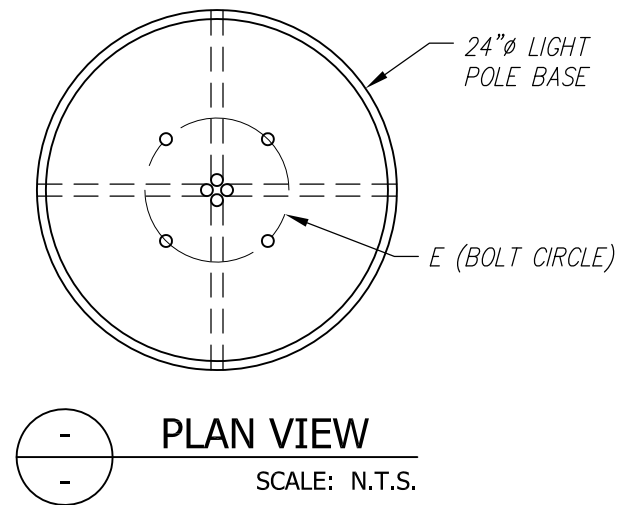

DIMENSIONS

A.) OVERALL HEIGHT:

B.) BOLT PROJECTION:

C.) DEPTH OF CONDUIT:

D.) REVEAL ABOVE GRADE:

E.) BOLT CIRCLE DIA:

F.) GROUND WIRE:

G.) CONDUIT:

H.) ANCHOR BOLT SIZE:

QTY: _____

QTY: _____

QTY: _____



QTY: _____

QTY: _____

QTY: _____


QTY: _____

QTY: _____

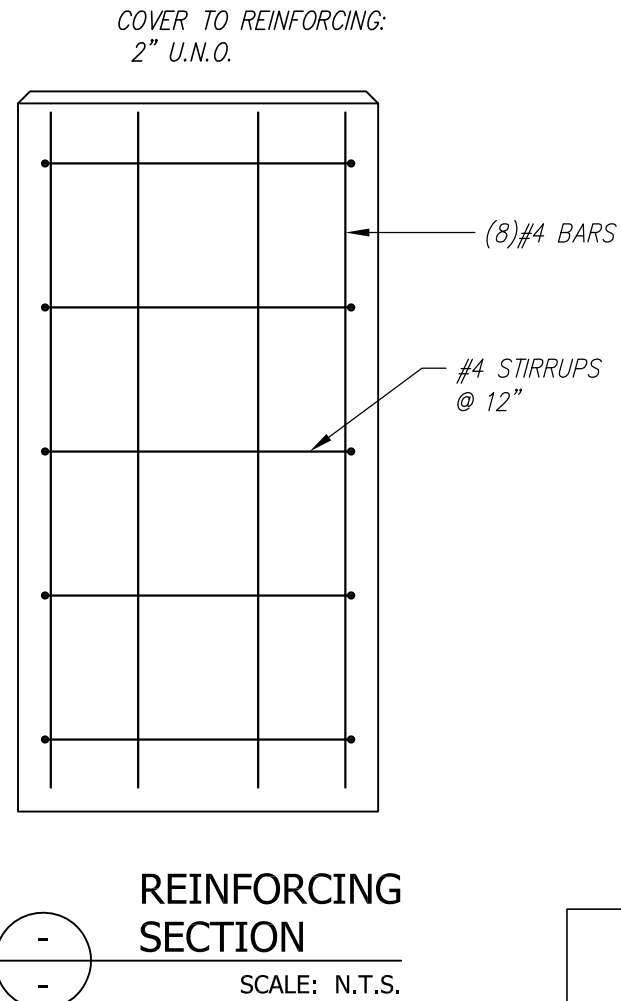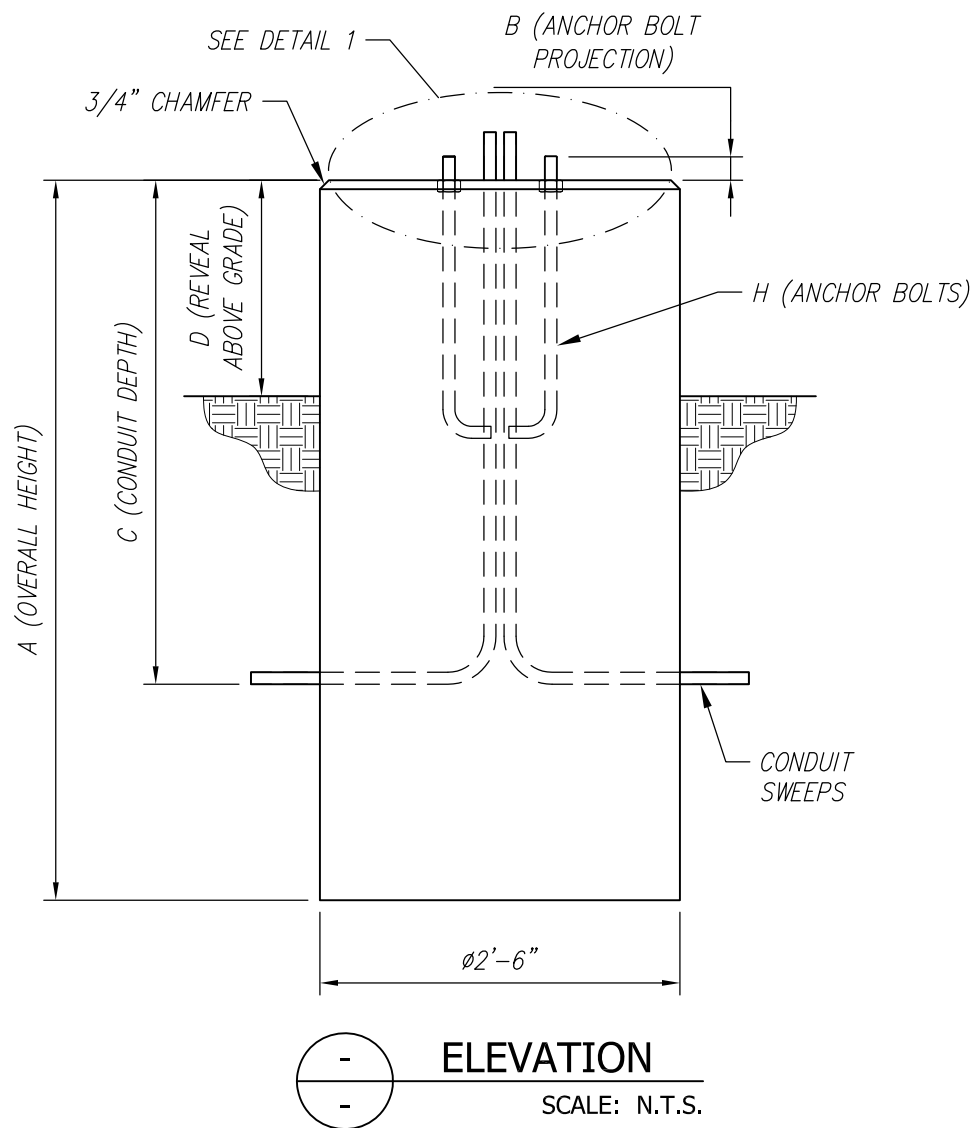

GENERAL NOTES:

1. CONCRETE STRENGTH $F'c = 5,000$ PSI.
2. REINFORCING STEEL: ASTM A615 (REBAR) GRADE 60
3. COVER TO REINFORCING: 2" U.N.O.
4. ALL CONDUIT, ANCHOR BOLTS AND ANY OTHER HARDWARE TO BE SUPPLIED BY THE CONTRACTOR.
5. WEIGHT = 737 LBS/VF

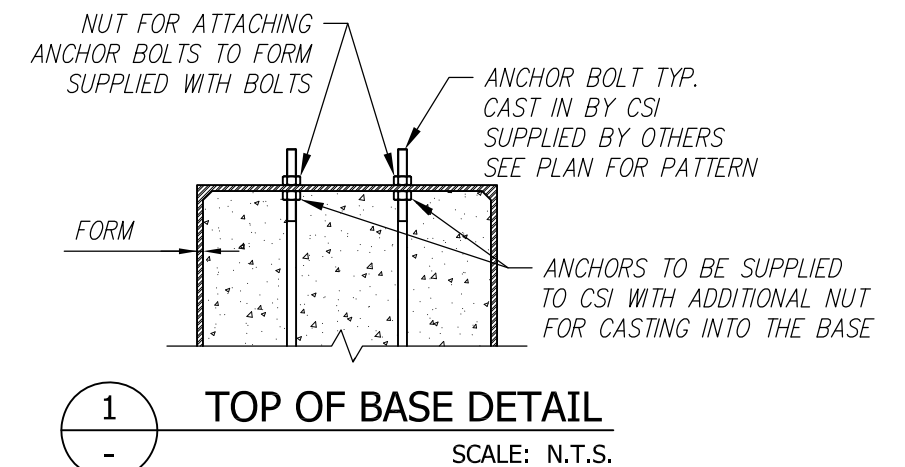

CSI

Concrete Systems Inc.

9 Commercial St., Hudson, NH, 03051

Phone 603-889-4163

Fax 603-889-2417

30"Ø LIGHT POLE BASE

CUSTOMER: _____

PROJECT NAME: _____

PROJECT LOCATION: _____