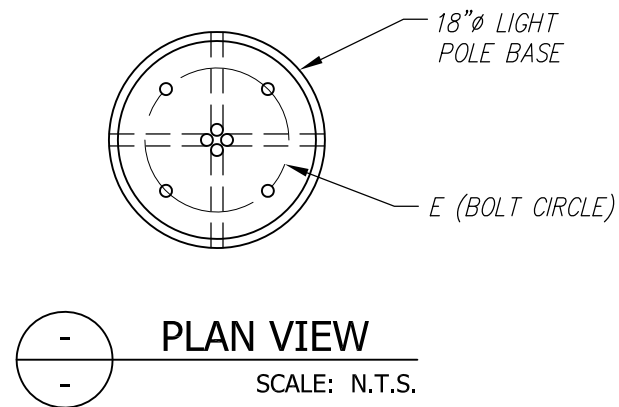




DIMENSIONS

A.) OVERALL HEIGHT: _____

B.) BOLT PROJECTION: _____

C.) DEPTH OF CONDUIT: _____









D.) REVEAL ABOVE GRADE: _____

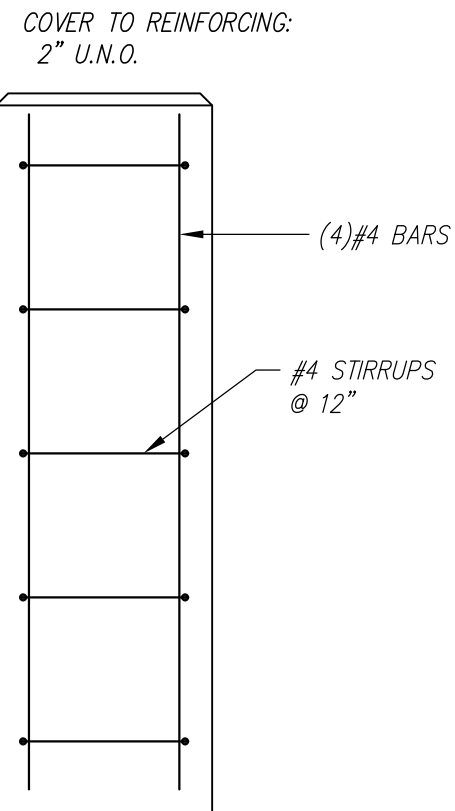
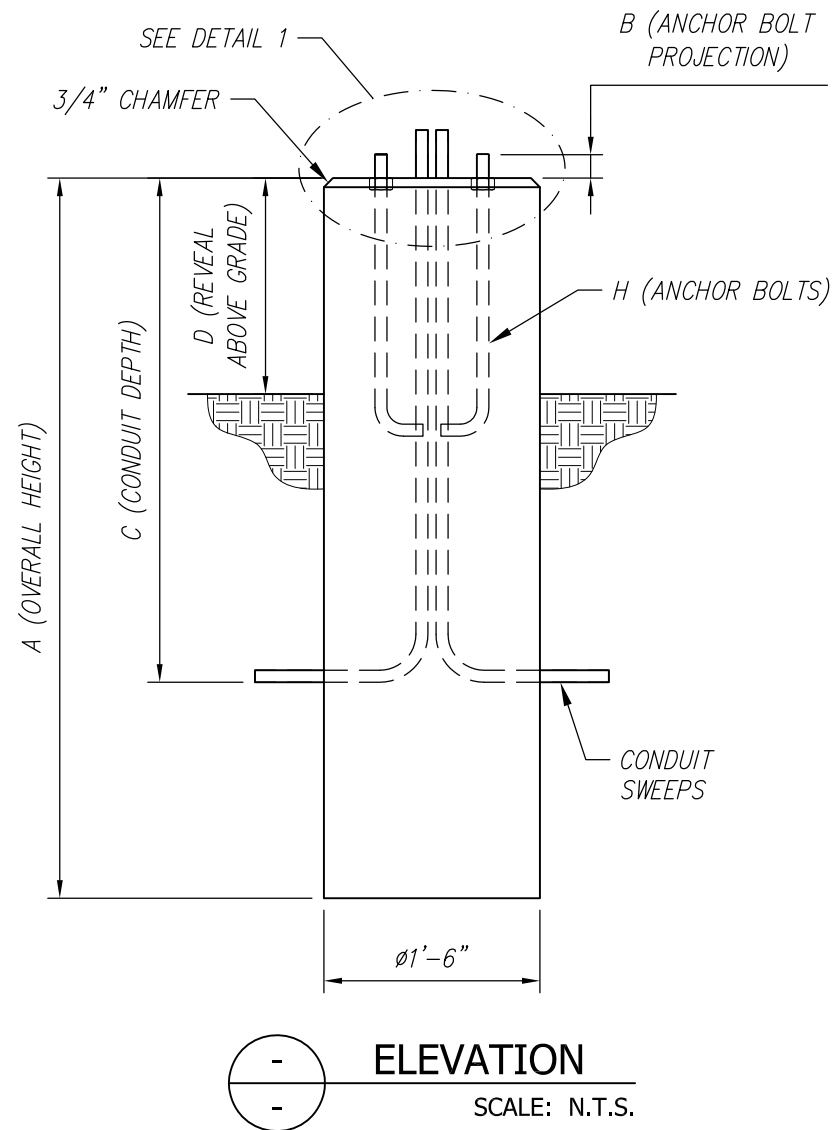
E.) BOLT CIRCLE DIA: _____

F.) GROUND WIRE: _____

G.) CONDUIT: _____

H.) ANCHOR BOLT SIZE: _____

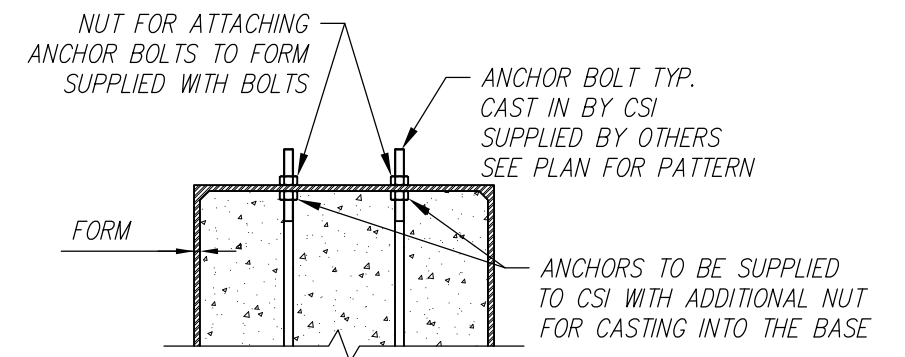
			
QTY: _____	QTY: _____	QTY: _____	QTY: _____
			
QTY: _____	QTY: _____	QTY: _____	QTY: _____



REINFORCING SECTION
SCALE: N.T.S.

GENERAL NOTES:

1. CONCRETE STRENGTH $F'C = 5,000$ PSI.
2. REINFORCING STEEL: ASTM A615 (REBAR) GRADE 60
3. COVER TO REINFORCING: 2" U.N.O.
4. ALL CONDUIT, ANCHOR BOLTS AND ANY OTHER HARDWARE TO BE SUPPLIED BY THE CONTRACTOR.
5. WEIGHT = 265 LBS/VF



1 TOP OF BASE DETAIL
SCALE: N.T.S.

 Concrete Systems Inc. 9 Commercial St., Hudson, NH, 03051 Phone 603-889-4163 Fax 603-889-2417	18"Ø LIGHT POLE BASE	
	CUSTOMER: _____	
	PROJECT NAME: _____	
PROJECT LOCATION: _____		