


INSTALLATION NOTES

1. Set door speeds, force, time delay and verify proper door operation prior to final connection of sensors system.
2. Primary activation must be Knowing Act. If not then technician MUST WALK TEST to verify function and detection patterns comply with ANSI/BHMA A156.10 requirements.
3. On Knowing Act applications, push/pull activation must be disabled.

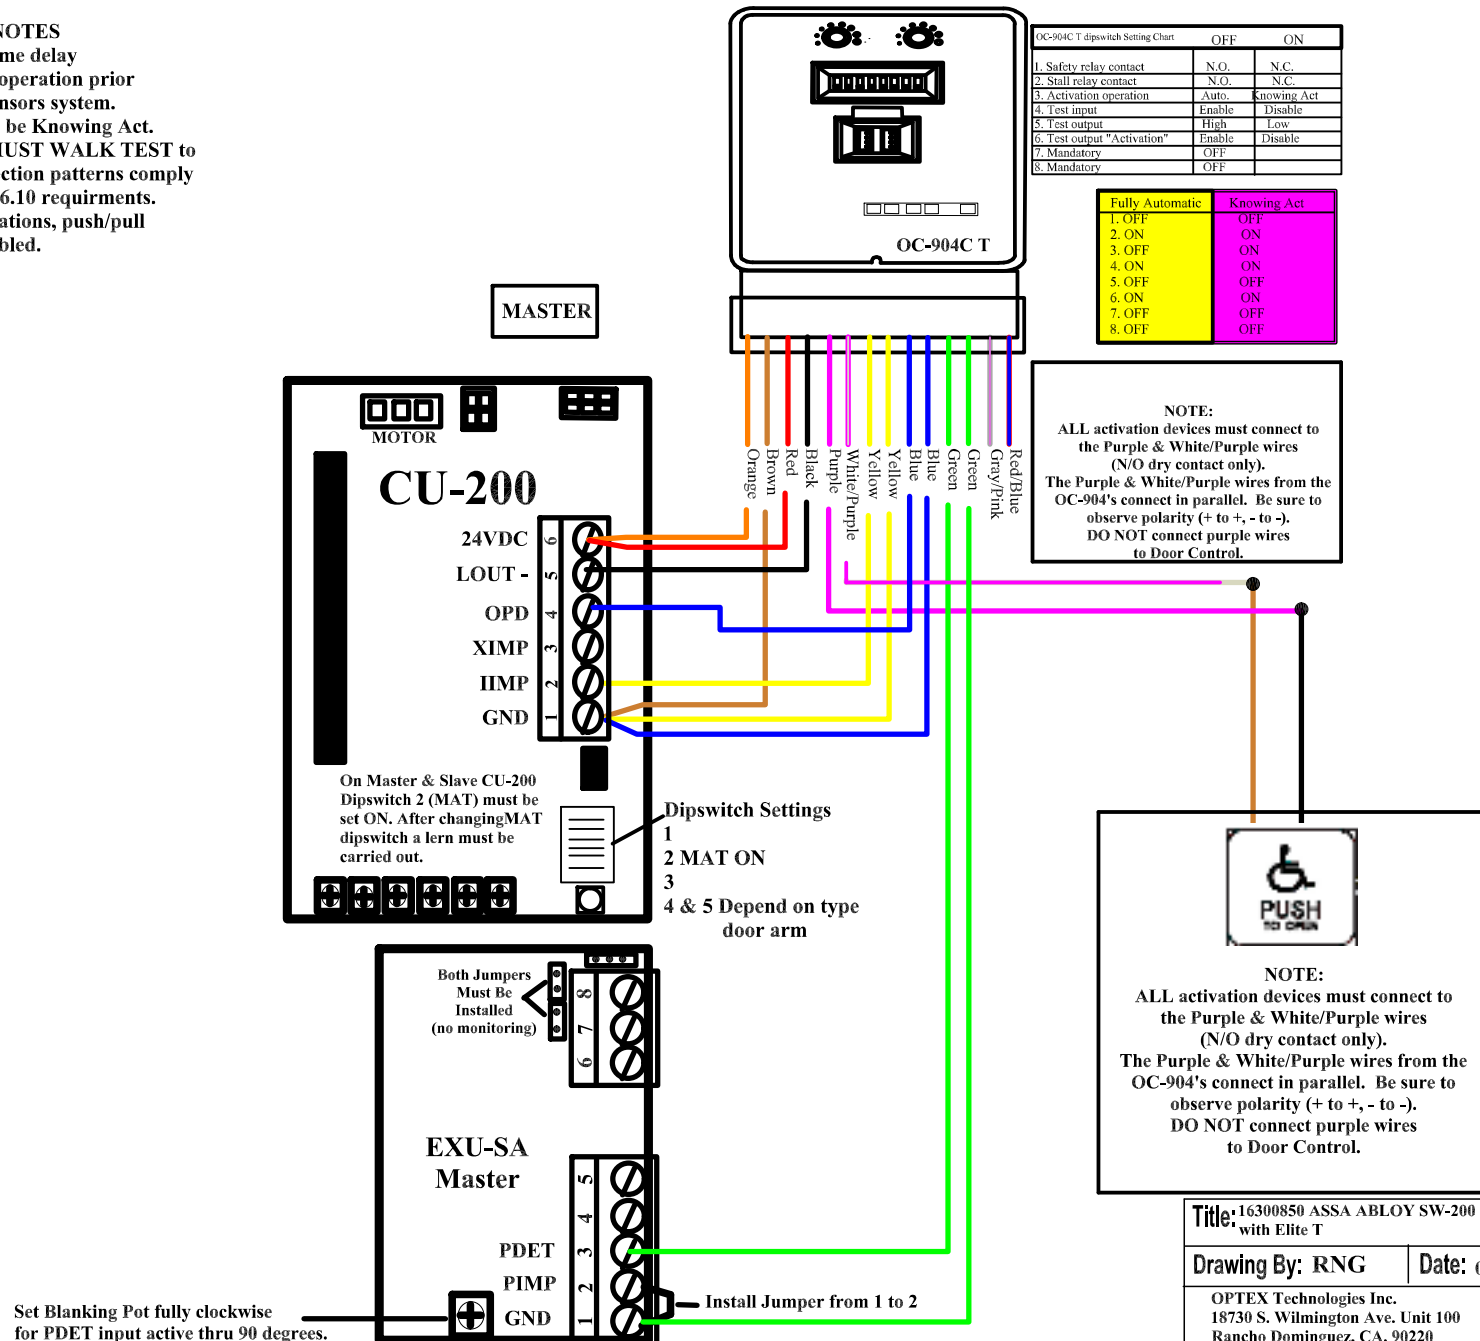

Title: 16300850 ASSA ABLOY SW-200 Single with Elite T

Drawing # 16300850

Drawing By: RNG

Date: 09/16/17

Sheet: 1 of 1

OPTEx Technologies Inc.
18730 S. Wilmington Ave. Unit 100
Rancho Dominguez, CA. 90220
800-877-6656 FAX 310-898-1098