

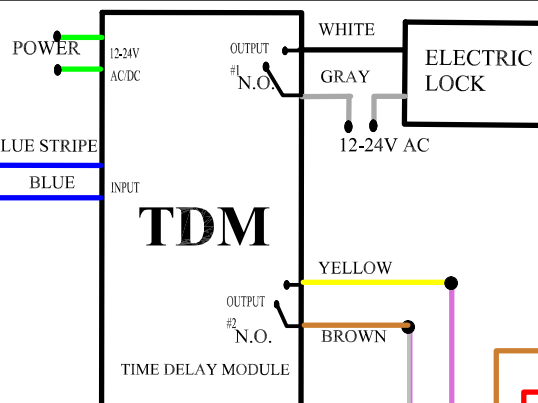


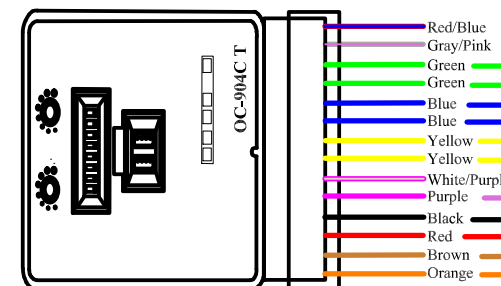

Note:
For Mag locks use
the N/C contact of
the TDM output #1

NOTE: All activating devices (pushplates, card readers, motion sensors, etc.) must connect to the TDM. Purple and White/Purple wires from both OC-904C T controls connect in parallel. Be sure to observe polarity of the purple wires (+ to +, - to -).

NOTE: On both Controls set UAL = 90, OCD = 0.1

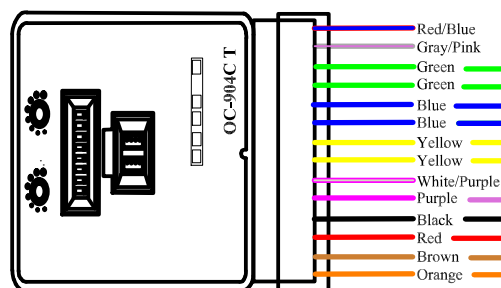


OC-904C T dipswitch Setting Chart		
	OFF	ON
1. Safety relay contact	N.O.	N.C.
2. Stall relay contact	N.O.	N.C.
3. Activation operation	Auto.	Knowing Act
4. Test input	Enable	Disable
5. Test output	High	Low
6. Test output "Activation"	Enable	Disable
7. Mandatory	OFF	
8. Mandatory	OFF	

Fully Automatic	Knowing Act
1. OFF	OFF
2. OFF	OFF
3. OFF	ON
4. ON	ON
5. OFF	OFF
6. ON	ON
7. OFF	ON
8. OFF	OFF

INSTALLATION NOTES

1. Set door speeds and verify proper door operation prior to final connection of sensors system.
2. Technician **MUST WALK TEST** to verify function and detection patterns comply with ANSI/BHMA A156.10 requirements.

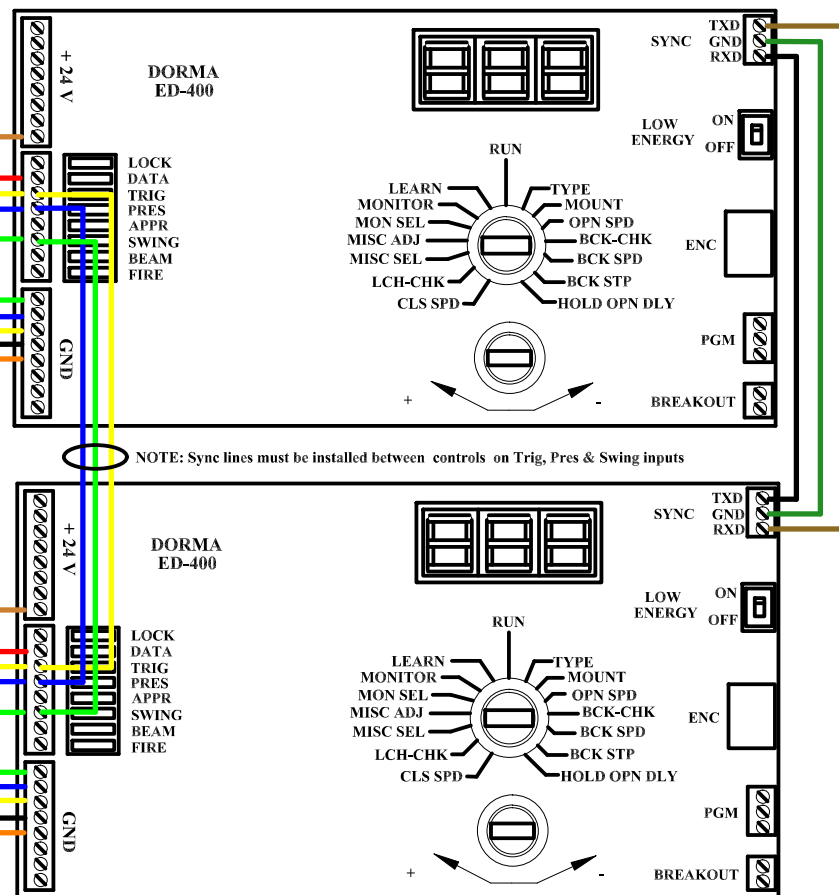

NOTE: Sync lines must be installed between controls on Trig, Pres & Swing inputs

NOTE: For Knowing Act applications Push/Pull activation must be DISABLED at the door control.

Title: 16300560 Dorma ED-400 Sim. Pair with Elite Tand Electric Lock		Drawing # 16300560
Drawing By: RNG	Date: 09/16/17	Sheet: 1 of 1
OPTEx Technologies Inc. 18730 S. Wilmington Ave. Unit 100 Rancho Dominguez, CA. 90220 800-877-6656 FAX 310-898-1098		