



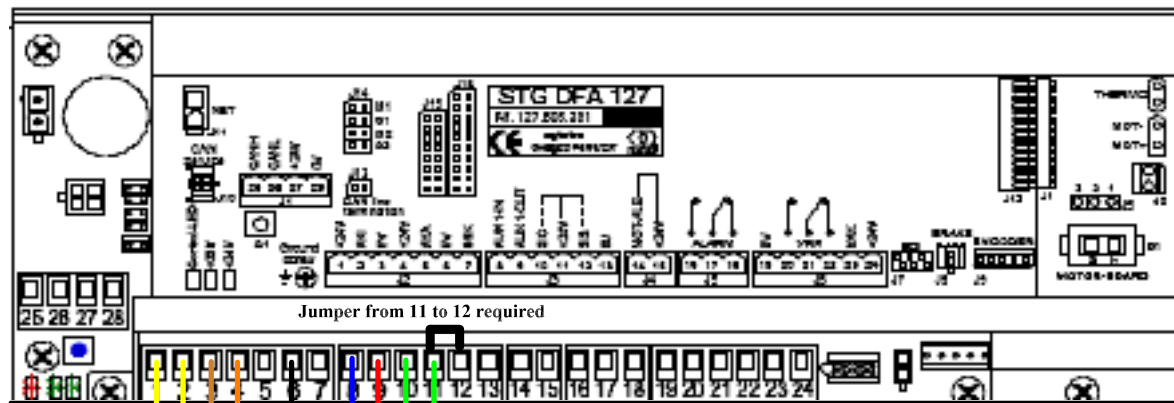

NOTE:
On Record control program both
AUX 1 Output and AUX 1 Input
to "BEA Bodyguard".

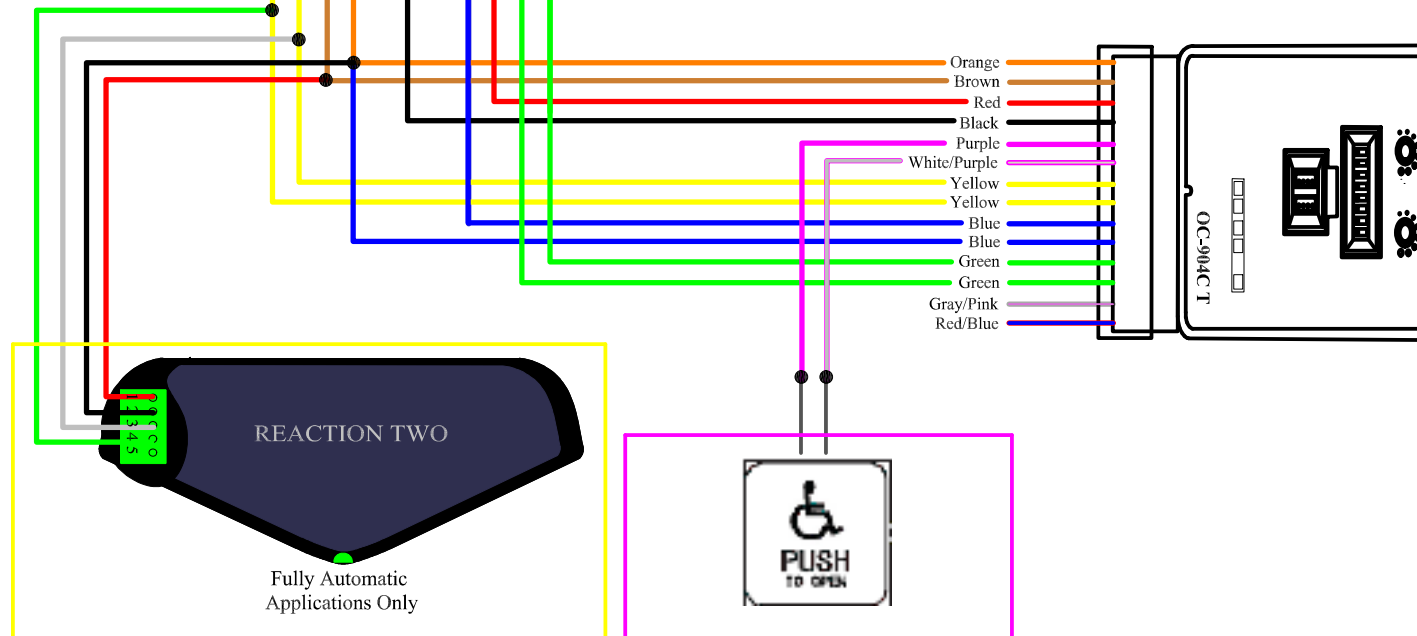

OC-904C T dipswitch Setting Chart			OFF	ON
1. Safety relay contact	N.O.	N.C.		
2. Stall relay contact	N.O.	N.C.		
3. Activation operation	Auto.	Knowing Act		
4. Test input	Enable	Disable		
5. Test output	High	Low		
6. Test output "Activation"	Enable	Disable		
7. Mandatory	OFF			
8. Mandatory	OFF			

Fully Automatic	Knowing Act
1. OFF	OFF
2. ON	ON
3. OFF	ON
4. ON	ON
5. OFF	OFF
6. ON	ON
7. OFF	OFF
8. OFF	OFF

NOTE:
ALL activation devices must connect to
the Purple & White/Purple wires
(N/O dry contact only).
The Purple & White/Purple wires from the
OC-904C T's connect in parallel. Be sure to
observe polarity (+ to +, - to -).
DO NOT connect purple wires
to Door Control.

INSTALLATION NOTES

1. Set door speeds and verify proper door operation prior to final connection of sensors system.
2. Technician MUST WALK TEST to verify function and detection patterns comply with ANSI/BHMA A156.10 requirements.

Title: 16300820 Record 8000 Single With Elite T		Drawing # 16300820
Drawing By: RNG	Date: 09/16/17	Sheet: 1 of 1
OPTEx Technologies Inc. 18730 S. Wilmington Ave. Unit 100 Rancho Dominguez, CA. 90220 800-877-6656 FAX 310-898-1098		