


INSTALLATION NOTES

1. Set door speeds and verify proper door operation prior to final connections of sensors system.
2. Technician MUST WALK TEST to verify function and detection patterns comply with ANSI/BHMA A156.10 requirements.
3. Stanley Control TB1 pins 6 & 8 must be connected to the breakout status switch or be jumpered together.
4. Stanley Control switch S-1 set to L for Low energy Magic-Force singles.
Set to H for all Magic-Swing and all Dual Magic-Force.

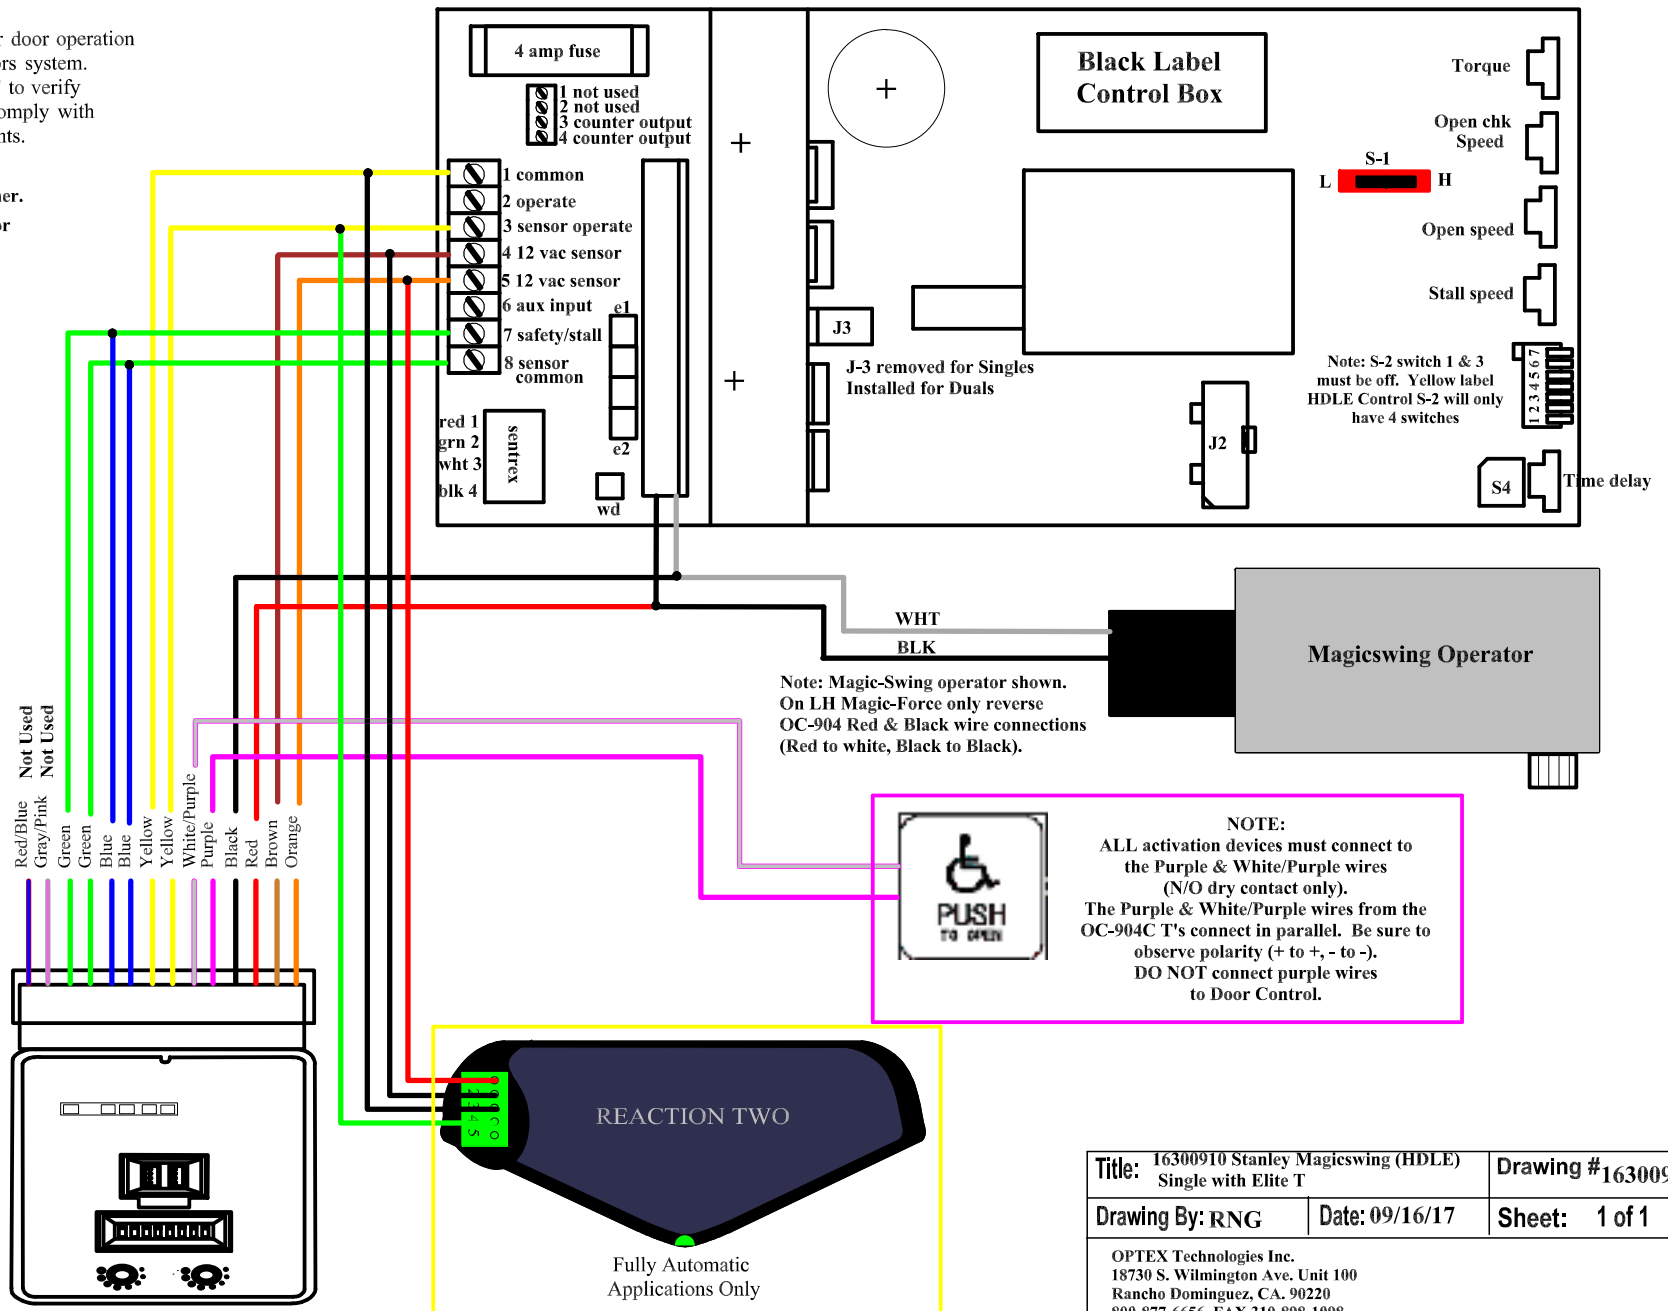

Title: 16300910 Stanley Magicswing (HDLE) Single with Elite T		Drawing #16300910
Drawing By: RNG	Date: 09/16/17	Sheet: 1 of 1
OPTEX Technologies Inc. 18730 S. Wilmington Ave. Unit 100 Rancho Dominguez, CA. 90220 800-877-6656 FAX 310-898-1098		