




X-Zone T EXTERIOR



X-Zone T INTERIOR

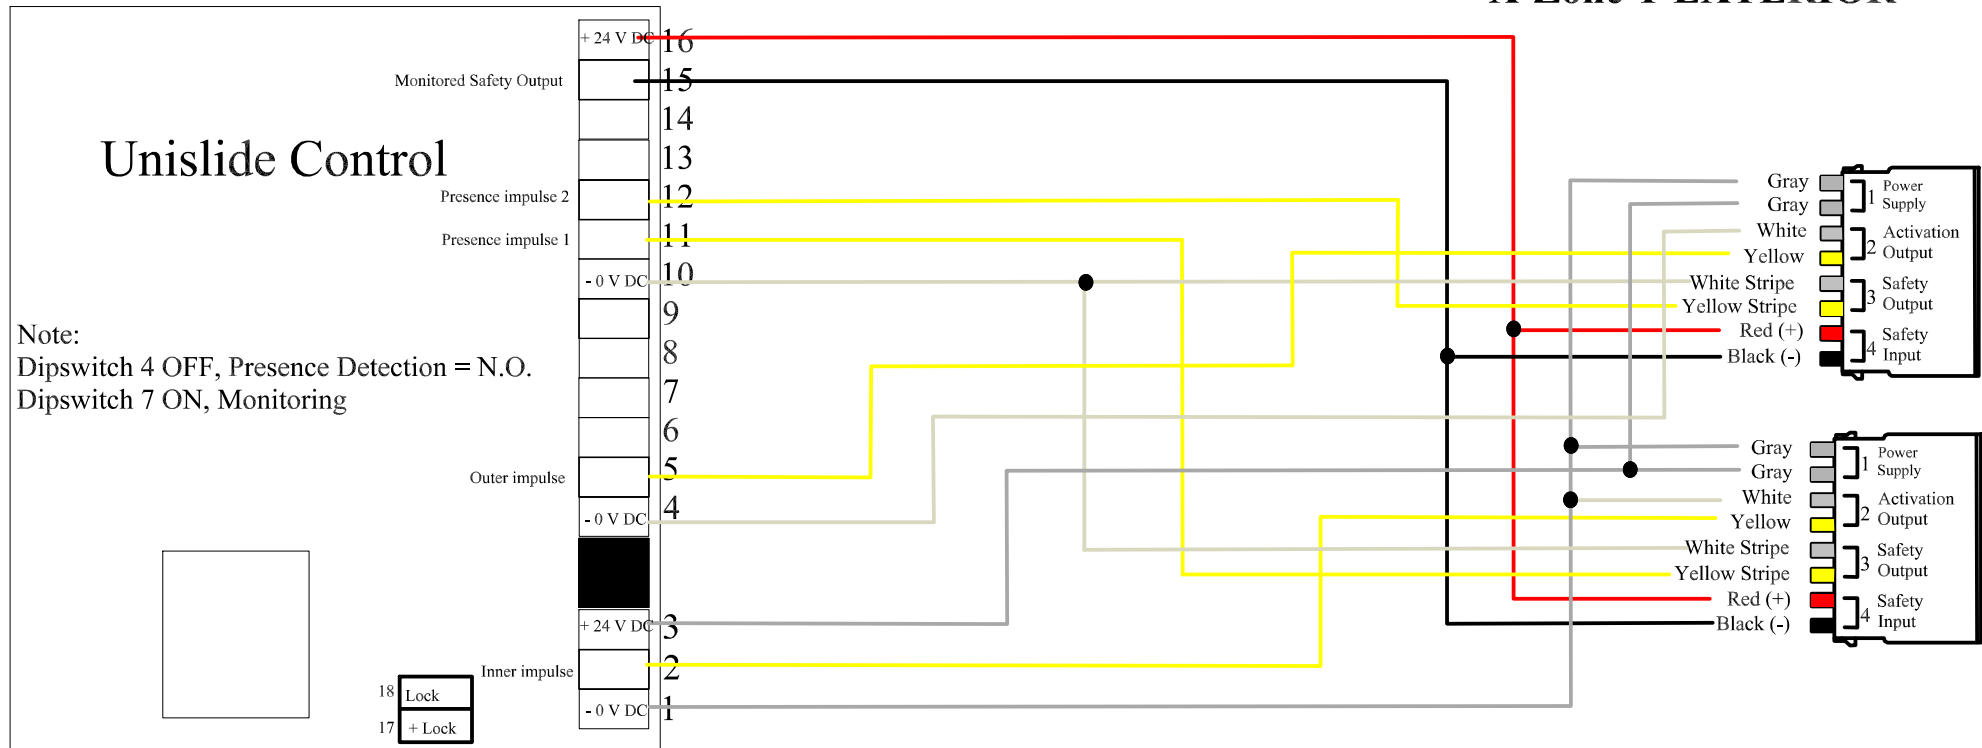

Notes:

1. Verify proper door operation prior to final connection of sensors.
2. On Unislide control, set dipswitch 4 OFF, set dipswitch 7 ON.
3. X-Zone T dipswitch 11 & 12 must be OFF (down) & dipswitch 13 ON (up) for proper monitoring operation.
4. Technician must perform a field test to verify substantial compliance with ANSI/BHMA A156.10 Section 8.

Title: 16300040 ASSA ABLOY UniSlide with X-Zone T		Drawing # 16300040
Drawing By: RNG	Date: 5/9/16	Sheet: 1 of 1
OPTEX Technologies Inc. 18730 S. Wilmington Ave. Unit 100 Rancho Dominguez, CA. 90220 800-877-6656 FAX 310-898-1098		