




NOTES:

1. MINIMUM 5,000 PSI CONCRETE @ 28 DAYS
2. REINFORCEMENT BAR A.S.T.M. A615 GRADE 60, WWF CONFORM TO ASTM A185
3. COVER TO STEEL 1" MINIMUM
4. VAULTS ARE DESIGNED TO MEET MET-ED AND PP&L SPECIFICATIONS.
5. EARTH COVER 0-2 FEET.
6. JOINT SEALED WITH MINIMUM 1" DIA BUTYL RUBBER OR EQUIVALENT.

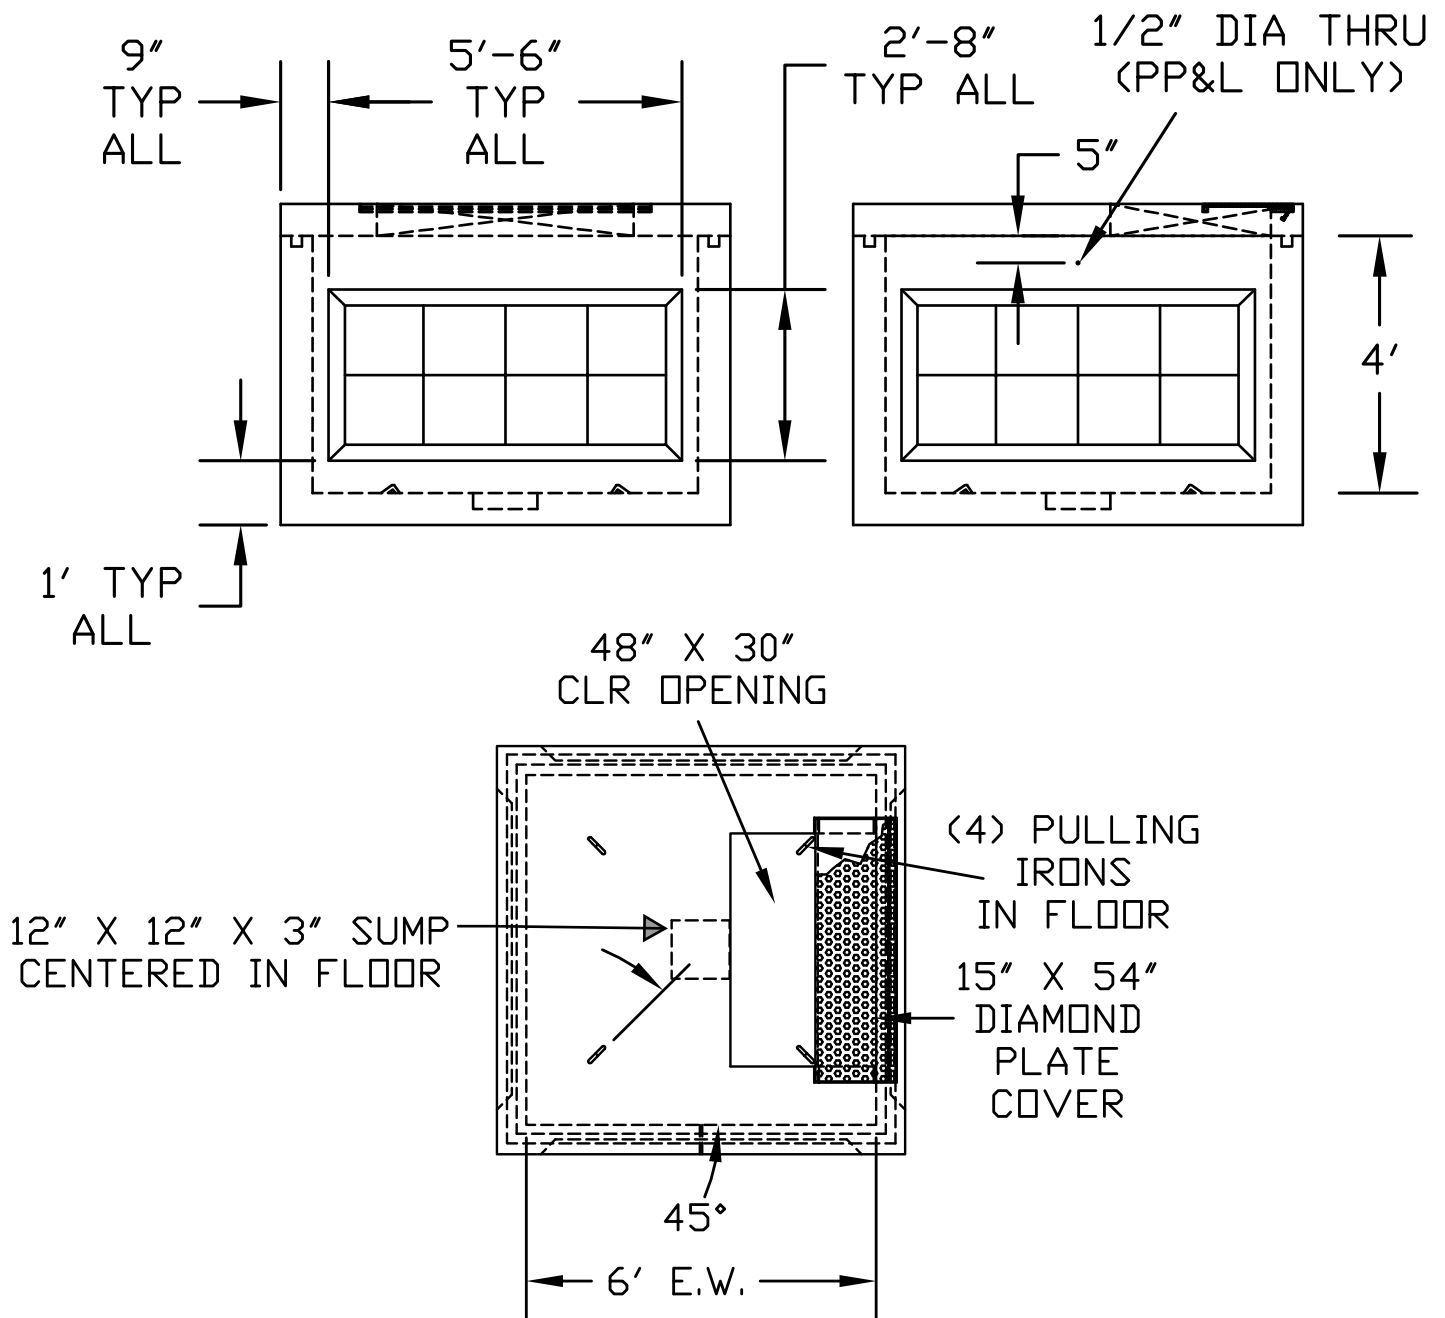

Deihl Vault & Precast, Inc.
1786 State Route 254, Orangeville, Pa 17859
www.deihlprecast.com

DESCRIPTION:

6'x6'x4' TRANSFORMER VAULT

DISCLOSURE:

This drawing is the sole property of Deihl Vault & Precast, Inc. It is furnished with the understanding that usage is limited to authorization at the time of transmittal. This drawing is not to be modified or transmittal. This drawing is not to be modified or copied without written permission.

JOB #:		STRUCTURE:		
DRAWN BY:		CHK BY:	DWG SCALE: FULL	
DATE: 10/20/21	CHK'D DATE:		PLOT SCALE: PLOT TO FIT	
DWG FILE: 664 TRANSFORMER VAULT				
REVISIONS			DATE	BY