

SK-Minimon Monitor Module

SPECIFICATIONS

Nominal Operating Voltage:	15-32 VDC
Average Operating Current:	375 μ A Maximum (group poll); 350 μ A (direct poll); 600 μ A Maximum Communicating, IDC Shorted)
EOL Resistance:	47 k Ω
Maximum SLC Wiring Resistance:	40 Ω
Max. IDC Wiring Resistance:	1,500 Ω
Maximum IDC Voltage:	11 Volts
Maximum IDC Current:	450 μ A
Temperature Range:	32°F to 120°F (0°C to 49°C)
Humidity:	10% to 93% Non-condensing
Dimensions:	1.3" H x 2.75" W x 0.5" D
Wire length:	6" minimum

BEFORE INSTALLING

This information is included as a quick reference installation guide. Refer to the control panel installation manual for detailed system information. If the modules will be installed in an existing operational system, inform the operator and local authority that the system will be temporarily out of service. Disconnect power to the control panel before installing the modules.

NOTICE: This manual should be left with the owner/user of this equipment.


GENERAL DESCRIPTION

The SK-Minimon monitor module can be installed in a single gang junction box directly behind the monitored unit. Its small size and light weight allow it to be installed without rigid mounting (see Figure 1). The SK-Minimon is intended for use in intelligent, two-wire systems where the individual address of each module is selected using rotary switches. It provides a Class B initiating device circuit for normally open contact fire alarm and security devices.

COMPATIBILITY REQUIREMENTS

To ensure proper operation, this module shall be connected to a compatible Silent Knight system control panel (list available from Silent Knight).

FIGURE 1:

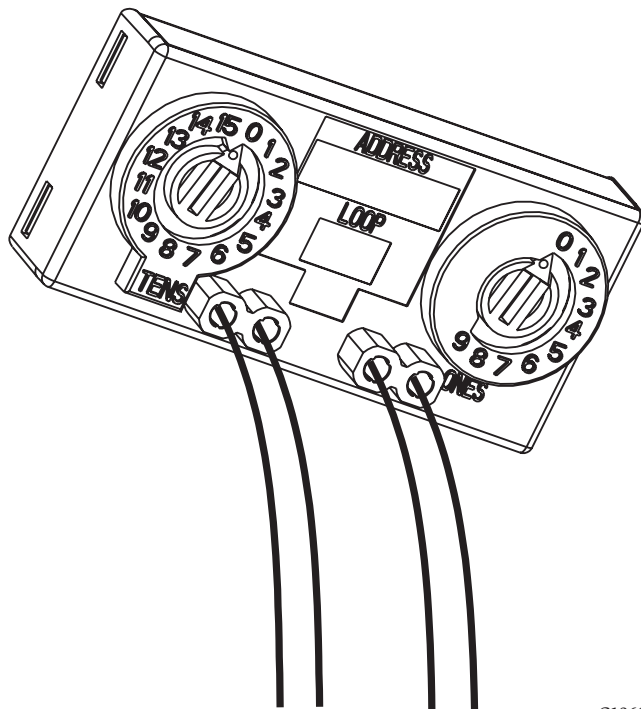

C1063-00


MOUNTING AND WIRING

NOTE: This module is intended to be wired and mounted without rigid connections inside a standard electrical box. All wiring must conform to applicable local codes, ordinances and regulations.

1. Connect the red (+) and black (-) wires to the positive and negative loop power leads of the signaling line circuit (SLC).
2. Connect the violet (+) and yellow (-) wires to a two-wire, normally open initiating loop.
3. Install the specified EOL resistor value to terminate the initiating loop.
4. Set the address on the module per job drawings.
5. Install the module in the desired mounting location.

NOTE: All references to power limited represent "Power Limited (Class 2)".

**FIGURE 2. TYPICAL CLASS B STYLE B INITIATING DEVICE
CIRCUIT CONFIGURATION:**

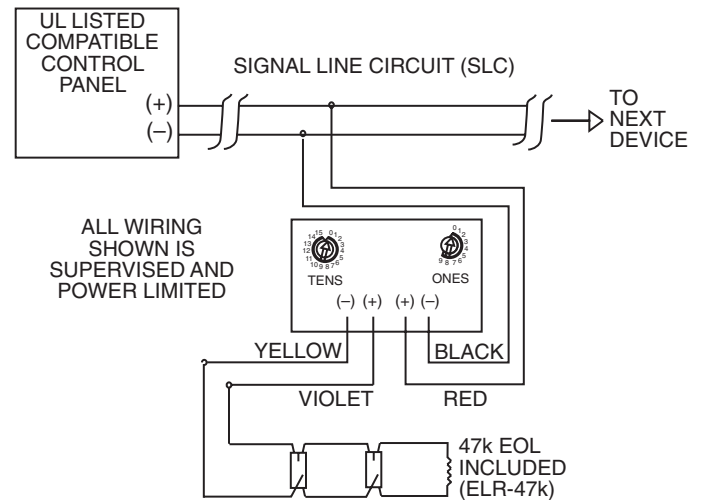

C0614-02