



**INTERNATIONAL QUALITY
PLASMA PROGRAM**
IQPP Interim Guidance
Reporting HCV Positive Donors, Version 1.0
Implemented 2013


1. Purpose

Provide guidance on IQPP Viral Marker Standard reporting for Donors who test HCV serology repeat reactive, when a RIBA test is unavailable.

2. Guidance

The IQPP Viral Marker Standard requires that donors confirmed positive by serology or positive by NAT for HIV, HCV and HBV be reported to the Association (see Clause 1, Item III and Annexes.)

The testing algorithm below is recommended to be followed when a Donor tests anti-HCV serology repeat reactive and a RIBA test is unavailable.

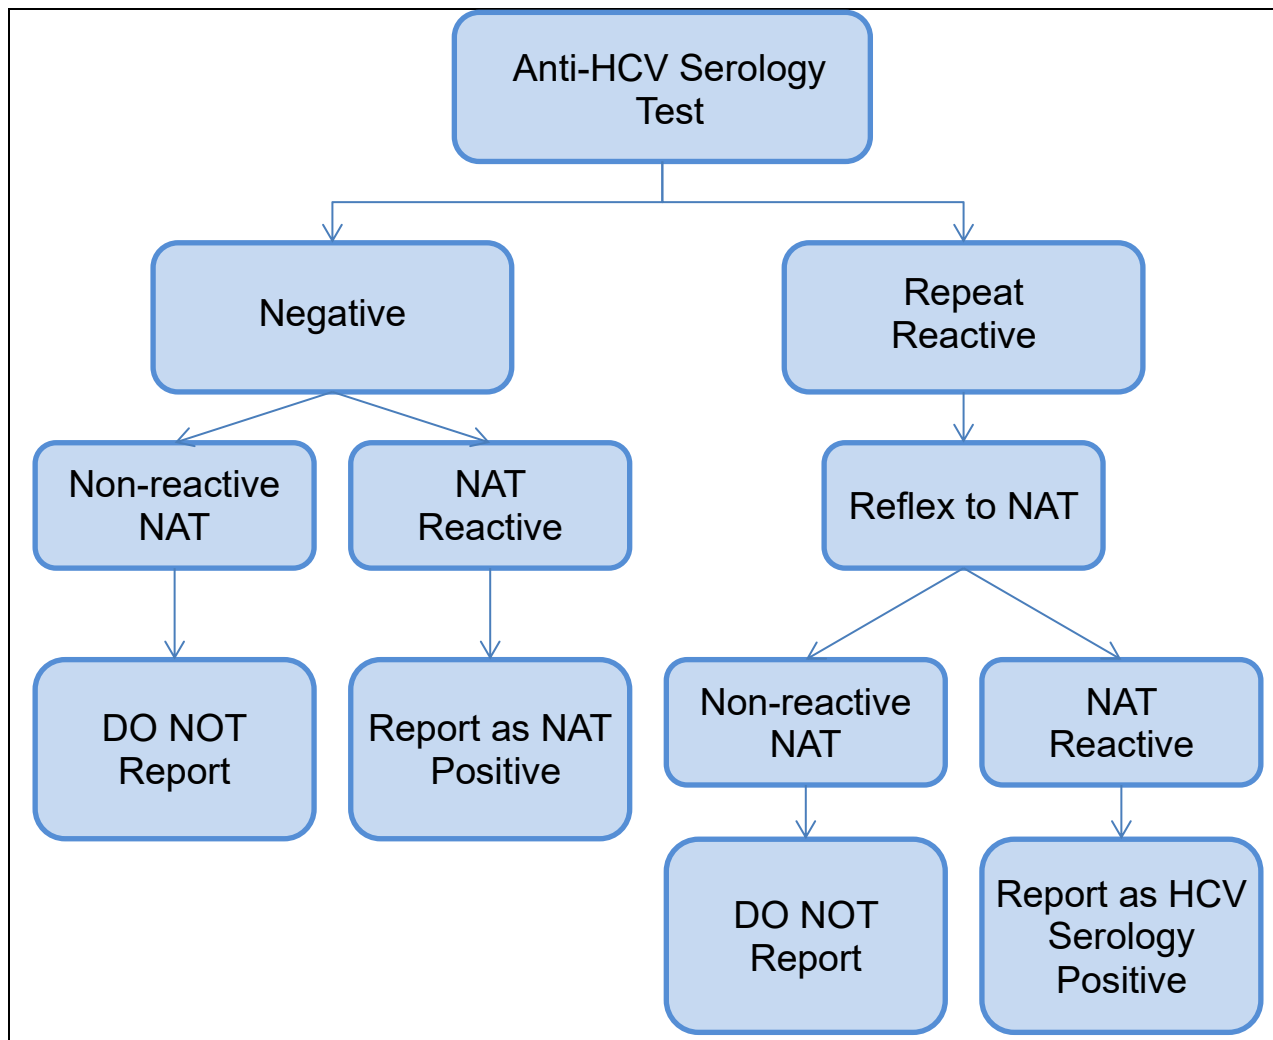

NOTE: This document applies to reporting for all HCV positive donors, regardless of their status. It supersedes the “IQPP Interim Guidance on Reporting HCV Qualified Positive Donors as Applicable to the IQPP Viral Marker Standard, Version 1.0.”