



Legionnaires Risk Assessment Review

14/01/2026 09:52:40



123 Sample Street, Sample Town YO1 5DE, Sample Town, YO1 5DE

Report Completed On: 14/01/2026 09:53

Report Completed By: Customer Care / XYZ Sales & Lettings Ltd (Demo)

[View Report Photos](#)

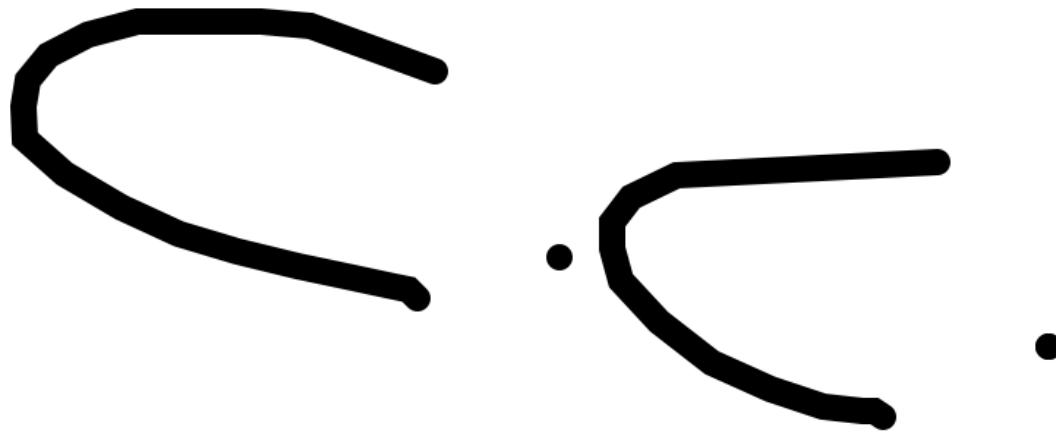


General

Information:	To be completed at least once per year.
Date of original Risk Assessment:	14/01/2025
Since the original assessment was carried out, has there been a change to the water system or the way it is used by occupants?	No
Has there been a change to the use of the building where the system is installed?	No
Is there new information available about risks or control measures?	No
When testing the temperature of the water in the system, does hot water flow from any outlets at a temperature of below 50C?	No
When testing the temperature of water in the system, does cold water flow from any outlets at a temperature of above 20C?	No
Are the current tenants and their visitors more susceptible due to their age, health or lifestyle?	No
Has there been a case of Legionnaires Disease associated with the system?	No

Assessor Signature

Signed by customer care.

**Please Note:**

If answers 'yes' to any of the questions above, a new risk assessment should be carried out by a competent person.