



IMI CORNELIUS INC ■ One Cornelius Place ■ Anoka, MN 55303-6234


Telephone (800) 238-3600

Facsimile (612) 422-3246

INSTALLATION INSTRUCTIONS

ADDENDUM TO INSTALLATION MANUAL (P/N 324229-000) FOR FCB OVERCOUNTER POST-MIX DISPENSER WITH V3 ELECTRONICS

Disregard wiring diagram within your Installation Manual (P/N 324229-000). Regard wiring diagram on this Addendum as the correct diagram.

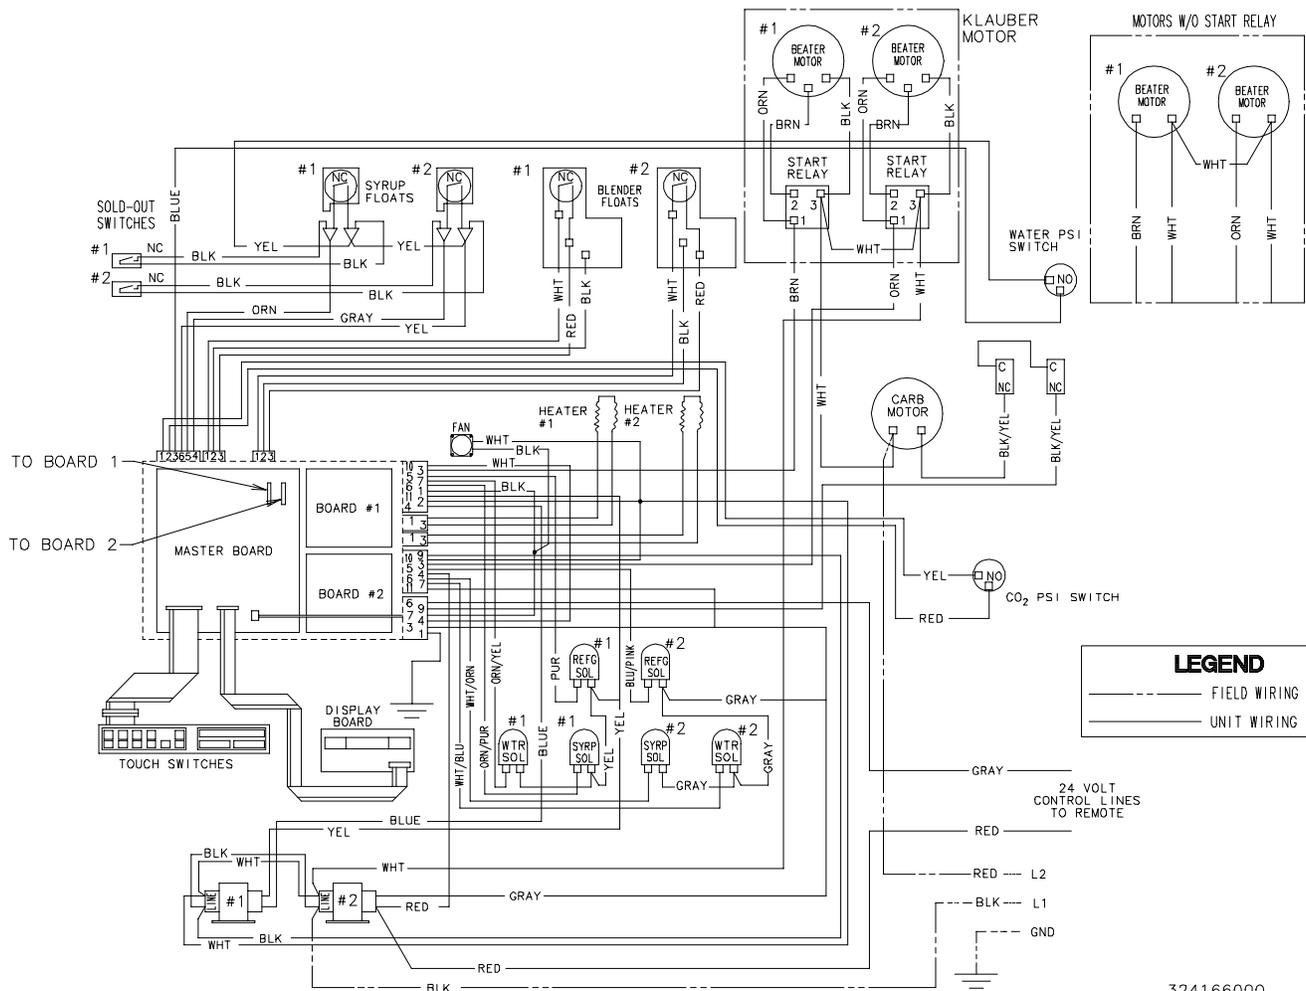

324166000
REV-D