



IMI CORNELIUS INC ■ One Cornelius Place ■ Anoka, MN 55303-6234

Telephone (800) 238-3600

Facsimile (612) 422-3246

ADDENDUM TO INSTALLATION MANUAL (CORNELIUS COMPANY P/N 309300000)

FOR

AURORA 3,000 COOLING UNIT (MODEL NO. 0131)

The purpose of this Addendum is to provide information for the Aurora 3,000 115VAC, 60HZ Cooling Unit Model No. 0131. Disregard all information in Installation Manual (P/N 309300000) pertaining to the 208/230VAC models. All remaining information in the manual and information in this Addendum will pertain to the 115VAC, 60HZ model. Retain this Addendum as part of your Installation Manual.

AURORA 3,000 115VAC, 60HZ COOLING UNIT MODEL NO. 0131.

Electrical Requirements.

Operating Voltage 115 VAC, 60 HZ

Current Draw 15 Amps

Connecting Electrical Power To Cooling Unit.

The Cooling Unit power cord must be plugged into a properly grounded 115VAC, 60 HZ, 20-amp (min) circuit electrical outlet fused at maximum 20-amp (slow-blow) or power circuit may be connected through an equivalent HACR-type circuit breaker. POWER CIRCUIT MUST BE PROPERLY GROUNDED, MUST BE MADE UP OF COPPER CONDUCTORS, AND ALL WIRING MUST CONFORM TO NATIONAL AND LOCAL ELECTRICAL CODES.

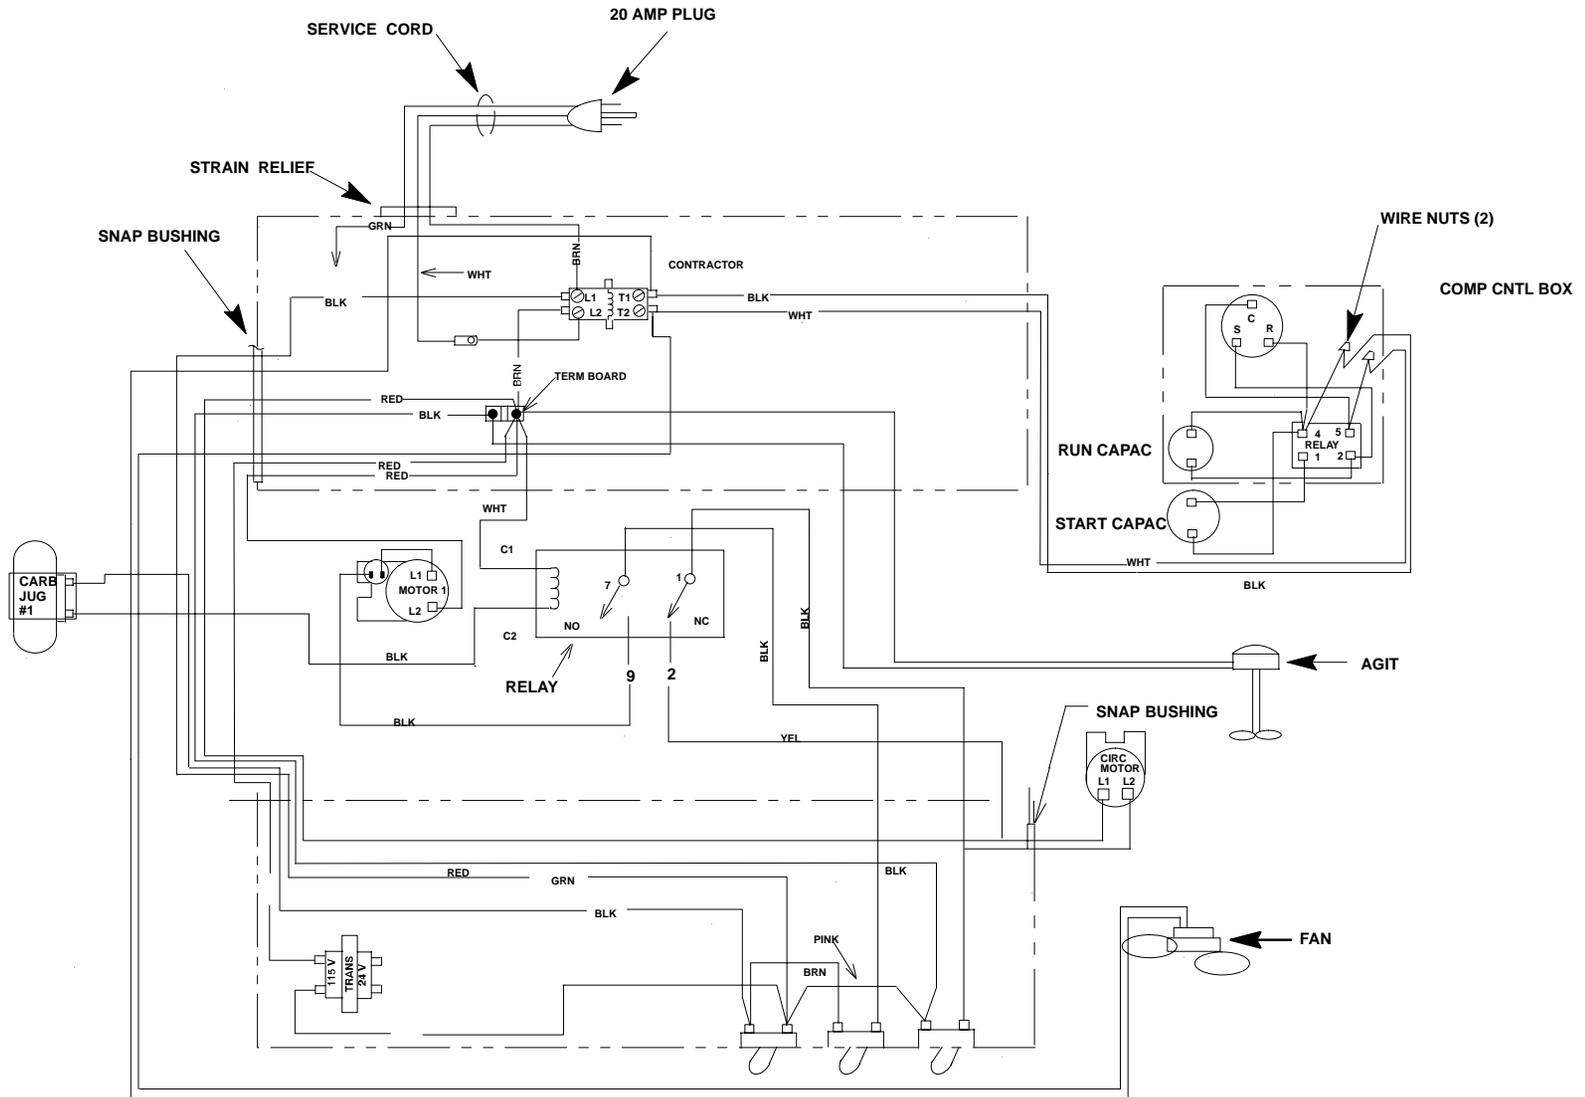


FIGURE 1. WIRING DIAGRAM (HIGH-VOLTAGE SYSTEM)