

TOSOT

SUBMITTAL DATA

TUD60-32AH2EDU / TU60-32WEDU
60000 BTU/H Unitary Heat Pump Split System

Job Name	Location	Date
Purchaser	Engineer	
Submitted to	For	
Unit Designation	Schedule No.	



TUD60-32AH2EDU



TU60-32WEDU


GENERAL FEATURES

- High Efficiency DC Inverter Technology
- 24VAC Thermostat Compatible
- Zero Lot Line Design
- Match with Competitive Indoor Unit
- New R32 Refrigerant
- Designed for New Construction or Replacement Market
- Low Ambient Cooling down to -15°C (5°F)
- Low Ambient Heating down to -30°C (-22°F)
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)

SPECIFICATIONS, FEATURES & FUNCTION SUMMARY

SPECIFICATIONS		TUD60-32AH2EDU / TU60-32WEDU		FEATURES & FUNCTIONS SUMMARY		TUD60-32AH2EDU / TU60-32WEDU	
System Type		HEAT PUMP					
SYSTEM PERFORMANCE				SYSTEM FEATURES			
Cooling	Min - Max	Btu/h	35,000 - 55000	Compressor	Inverter		
	Capacity @95°F	Btu/h	54,000	Ultra Low Frequency Torque Control	Yes		
Heating	Min - Max	Btu/h		Power Factor Correction	Yes		
	Rated Capacity @95°F	Btu/h	54,000	Compressor Type	Rotary		
	Rated Capacity @17°F	Btu/h	38,000	Outdoor Electronic Expansion Valve (EEV)	Yes		
	Rated Capacity Max @5°F	Btu/h	45,000	Indoor TXV Control	Yes		
SEER2			19	Basepan With Electric Heater	Yes		
EER2			11.5	Compressor With Electric Heater	Yes		
HSPF2			10	Fin Coating (Outdoor - Golden & Indoor - Blue)	Acrylic Resin		
COP @5°F			1.8	Intelligent Defrosting	Yes		
COP @47°F			3.3	Intelligent Preheating	Yes		
Cooling Temperature Range	°F	5 - 129		Low Voltage Startup	Yes		
Heating Temperature Range	°F	-22 - 75		Memory/Power Failure Recovery	Yes		
Refrigerant Type	R32			Self Diagnosis	Yes		
INDOOR UNIT		TUD60-32AH2EDU		Low Ambient Cooling	Yes		
Power Supply	VAC	208-230V / 1Ph / 60 Hz		24VAC Thermostat Compatible	Yes		
Sound Pressure Level	dB(A)	53		Indoor Fan Type	Centrifugal		
Control Voltage	VAC	24		Multi Fan Speeds	5		
Rated Current Cooling	A	2.8		Auxiliary Electrical Heater	Optional		
Rated Current Heating	A	2.5					
MCA	A	7.7					
MOCP	A	15					
Electric Heater (Optional)	kW	6, 9, 12					
Air Flow	CFM	1500					
External Static Pressure (Up to)	In W.c.	1.0					
Dehumidification	pt/hr	/					
External Dimensions (W x H x D)	in	24-13/16 x 52 x 21-1/4					
Package Dimension (W x H x D)	in	27-1/4 x 54-3/16 x 26					
Net Weight	lbs	199.5					
Gross Weight	lbs	218.3					
OUTDOOR UNIT		TU60-32WEDU					
Power Supply	VAC	208-230V / 1Ph / 60 Hz					
Sound Pressure Level	dB(A)	63					
Control Voltage	VAC	24					
Rated Current Cooling	A	24.53					
Rated Current Heating	A	23.44					
MCA	A	40					
MOCP	A	45					
External Dimensions (W x H x D)	in	35-7/16 x 49-5/8 x 13-3/8					
Package Dimension (W x H x D)	in	40-11/16 x 55-3/16 x 17-3/8					
Net Weight	lbs	241.4					
Gross Weight	lbs	263.5					
Refrigerant Charge	oz	162.3					
Additional Charge	oz/ft	0.215					
REFRIGERANT PIPING							
Line Set Size (Liquid - Gas) - Flared Connections	in	3/8 - 3/4					
Pre-Charge Length	ft	25					
Pipe Length (Min - Max)	ft	10 - 98					
Max. Pipe Elevation	ft	49					

FAN PERFORMANCE

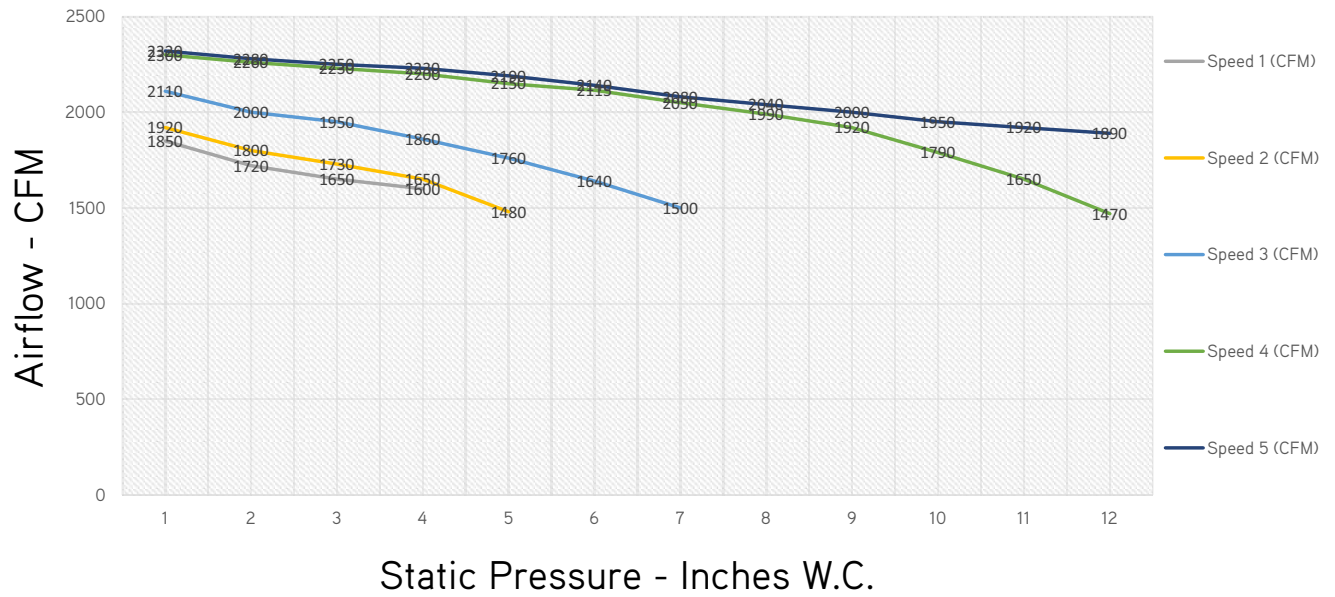

STATIC PRESSURE Inches W.C.	0	0.1	0.15	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
Speed 1 - CFM	1850	1720	1650	1600								
Speed 2 - CFM	1920	1800	1730	1650	1480							
Speed 3 - CFM	2110	2000	1950	1860	1760	1640	1500					
Speed 4 - CFM	2300	2260	2230	2200	2150	2115	2050	1990	1920	1790	1650	1470
Speed 5 - CFM	2320	2280	2250	2230	2190	2140	2080	2040	2000	1950	1920	1890

NOTE:

1. Above chart CFM ratings are based on dry coil with factory filter installed.
2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

DIMENSIONS


INDOOR UNIT

Unit: inch

TUD60-32AH2EDU

DIMENSIONS

A	11-5/8
B	20
H	52
W	24-13/16
D	21-1/4

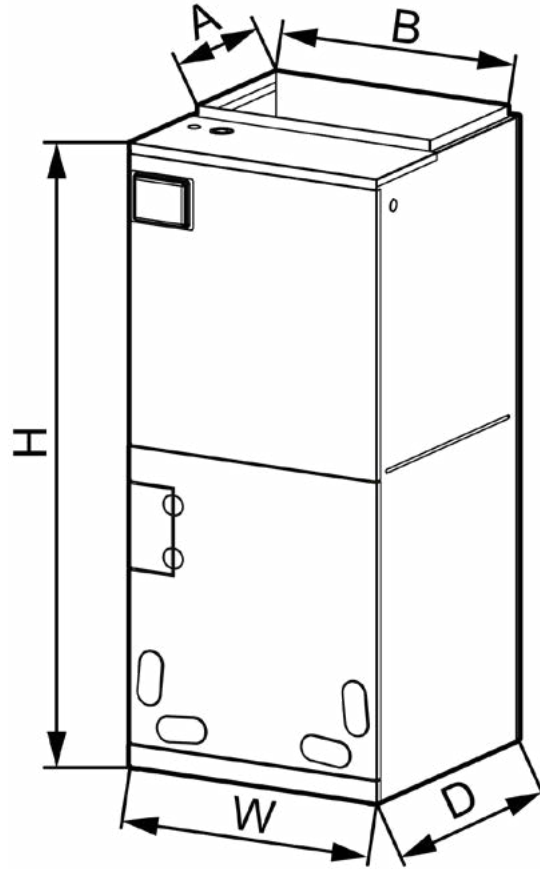




OUTDOOR UNIT

Unit: inch


TU60-32WEDU

DIMENSIONS

A	35-7/16
B	16-1/4
C	49-5/8
D	22-7/16
E	14-7/8
G	13-3/8

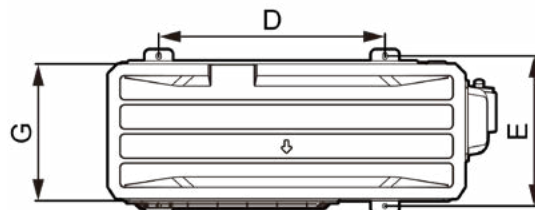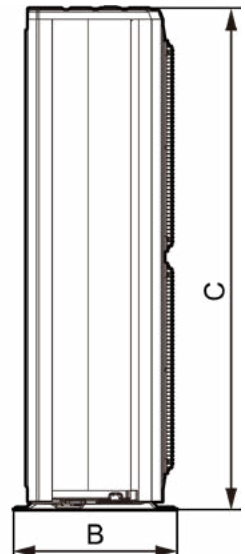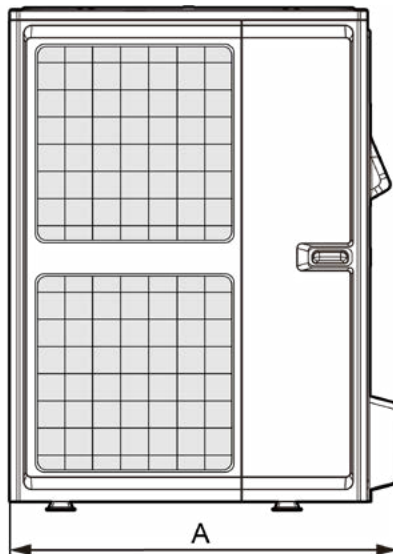

ACCESSORY HEATER AND GENERAL INFORMATION

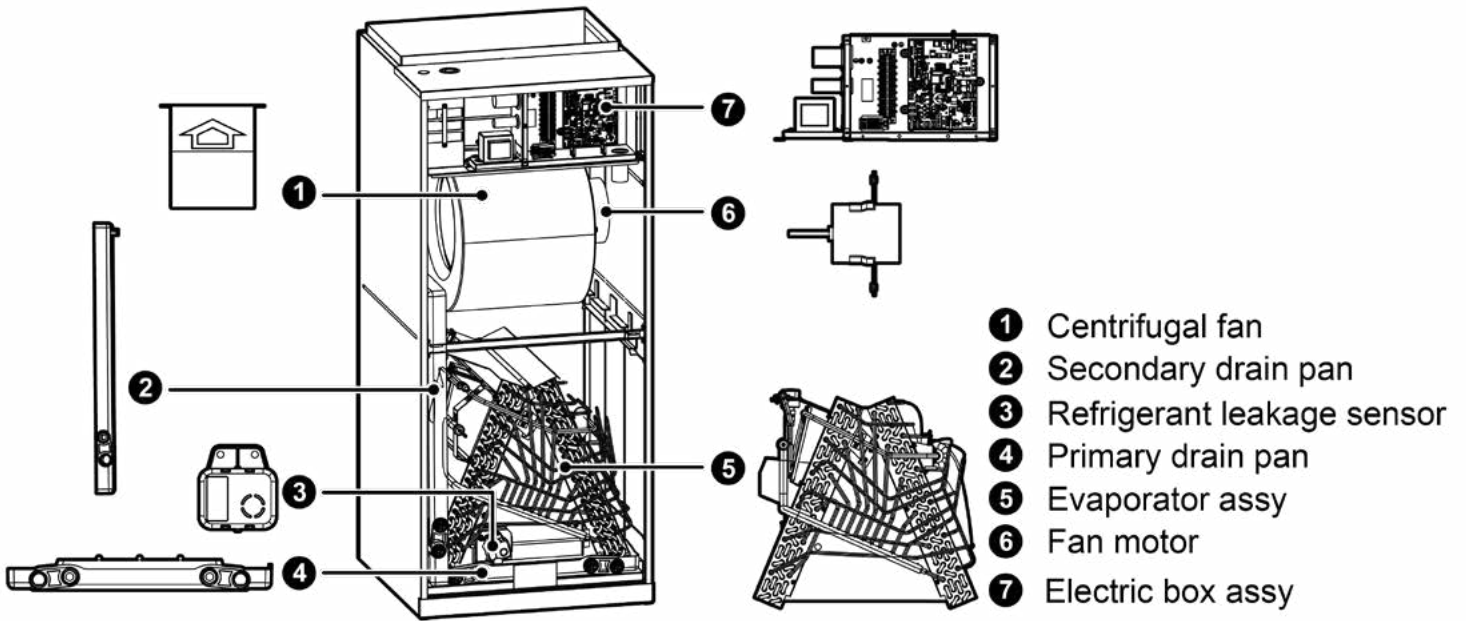

- ① Centrifugal fan
- ② Secondary drain pan
- ③ Refrigerant leakage sensor
- ④ Primary drain pan
- ⑤ Evaporator assy
- ⑥ Fan motor
- ⑦ Electric box assy



MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)				Max Fuse or Breaker (A)				
			208V	230V	208V		230V		208V		230V		
TUD60-32AH2EDU	One Mains Supply												
	320004060223	FLEXA2LHTR06	3.74	4.6	31		33		35			35	
	Two Mains Supply												
					Power A	Power B	Power A	Power B	Power A	Power B	Power A	Power B	Power A
	320004060224	FLEXA2LHTR09	6.03	7.36	35	13.8	36.9	15	40	15	40	40	20
	320004060225	FLEXA2LHTR12	7.49	9.2	35	27.5	36.9	30	40	30	40	40	35

CLEARANCES


INDOOR UNIT

Minimum clearance

FRONT > 24

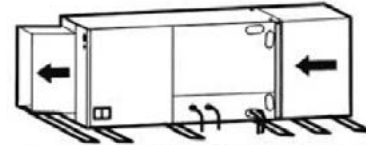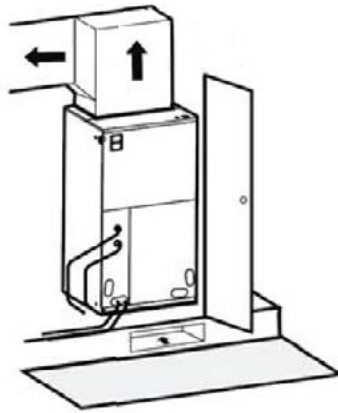

Horizontal Left Configuration - No Modification Needed

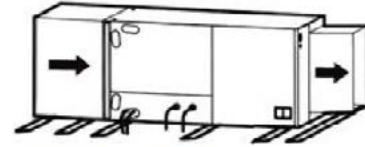

Horizontal Right Configuration - Must Relocate Drain Pan

NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

OUTDOOR UNIT


Minimum clearance

NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E	H_b H_d H		(in)				
			a	b	c	d	e
B	-	-	-	≥ 4	-	-	-
A, B, C	-	-	≥ 12	≥ 4	≥ 4	-	-
B, E	-	-	-	≥ 4	-	-	≥ 40
A, B, C, E	-	-	≥ 12	≥ 6	≥ 6	-	≥ 40
D	-	-	-	-	-	≥ 40	-
D, E	-	-	-	-	-	≥ 40	≥ 40
B, D	$H_b < H_d$	$H_d < H$	-	≥ 4	-	≥ 40	-
	$H_b > H_d$	$H_d > H$	-	≥ 4	-	≥ 40	-
B, D, E	-	$H_b \leq 1/2H$	-	≥ 10	-	≥ 80	≥ 40
	$H_b < H_d$	$1/2H < H_b \leq H$	-	≥ 10	-	≥ 80	≥ 40
	-	$H_b > H$	Prohibited				
	$H_b > H_d$	$H_b \leq 1/2H$	-	≥ 4	-	≥ 80	≥ 40
	$H_b > H_d$	$1/2H < H_b \leq H$	-	≥ 8	-	≥ 80	≥ 40
-	$H_b > H$	Prohibited					

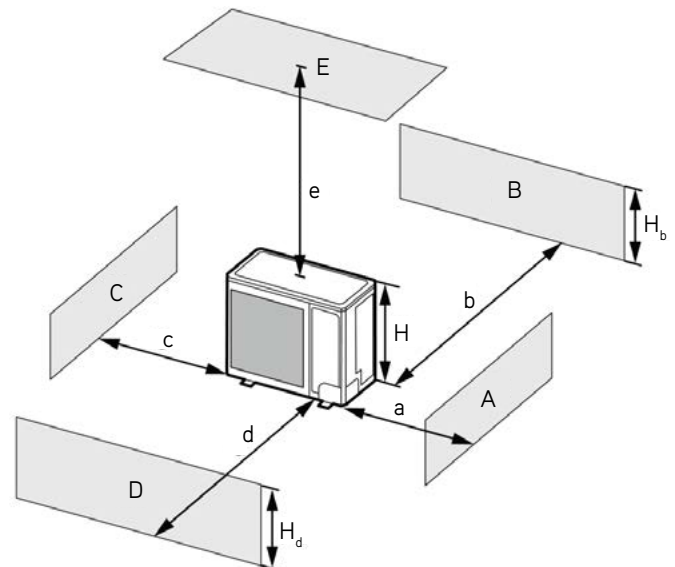

CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	H_b H_d H		(in)				
			a	b	c	d	e
A, B, C	-	-	≥ 12	≥ 12	≥ 40	-	-
A, B, C, E	-	-	≥ 12	≥ 12	≥ 40	-	≥ 40
D	-	-	-	-	-	≥ 80	-
D, E	-	-	-	-	-	≥ 80	≥ 40
B, D	$H_b < H_d$	$H_d > H$	-	≥ 12	-	≥ 80	-
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 80	-
B, D, E	$H_b > H_d$	$1/2H < H_d \leq H$	-	≥ 12	-	≥ 100	-
		$H_b \leq 1/2H$	-	≥ 12	-	≥ 80	≥ 40
	$H_b < H_d$	$1/2H < H_b \leq H$	-	≥ 12	-	≥ 100	≥ 40
		$H_b > H$	Prohibited				
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 100	≥ 40
		$1/2H < H_d \leq H$	-	≥ 12	-	≥ 100	≥ 40
	$H_d > H$	Prohibited					-

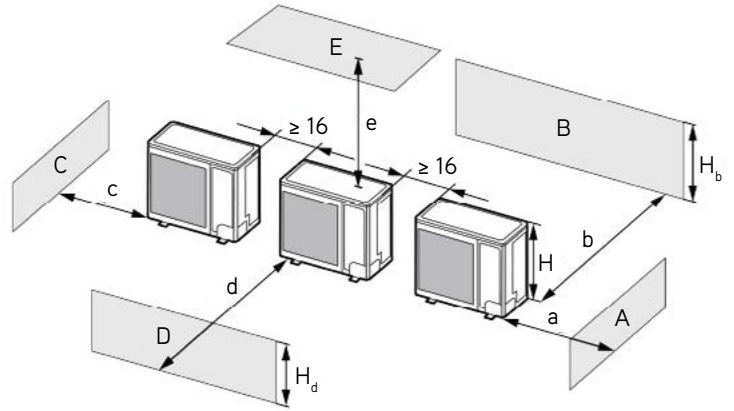


3. When outdoor units are installed in rows.

H_b H_d	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H_d$	Prohibited

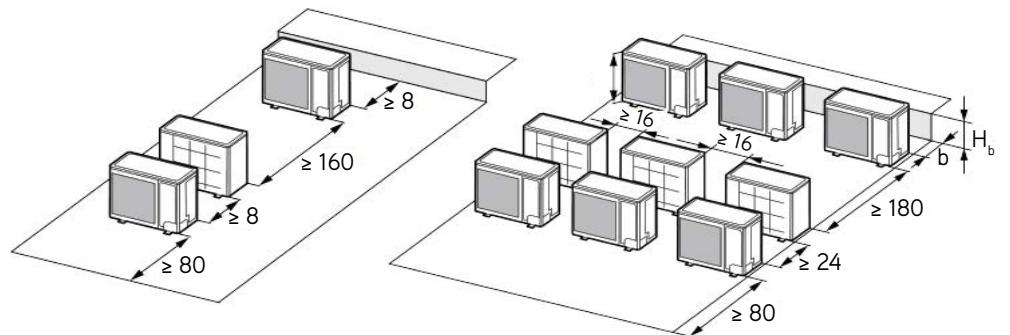

4. When outdoor units are installed one above another.

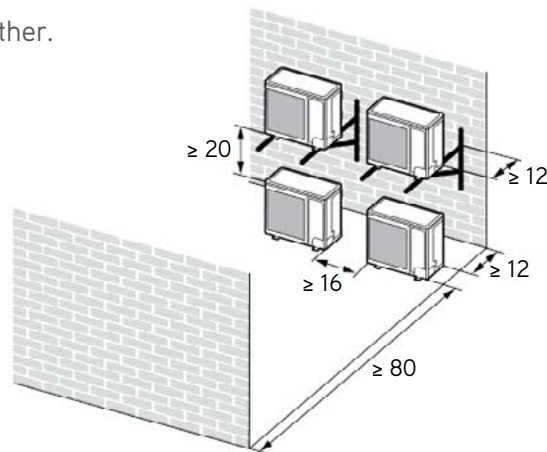

Specifications are subject to change without notice. Manufacturer reserves the right to discontinue or modify specifications or designs without notice or without incurring obligations. All Rights reserved.