



## RENEW REVOLVE® Deck Board

RENEW Plastics, Division of N.E.W. Plastics Corporation

Initial Acceptance: January 1, 2019

Expiration: April 30, 2028

Revision: April 30, 2026

Version: 3.0

### TYPE OF ACCEPTANCE

#### **Product Material – Wood and Plastics**

CSI Specification Division: 06 50 00 (Structural Plastic) and 06 53 00 (Plastic Decking)

### MANUFACTURER IDENTIFICATION:

RENEW Plastics, Division of N.E.W. Plastics Corporation  
112 4<sup>th</sup> Street  
Luxemburg, WI 54217-0480  
Tel: [\(920\) 845-2326](tel:9208452326)  
[www.newplasticscorp.com](http://www.newplasticscorp.com)

### EVALUATION REPORT SUBJECT:

RENEW Plastics Deck Boards and Stair Treads for Exterior Applications  
Installation on construction complying with the International Residential Code®  
(IRC®) or with the International Building Code® (IBC®).

### DESCRIPTION OF BUILDING COMPONENTS:

#### **A. Deck Boards**

RENEW Plastics deck boards are thermoplastic composite products consisting of plastic (HDPE), filler (minerals) plus additives and color. The product specifications are listed in the approved quality control manual. The RENEW Plastics deck boards are manufactured in several colors by the co-extrusion process and have capping covering all four (4) sides of the deck boards.

##### **1. Deck Boards: Solid**

- (a) The **Revolve (Square Edge Cap & Core Board)** deck board is rectangular in shape, has rounded edges, is completely solid and has cap stock on all four (4) sides of the deck board. See attached drawing in Table 1.

##### **2. Deck Boards: Solid with Side Grooves**

- (a) The **Revolve (G&G Cap & Core Board)** deck board is rectangular in shape, has rounded edges, is completely solid, has a groove on each side of the board and has cap stock on all four (4) sides of the deck board. See attached drawing in Table 1.

3. RENEW Plastics deck boards must be installed as indicated in the manufacturer's published installation instructions dated October 1, 2019.

**APPLICABLE CODES:**

- 2015, and 2018, 2021 International Building Code (IBC)
- 2015, and 2018, 2021 International Residential Code (IRC)

**APPLICABLE CHARACTERISTICS REVIEWED:**

**B. Deck Board(s)** See Section A – 1(a) thru 2(a) above for the identification and description of the deck boards reviewed.

**1. Deck Board: Structural Performance**

- (a) The deck boards have been reviewed for uniform load, maximum span and deck board direction when installed on support framing members. See attached Table 1.
- (b) The deck boards have been reviewed for wind uplift resistance and have an uplift load rating when installed as indicated in Table 1 in this Report.
- (c) The deck boards used as stair treads meet the code prescribed load requirements including the concentrated load of 300 lbf when installed in accordance with the manufacturers' installation instructions and Table 1 in this Report.

**2. Deck Board: Fastening**

- (a) Deck Boards, solid and with side grooves, must be fastened to the structural supporting members in accordance with the manufacturer's installation instructions and Table 1 in this Report. When the manufacturer's installation instructions differ from this Report, this Report governs.
- (b) When deck boards are used as stair treads, they must be installed in accordance with the manufacturer's installation instructions and Table 1 in this Report. When the manufacturer's installation instructions differ from this Report, this Report governs.

**3. Deck Board Durability: Temperature**

- (a) The deck boards have been reviewed for the temperature range of -20 degrees F (-29 degrees C) to +125 degrees F (52 degrees C).

**4. Deck Board Flame Spread Index:**

- (a) The flame spread rating for the deck boards described in this Report was less than 200 when tested in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*.

**5. Deck Board Decay Resistance:**

- (a) The deck boards reviewed for this Report have been deemed comparable to naturally durable wood for resistance to fungal decay.

**6. Deck Board Termite Resistance:**

- (a) The deck boards reviewed for this Report have been deemed comparable to preservative-treated wood for resistance to termite attack.

**7. UV Testing:**

- (a) The UV testing was conducted, and an appropriate adjustment factor was applied in accordance with ASTM D7032, *Standard Specification for Establishing Performance Ratings for Wood-Plastic Composite Deck Boards and Guardrail Systems (Guards or Handrails)*.

**APPLICABLE USES:**

The RENEW Plastics deck boards evaluated in this Report are limited to exterior applications for balconies, porches, stair treads, walking surfaces and decks.



**LIMITATIONS OF ACCEPTANCE:**

The RENEW Plastics deck boards described in this Report comply with those codes listed in Applicable Codes section above and are subject to the following conditions:

1. The deck board products must be limited to Type V-B (IBC) and residential construction in accordance with the IRC for exterior use as a deck board for balconies, porches, decks, walking surfaces and stair treads.
2. Installation of the deck boards must comply with this Report, the manufacturer's published installation instructions (see Section A-3 in this Report), and the applicable code. When the deck board manufacturer's installation instructions differ from this Report, this Report governs.
3. The fasteners described in this Report must be used for the installation of the RENEW Plastics deck boards. The compatibility of the fasteners to treated supporting construction has not been evaluated.
4. The RENEW Plastics deck boards indicated in this Report must be fastened to the supporting construction with the manufacturer's provided fasteners as indicated in the manufacturer's installation manual and outlined in this Report. When the deck board manufacturer's fastening instructions differ from this Report, this Report governs.
5. When required, the structural deck board layout must be designed by a design professional and submitted to the authority having jurisdiction for final acceptance.
6. The RENEW Plastics deck boards have not been evaluated as a member of a fire-resistance-rated assembly.
7. The structural design for code compliance of supporting members for the deck boards has not been evaluated and is not part of this Report.
8. RENEW Plastics has a Third-Party inspection program provided by PFS Corporation.

**DOCUMENTATION SUBMITTED:**

Submitted data was provided in accordance with PFS TECO Certification and Inspection Program: Deck Boards and Guardrails (Quality control manual, Specifications, Manufacturer's installation instructions, Test data, and Descriptive information) and the products have been evaluated in accordance with ICC-ES AC174, *Acceptance Criteria for Deck Board Span Ratings and Guardrail Systems (Guards and Handrails)*.

**PRODUCT IDENTIFICATION:**

The RENEW Plastics boards evaluated in this Report must be identified with a label, stamp, or laser imprint on every deck board. The required information is as follows: RENEW Plastics, product identification, compliance to ASTM D7032 including the maximum deck board span (inches on center spacing of supports) and loading (psf), the PFS TECO Building Product Evaluation Report number (BPER 0119), and PFS Certification Mark (see image below). Deck boards without this information are not covered under this Report.



**Table 1: Span Table and Fastening Schedule for Deck Boards**

Product Trade Name	Deck Board Profile	Shape	Maximum Span Rating (in/psf) with Deck Board Orientation to Support Joists		Fastening Schedule <sup>1</sup> and Uplift Values	Maximum Stair Tread Span (in)
			90°	45°		
Revolve-Square Edge Cap & Core Board		Solid Edge	16 / 100	12 / 100	100 psf with two #10 2-3/4" Composite Deck Screws at each joist	8
Revolve-G&G Cap & Core Board		Grooved Edge	16 / 100	12 / 100	89 psf with CAMO EdgeClip or EdgeXClip 96 psf with G&G Decking Clip system at each joist	- n/a -

for SI conversion: 1 in = 25.4 mm, 1 psf = 47.9 Pa, 1 lbf = 0.0044 kN


<sup>1</sup> Deck boards must be installed according to the manufacturer's Installation Instructions. Deck boards installed as stair tread must be fastened with 2 #10 2-3/4" composite deck screws on each stringer.

The joist to which the deck boards are attached must have a minimum specific gravity of 0.50 or higher, or the fastening must be designed. Deck boards and stair treads must be installed over at least two (2) spans. Stair treads must be installed perpendicular to supporting members.


No duration of load increase is allowed for the uplift values noted in Table 1 in this Report.



G&G Decking Clip

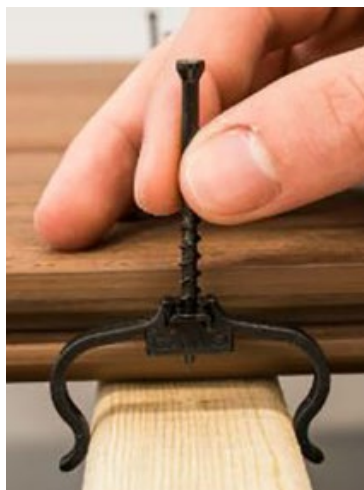

CAMO Edge Clip

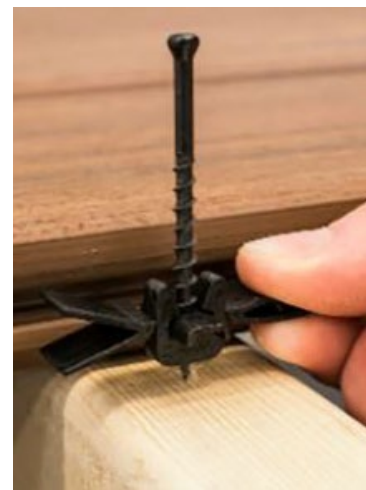

CAMO EdgeX Clip



#10 2-3/4" Composite Deck Screw