



Building Product Evaluation Report 0115

RDI Endurance Guardrail Systems Oldcastle

Initial Acceptance: January 1, 2018

Expiration: January 1, 2027

Revision: June 1, 2026

Version: 2.0

TYPE OF ACCEPTANCE

Product Material – Wood and Plastics

CSI Specification Division: 06 50 00 (Structural Plastic) and 06 63 00 (Plastic Railing)

MANUFACTURER IDENTIFICATION:

Oldcastle

400 Perimeter Center Terrace FL 10
Atlanta, GA 30360
1-866-729-2378
www.RDIRAIL.com

EVALUATION REPORT SUBJECT:

Endurance® Guardrail Systems for Exterior Applications

Installation on construction complying with the International Residential Code® (IRC®) or with the International Building Code® (IBC®), including IBC exceptions in Section 1015.3 of the IBC.

DESCRIPTION OF BUILDING COMPONENTS:

Oldcastle guardrail system is identified by the name – **Endurance** (Guardrail System). The guardrail system is for use in areas as referenced in the Applicable Code Sections of this Report. The guardrail system provides a protective barrier for walking areas, balconies, porches and ramps. The guardrail system is manufactured by the co-extrusion process, assembled with molded components and are produced in white and other colors.

1. Guardrail – Endurance

- (a) The **Endurance** guardrail system consists of top rail, bottom rail, balusters and aluminum reinforcing inserts. The top rail, bottom rail and balusters are manufactured with PVC material by the co-extrusion process except for the PVC molded brackets and aluminum baluster.
- (b) The **Endurance** guardrail system has a top rail that comes in a “T” rail profile. The top rail profile is “T” in shape, hollow in the center, has rounded edges, is pre-routed for balusters and has cap stock on the rail. The top rail aluminum reinforcing insert has a “T” shape profile and is made of extruded 6105-T5 aluminum alloy material. See Table 1 in this Report for drawings and dimensions of top rail and insert.
- (c) The **Endurance** guardrail system has a bottom rail that is rectangular in shape, hollow in the center, has rounded edges and is pre-routed for balusters. The bottom rail aluminum reinforcing insert has an inverted “P” shape profile and is made of extruded 6063-T6 aluminum alloy material. See Table 1 in this Report for drawings and dimensions of bottom rail and insert.
- (d) The **Endurance** guardrail system has three baluster designs as follows: square, turned and round. The square and turned balusters are manufactured with PVC material. The square baluster has rounded edges and is hollow in the center. The turned baluster is square on both ends with rounded edges, turned in the middle, is hollow in the center and is produced in two lengths. The round baluster is circular in shape, is hollow in the center and is an extruded aluminum alloy 6063-T5 material. See Table 1 in this Report for baluster drawings and dimensions.



- (e) The **Endurance** guardrail system connections for the top and bottom rail to the supports are PVC molded brackets and adapters. The brackets and adapters shall be secured to the posts with steel screws (stainless, corrosion-resistant, or galvanized) suitable for use in preservative-treated wood. See Table 1 and 3 of this Report for a drawing of the bracket and the number of fasteners required.
- (f) See Table 2 in this Report for the **Endurance** guardrail system height and length limits.
- (g) See manufacturer's published installation instructions identified as [34110047 Rev. 07-19](#) for additional guardrail system installation details.

2. Stair – Endurance

- (a) The guardrail system can be used as a stair guard. See Tables 1, 2 and 3 for maximum length between posts, bottom rail supports, top and bottom rail connection brackets and fasteners required.
- (b) When the guardrail is used with stairs, the guardrail must be installed in accordance with the applicable code, manufacturer's installation instructions and Table 1, 2 and 3 in this Report. When the manufacturer's installation instructions differ from this Report, this Report governs. Additionally, in order to comply with the IBC or IRC graspability requirements, a separate handrail complying with IBC Section 1014.3 or IRC Section R311.7.8.3 must be provided. Specific details regarding the construction installation and attachment to the stair guardrail and/or posts have not been evaluated and are outside the scope of this Report. Specific details when required must be furnished to the authority having jurisdiction.
- (c) See Manufacturer's published installation instructions [3411973 Rev 02.23](#) for additional installation details.

APPLICABLE CODES:

- 2015, 2018, and 2021 International Building Code (IBC)
- 2015, 2018, and 2021 International Residential Code (IRC)
- 2013 California Green Building Standards Code (CalGreen) Title 24, Part 11
- 2015 (ICC/ASHRAE) 700-2015 National Green Building Standard™

APPLICABLE CHARACTERISTICS REVIEWED:

1. Structural Performance:

- (a) The **Endurance** guardrail system has been reviewed for maximum spans as indicated in Table 2. Table 2 in this Report also indicates the limitations of use evaluated for each design.

2. Temperature:

- (a) The **Endurance** guardrail system has been reviewed for the temperature range of -20 °F (-29 °C) to 125 °F (52 °C).

3. Flame Spread Index:

- (a) The **Endurance** guardrail system flame spread rating was between 0-25 for PVC material when tested in accordance with ASTM E84 "Standard Test Method for Surface Burning Characteristics of Building Materials."

4. Decay Resistance:

- (a) The material used in the **Endurance** guardrail system in this Report does not contain any wood and has been deemed comparable to naturally resistant wood or to preservative-treated wood for resistance to fungal decay.

5. Termite Resistance:

- (a) The material used in the **Endurance** guardrail system in this Report does not contain any wood and has been deemed equivalent to naturally resistant wood or to preservative-treated wood for resistance to termite attack.

6. UV Testing:

- (a) The UV testing was conducted, and an appropriate adjustment factor was applied in accordance with ASTM D 7032-17 "Standard Specification for Establishing Performance Ratings for Wood-Plastic Composite Deck Boards and Guardrail Systems (Guards or Handrails)".



7. **Fastening:**
 - (a) The **Endurance** guardrail system top and bottom rails must be fastened to posts with PVC molded brackets using steel (stainless, corrosion-resistant, or galvanized) screws. See Table 3 in this Report and manufacturers installation instructions, noted in the description section, 1(g) of this Report.
 - (b) The fasteners and brackets are supplied by the manufacturer and must be used in the installation of the Oldcastle guardrail system. Use of other brackets and fasteners is not covered under this Report.
8. **Posts:**
 - (a) Wood posts and other wood framing members supporting the posts are not covered under this Report and fall outside of this Report. Wood posts and other wood must be designed to meet the load requirement in the applicable building code and the wood members must have a minimum specific gravity of 0.51 (Southern Pine or better) and minimum thickness to allow full penetration of bracket mounting screws. Other wood posts or wood members not meeting these requirements are not covered under this Report.
9. **2013 California Green Building Standards Code (CalGreen), Title 24, Part 11:**
 - (a) The **Endurance** guardrail system conforms to the requirements for reduced maintenance according to Section A5.406.1.2 of the code.
10. **2015 (ICC/ASHRAE 700-2015) National Green Building Standard™:**
 - (a) The **Endurance** guardrail system conforms to the requirements for termite-resistant materials Sections 602.1.6 and 11.602.1.6 of the standard.
 - (b) The **Endurance** guardrail system conforms to the requirements for site-applied finishing materials Section 12.1(A).601.7 of the standard.

APPLICABLE USES:

The Oldcastle guardrail systems evaluated in this Report are for installations on construction complying with IRC or IBC including Exceptions indicated in section 1015.3. See Table 2 for guardrail system limitations.

LIMITATIONS OF ACCEPTANCE:

The Oldcastle **Endurance** guardrail system described in this Report comply with those codes listed in the Applicable Codes section above and are subject to the following conditions:

1. The Oldcastle **Endurance** guardrail system is limited to exterior construction complying with the IRC and the IBC. The guardrail systems provide a protective barrier for walking areas, balconies, porches, and ramps.
2. Installation of the guardrail system must comply with this Report; the manufacturer's published installation instructions identified as 34110047 Rev. 07-19 and the applicable code. When the guardrail installation instructions differ from this Report, this Report governs.
3. The fasteners described in this Report have been evaluated for the installation of the Oldcastle **Endurance** guardrail system only. Structural wood posts and framing support members for posts must be designed to satisfy load requirements (live and dead) indicated in the applicable building code. Material necessary for the anchorage of the guardrail system(s) and compatibility of the fasteners to the treated wood supporting construction has not been evaluated.
4. The Oldcastle **Endurance** guardrail system indicated in the Report must be fastened to the supporting construction as indicated in the manufacturer's published installation instructions and as outlined in this Report. When guardrail fastening instructions differ from this Report, this Report governs.
5. When required, the guardrail system in this Report must be designed by a professional and submitted to the authority having jurisdiction for final acceptance.
6. The use of a corner rail connection without a post is outside the scope of this Report.
7. The Oldcastle **Endurance** guardrail system has not been evaluated as a member of a fire resistance-rated assembly.
8. Oldcastle has Third Party inspection program provided by PFS Corporation.

DOCUMENTATION SUBMITTED:

Submitted data was provided in accordance with PFS TECO Certification and Inspection Policy: Deck Boards and Guardrails (Quality Control Manual, Specifications, Manufacturer's published installation instructions, Test data and Descriptive information).



The products have been evaluated in accordance with ICC-ES AC174, *Acceptance Criteria for Deck Board Span Ratings and Guardrail Systems (Guards and Handrails)*.

PRODUCT IDENTIFICATION:

The Oldcastle guardrail assembly system must be identified with a label on each component or the packaging. The information required is as follows: Oldcastle, product identification (***Endurance***), compliance to ASTM D7032 including the maximum guardrail span and loading, the PFS TECO Building Product Evaluation Report number (BPER 0115), and the PFS Certification Mark (see image below). Guardrails that are 36" high require a label indicating, "Guardrail installation in residential (1 & 2 Family) units only." Guardrails without this information are not covered under this Report.



Table 1: Schematics of Endurance® Guardrail System Components

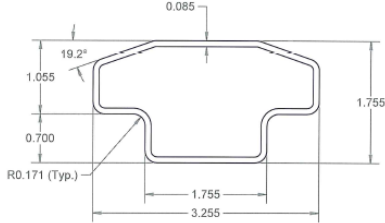



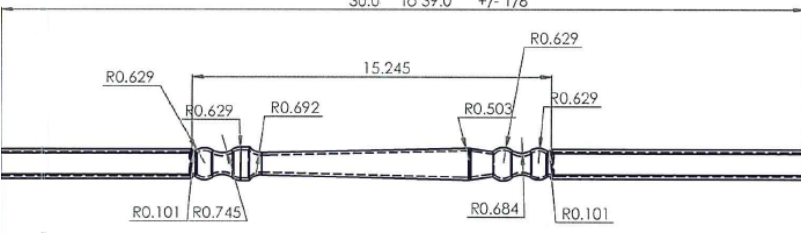

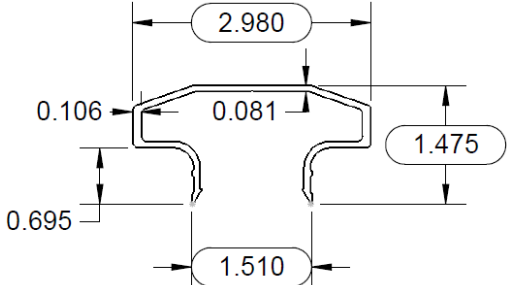
Description	Profile
Top Rail	
Bottom Rail	
Balusters	 Square Baluster  Round Aluminum Baluster  Turned Baluster 
Top Rail Insert T-Channel	

Table 1 Continued

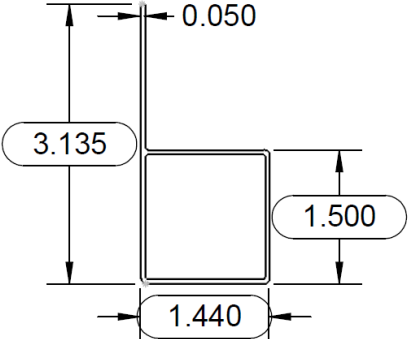
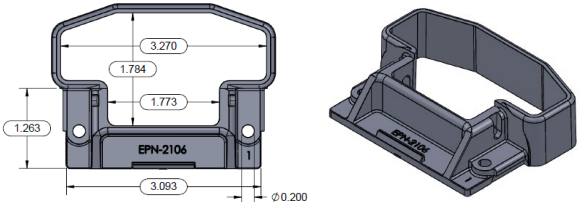
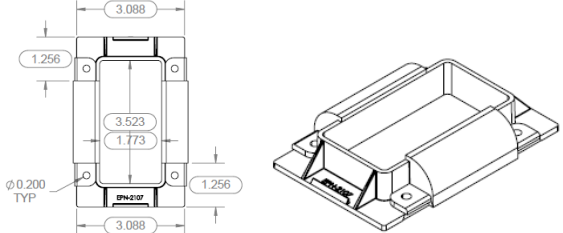



Bottom Rail Insert P-Channel	
Level Top Rail Bracket	
Level Bottom Rail Bracket	
Stair Top Rail Bracket	 Top Bracket  Bottom Bracket
Stair Bottom Rail Bracket	


Table 2: Span Table for Endurance® Guardrail Assembly

Guardrail Type	Top Rail Insert	Bottom Rail Insert	Baluster	Max Guardrail Span
Maximum Guardrail Height 36 in. for IRC Residential One- and Two-Family Residential Dwellings				
Level and Stair	T-Channel	P-Channel	Square, Turned, Aluminum Round	8-ft
Maximum Guardrail Height 42 in. for IBC				
Level and Stair	T-Channel	P-Channel	Square, Turned, Aluminum Round	8-ft

for SI conversion: 1 in = 25.4 mm, 1 psf = 47.9 Pa, 1 lbf = 0.0044 kN

Refer to Table 3 for fastening schedule

Maximum span is clear length between posts measured parallel to top/bottom rail

Table 3: Fastening Schedule for Endurance® Guardrail Assembly

Location	Connection	Fasteners
Level Top Rail	Bracket to Post	Two #10 x 2" Square Pan SDS 410 SS 1000 Hr ¹
	Bracket to Rail	Two #8 x 1" Square Pan SDS 410 SS 1000 Hr
Level Bottom Rail	Bracket to Post	Four #10 x 2" Pan Square Deck 18-8 SS Type 23 ¹
Stair Top Rail	Bracket to Post	Two #10 x 3.5" Square Pan SDS 410 SS 1000 Hr ¹
	Rail Bracket to Rail	Two #8 x 1" Square Pan SDS 410 SS (EPN-6124)
Stair Bottom Rail	Bracket to Post	Four #10 x 2" Pan Square Deck 18-8 SS Type 23 ¹

¹ Pre drill with 5/32" drill bit.