

NET ZERO WATER TOOLKIT

A GUIDE TO NON-POTABLE ONSITE WATER REUSE
FOR TEXAS DEVELOPERS AND OWNER/OPERATORS

Grace Gilker and Sharlene Leurig



CONTENTS

INTRODUCTION 3

Growth as a source of water, toolkit aims

GET TO KNOW NET ZERO WATER 4

Onsite water reuse definitions, health and safety

NET ZERO WATER IN YOUR BACKYARD: CASE STUDIES 7

Existing onsite water reuse case studies from around Texas and beyond

REUSE SYSTEMS: HOW WATER TREATMENT WORKS 12

The onsite water treatment process for different water sources

WHY NET ZERO WATER 16

What projects stand to gain from onsite water reuse

PLANNING 18

Step-by-step guide to onsite water reuse planning

FINANCING VEHICLES 21

Existing tools for funding onsite water reuse projects

PERMITTING 24

Step-by-step permitting roadmap

INSTALLATION, OPERATION, AND MAINTENANCE 27

Best practices, operator requirements, commissioning use cases

CONCLUSION 29

The Texas opportunity

TOOLS AND REFERENCES 30

Calculators, guides, citations

ACKNOWLEDGEMENTS 33

TEXAS NEEDS MORE WATER

The state is projecting a [73% population increase](#) over the next 50 years, paired with a 63% increase in municipal water demand and an 18% decrease in water supply.¹ That math doesn't work, and water conservation alone will be insufficient to address this looming water crisis. So how do we grow our water supply and ensure water security for Texas? The answer is in the problem—we have to look at growth as a source of water, not just a source of demand.

This toolkit aims to guide Texas property developers, Texas owner/operators, and other professionals engaged in land development through the landscape of Net Zero Water, from design to permitting to maintenance. First, let's define terms and scope.

NET ZERO WATER

Net Zero Water refers to a design mindset that prioritizes the use of alternative water sources for a project's resilience and reliability. Net Zero Water aims to help a development provide for its own water needs through the **capture, storage, and treatment of compatible water sources found onsite.**

Through a Net Zero Water approach, **developments establish their own supplies of sustainable, climate-resilient water** while minimizing their total water consumption and total wastewater discharge. Net Zero Water offsets water demands and advances sustainable water management, making future development possible. The Net Zero Water method is comparable to the [One Water](#)² integrated approach to planning and implementation.

Net Zero Water is a net win for Texas, making the Lone Star State's water systems more independent and more resilient.



I. POTABLE

Drinking water

2. NON-POTABLE

Water source not appropriate for drinking

3. SURFACE WATER

Sources including lakes, streams, rivers, creeks, wetlands, and other water found above ground.

4. ONSITE TREATMENT

Treating water near its source and use, as opposed to water treated offsite at a conventional treatment facility

5. ALTERNATIVE WATER SOURCES

Umbrella term for water not provided by a centralized utility, state-owned surface or groundwater resources

6. ONSITE WATER REUSE

Collecting and treating alternative water sources from a development for use across that development

7. WATER CAPTURE

Taking possession of water that arrives onsite

8. BLACKWATER

Wastewater from kitchen and utility sinks, urinals, and toilets

9. GRAYWATER

Wastewater including all sources except kitchen and utility sinks, urinals and toilets

10. EVAPORATIVE COOLING BLOWDOWN

The water drained from cooling towers with heavy mineral content

11. WASTEWATER

Umbrella term for blackwater and graywater

12. FOUNDATION DRAINAGE WATER

Groundwater that infiltrates a foundation

13. STORMWATER

Surface water from rainfall events

14. RAINWATER

Water collected from rooftop runoff only

15. AC CONDENSATE

Condensed water from air conditioning equipment and cooling towers

16. RECYCLED/RECLAIMED/PURPLE PIPE WATER

Wastewater that has been treated for non-potable reuse, often by a water utility

NON-POTABLE POTENTIAL PUBLIC WATER SYSTEM

Texas can meet the challenge of increased non-potable water demand with increased non-potable water supply. Most water used for municipal needs does not need to be potable—think toilets, irrigation and cooling towers. Texas law already allows most non-potable onsite water reuse without permitting at the state level. In contrast, the barriers to entry for potable onsite reuse beyond single family home applications are much greater. So far, only one onsite potable water reuse system, a 100% rainwater drinking water system at [Shield Ranch](#)³, has been permitted by the Texas Commission on Environmental Quality (TCEQ). **Due to non-potable reuse systems' greater accessibility, this Toolkit focuses solely on non-potable water reuse.**

SHIFTING THE WATER CYCLE

THE ONSITE WATER REUSE DIFFERENCE


The power of Net Zero Water lies in its ability to shift the traditional path of water use.

Onsite water reuse systems move away from a single water use mentality, where a centralized utility captures and treats freshwater, sells it to customers for one-time use before the water is shipped off site where it is cleaned and discharged into a stream or river, to a more cyclical model, where the customer participates in building water resilience by capturing and treating water onsite.

The Net Zero Water approach increases resiliency through a diversified water portfolio, as onsite water reuse systems can be implemented in tandem with centralized water and wastewater treatment. Net Zero Water can also provide water independence, implemented as a standalone practice without centralized water services.

Beyond its flexible application, Net Zero Water systems copy nature's water cycle—after all, every drop of water we've ever consumed, cooked with, or bathed in has been used and recycled countless times through millenia. Net Zero systems mimic nature's efficiency as well. **Buildings equipped to reuse water through capture, storage, and treatment can meet their water needs with 10-30% of the water services that their traditional counterparts without onsite water reuse require.**⁴

As water prices continue to rise and water supplies continue to dwindle, Net Zero Water developments are becoming increasingly cost effective. Up to 95% of a commercial building's water demands are non-potable, and up to 50% of a residential building's water demands are non-potable.⁵

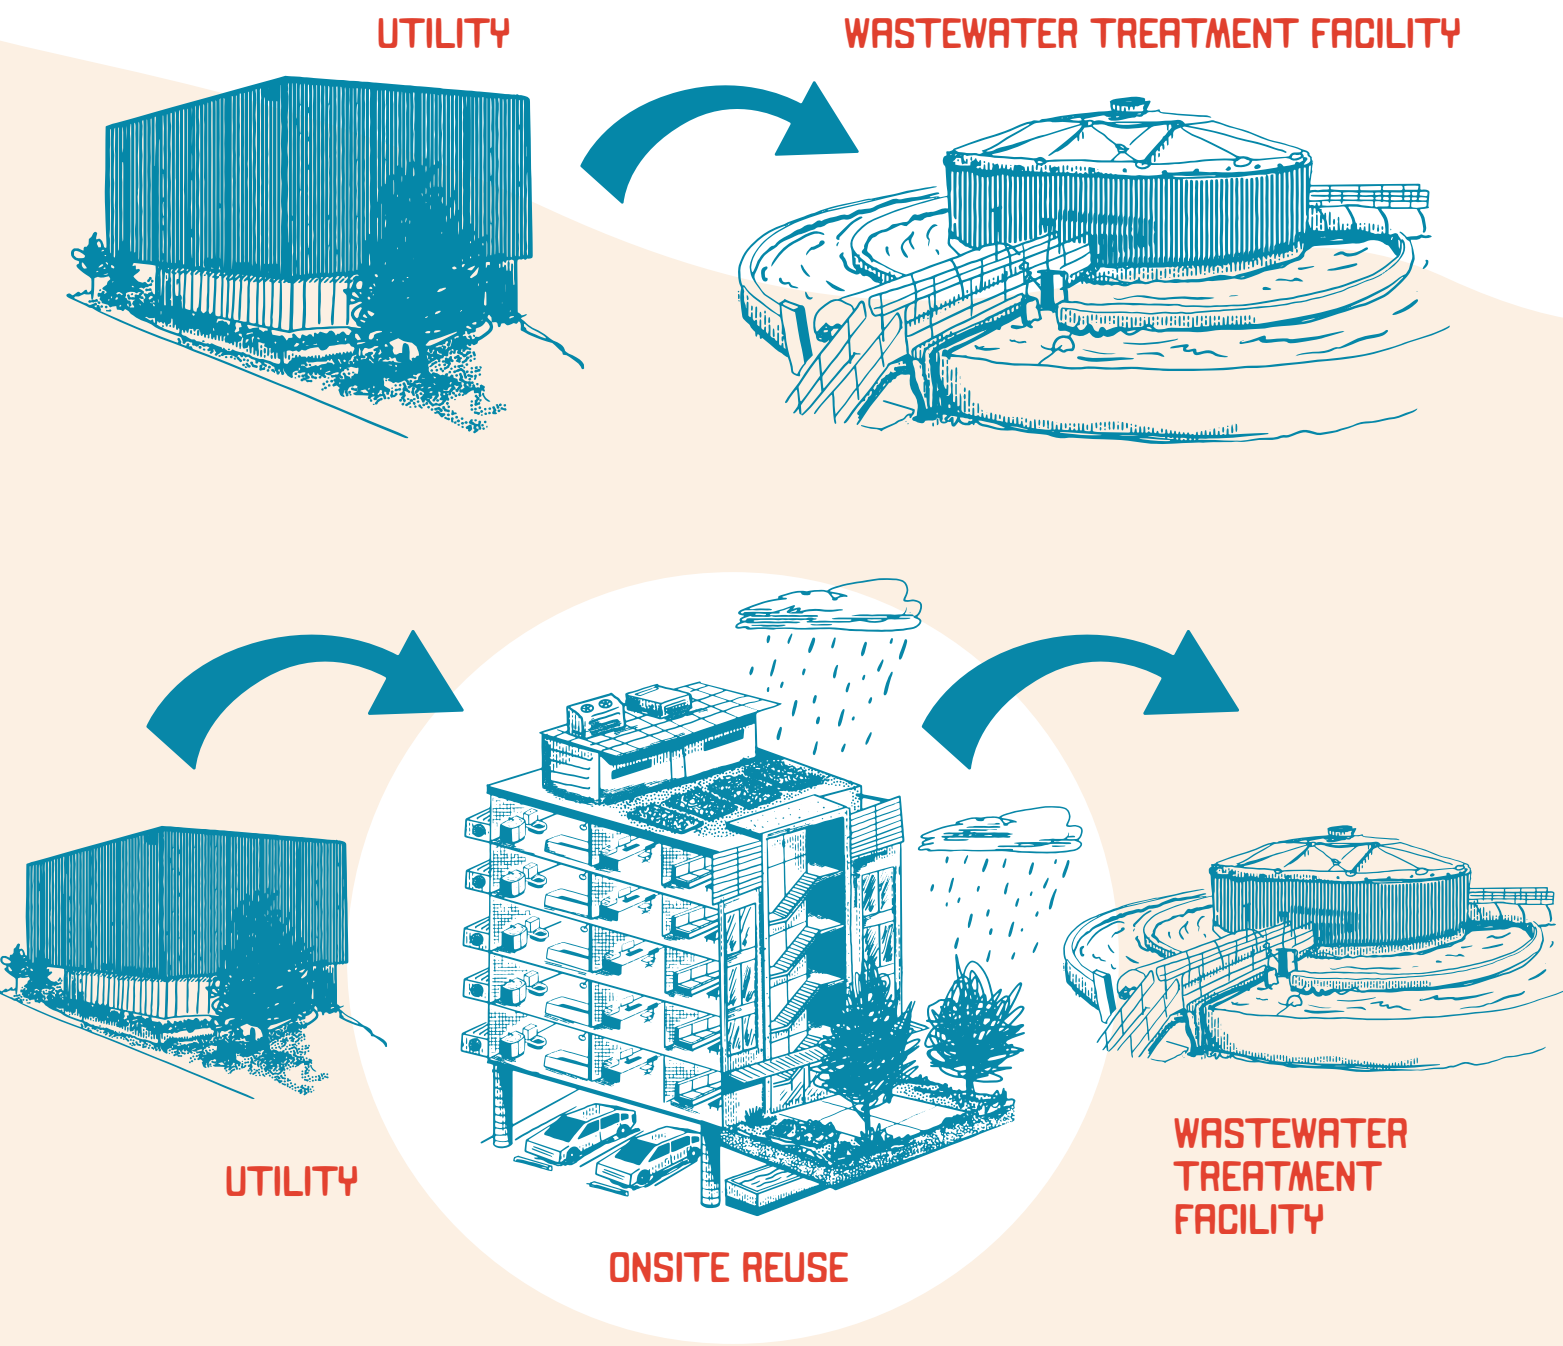

WATER QUALITY

HEALTH AND SAFETY


While efficiency is important, public health is paramount when talking about water supply. Net Zero Water is safe, reliable, and resilient when managed properly. It is essential to emphasize that no matter the source of onsite water, all alternate sources of water require treatment, maintenance and testing. The TCEQ recommends the National Science Foundation's [\(NSF's\) Water Reuse Systems Standards](#) to ensure best practices for protecting environmental and human health.⁶ To support advanced onsite water practices, Austin adheres to a set of national standards developed by the [Blue Ribbon Commission for Onsite Non-Potable Water Systems](#).⁷

Both standards use a fit-for-purpose treatment approach, where the level of treatment required for water reuse is dependent on the quality of the source water and the planned use for the treated water.

Regardless of the standard chosen, ongoing maintenance and monitoring are critical to ensure public safety and reliable water.

The level of treatment and monitoring required depends on the source of onsite water being used (e.g. AC condensate versus blackwater) and the end use of the reuse water (e.g. drip irrigation versus toilet flushing). This combination will influence the cost of ongoing management for the reuse system, and should be considered early on in the design process.

Across Texas, many projects have already recognized the advantage of Net Zero Water systems. The next section will explore the various users, development types, densities, and onsite reuse technologies already operating in Texas.

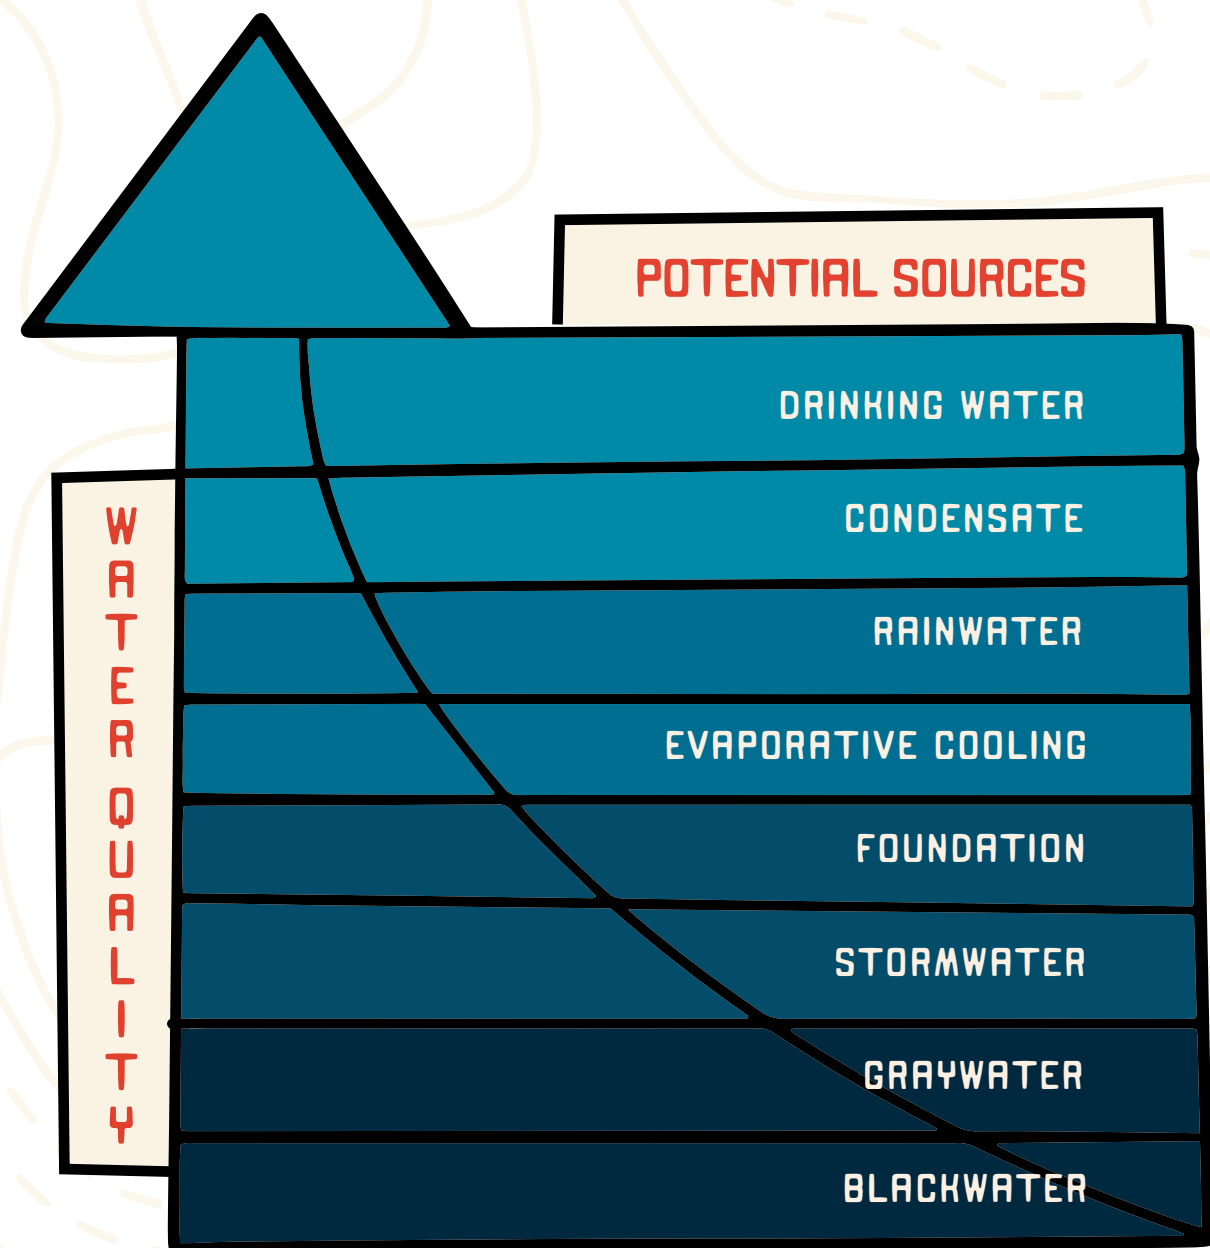

The higher the source's water quality, the less treatment required.



BRODIE OAKS, AUSTIN *(Master Planned Community - Mixed Use)*

This urban infill redevelopment will transform an existing low-density commercial shopping complex and office park into a mixed use for living, working and shopping.

The redesign will include 1700 housing units (200 affordable), 200 hotel rooms, 140,000 sq-ft of retail and 1.26 million sq-ft of commercial office space.

The plan will transform 21 acres of parking into 13 acres of open space.

Water reuse systems increase profit margins by playing multiple roles: increasing allowable permeable cover while meeting groundwater protection ordinances.

Brodie Oaks will capture all rooftop rainwater for beneficial use, including landscape irrigation and cooling towers.

All stormwater from the site will be retained either in ponds or underground storage tanks and then will be re-irrigated onsite.

Rainwater and stormwater reuse systems allowed the project to free up 6 additional acres for negotiated permittable uses while cutting runoff by ⅔.⁸



UNIVERSITY OF TEXAS, AUSTIN *(Institutional)*

Since 2013, the University of Texas has been using centralized reclaimed water (purple pipe) from the City of Austin for the heat exchange in their two thermal storage tanks, which cool water during off-peak hours for later cooling use during peak hours. The two tanks have a joint capacity of 9 million gallons.⁹

The university also uses 50-60 million gallons of AC condensate water to fill its cooling towers all across campus.

The university also uses its centralized reclaimed water (purple pipe) to make up evaporative losses in some campus cooling towers and for irrigation on some areas of campus.

Onsite water reuse saves the university more than 100 million gallons of potable water each year.¹⁰



CASE STUDIES

LEGEND

WATER SOURCES

- RAINWATER
- CENTRALIZED PURPLE PIPE
- CONDENSATE
- BLACKWATER
- FOUNDATION
- GRAYWATER

WATER USES

- TOILETS
- LAUNDRY
- IRRIGATION
- COOLING TOWERS
- FIRE PROTECTION
- CONSTRUCTION DUST CONTROL


DENSITY/LOCATION

- TX URBAN
- TX EX URBAN
- OUTSIDE TEXAS

CREDIT HUMAN HQ, SAN ANTONIO (Commercial)


Credit Human’s 12-story, 200,000 sf headquarters in San Antonio includes: a geothermal system for heating and cooling that saves approximately 1.25 million gallons of water annually; 1 megawatt solar system that offsets nearly 40% of energy use needs; an airtight building envelope certified by the Department of Energy as 40% tighter than code; advanced plug load controls; a Variable Refrigerant Flow (VRF) HVAC system; and a water capture and reuse system with the capacity to hold 140,000 gallons, including 80% of rainwater collected on site and cooling tower condensate.

Captured water is used to flush all toilets, provide irrigation, and supply makeup water for the cooling towers, resulting in an estimated savings of 4 million gallons of water per year.

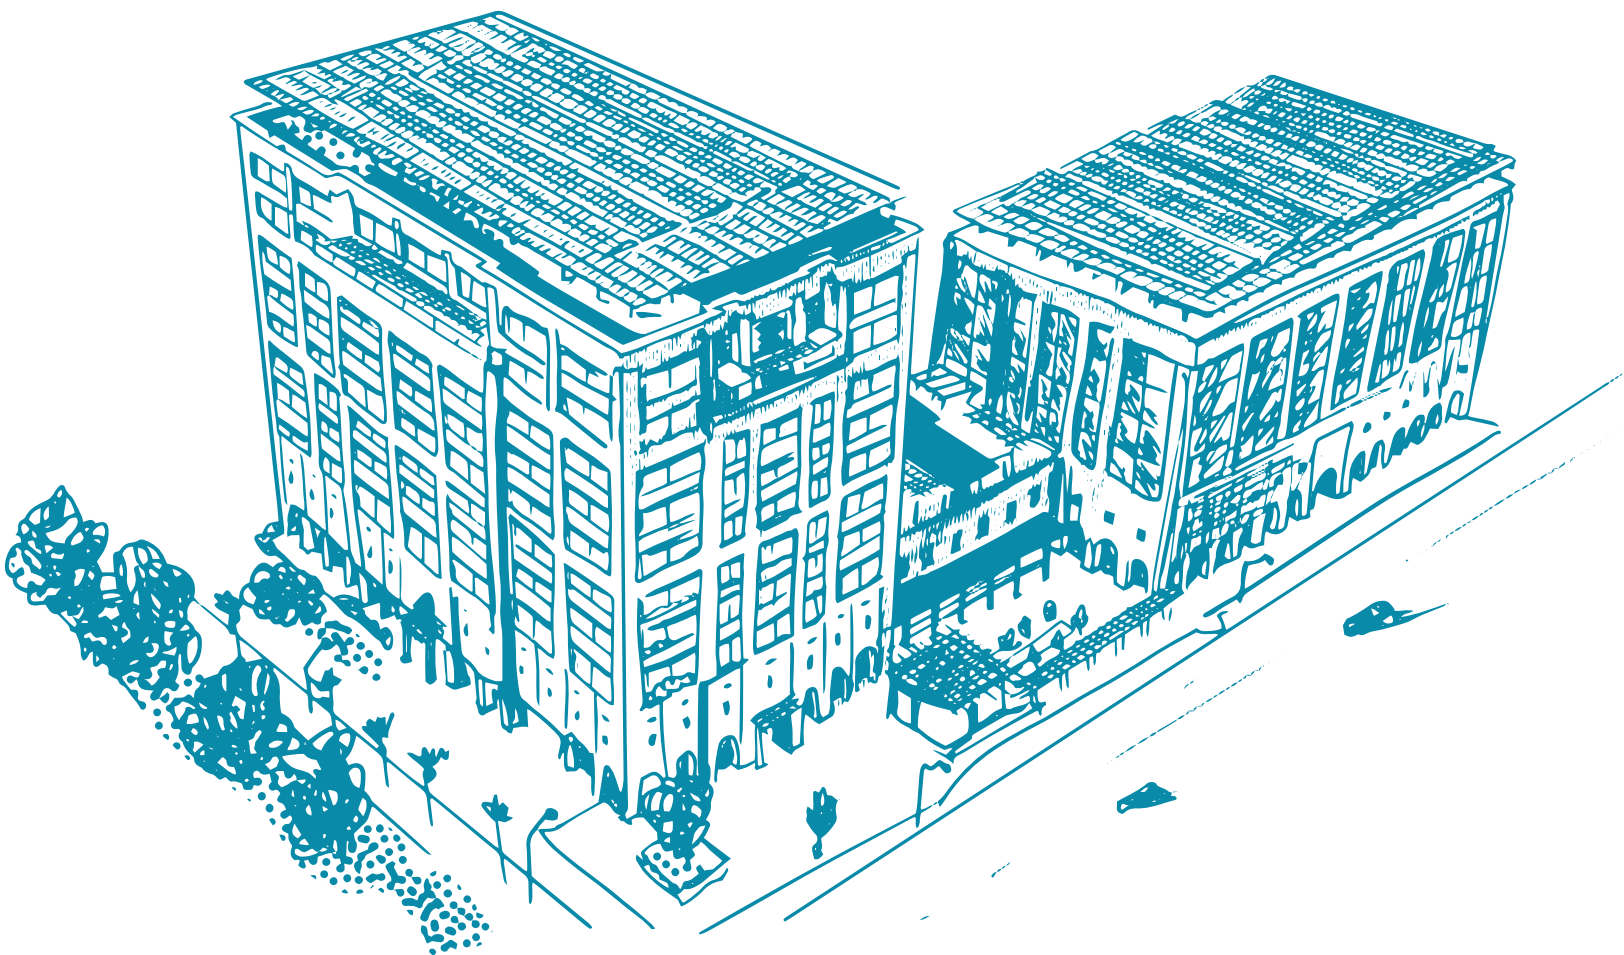

The additional connection and use of San Antonio Water System reclaimed water provides the building with another source of water for non-potable needs.


Credit Human invested approximately 4.6% of the total building cost in sustainable design elements and systems to save water, reduce electricity, and lower carbon emissions. With an internal rate of return of more than 11% in just 13 years, this investment is projected to be the top performer in Credit Human’s portfolio.¹¹

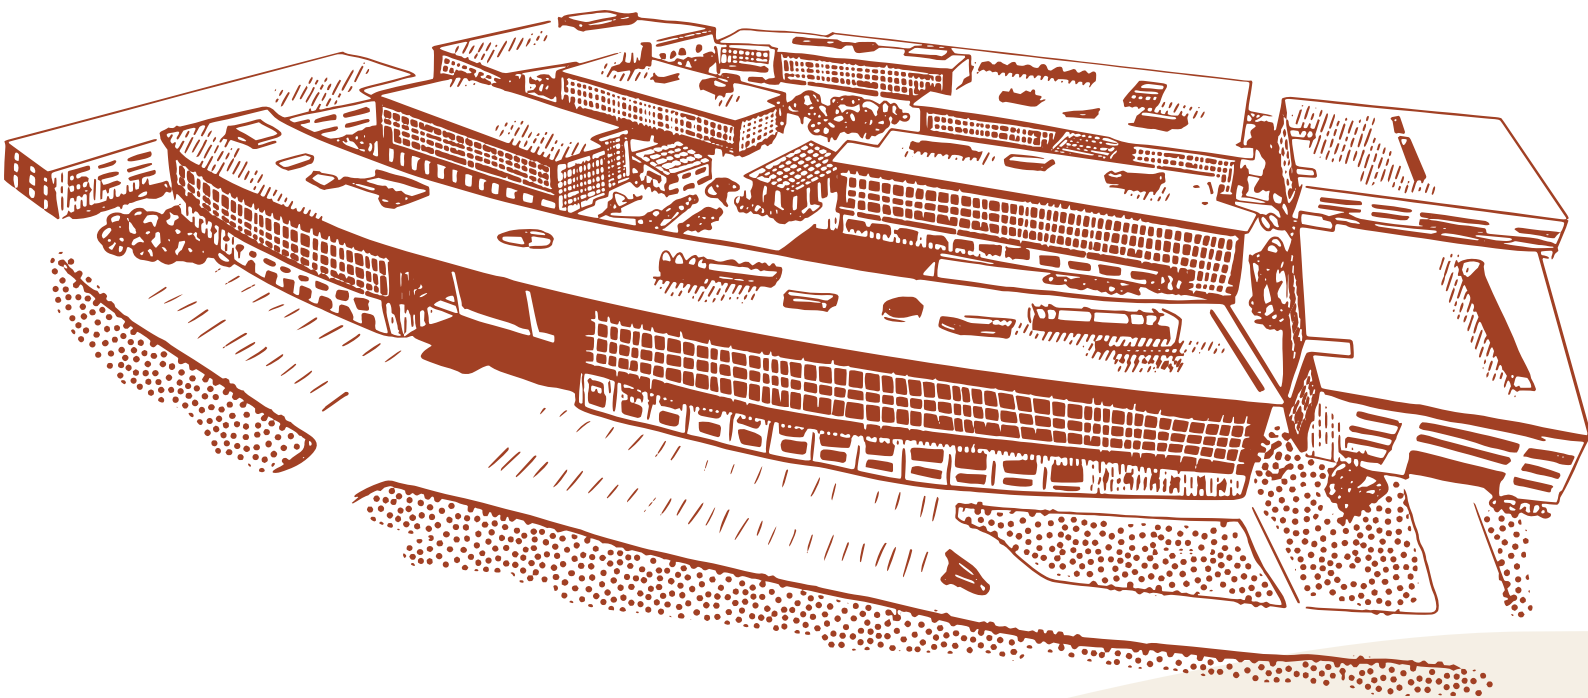

TOYOTA HQ, PLANO (Commercial)

A cistern storage system holds 400,000 gallons of rainwater for irrigation and indoor sanitary facility reuse.

Toyota anticipates saving 12 million gallons of potable water annually.¹²

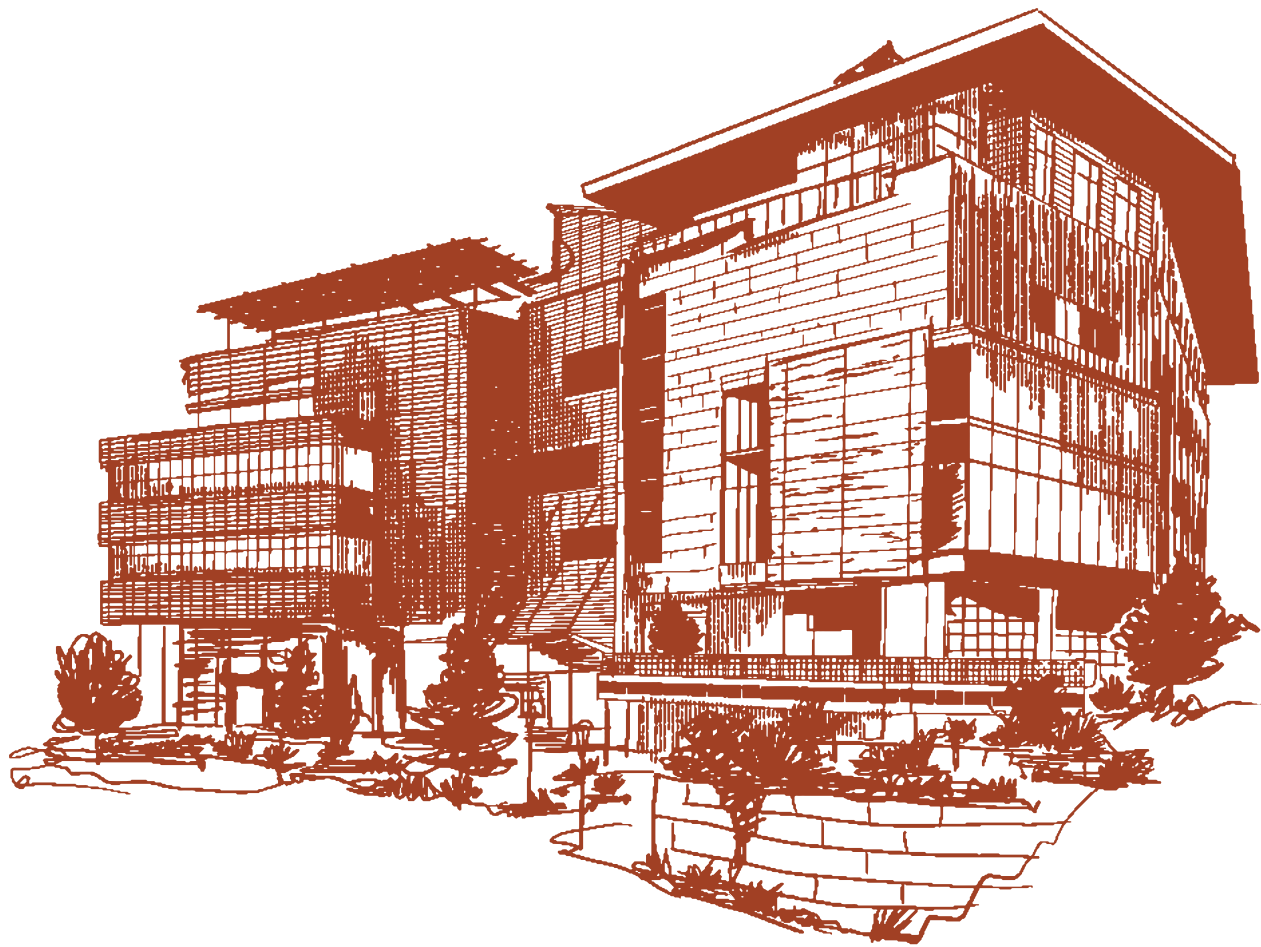

AUSTIN CENTRAL LIBRARY, AUSTIN (Commercial)

The library’s combined reuse systems enable 85% less potable water use.

Onsite rainwater cistern can hold 700,000 gallons of water.¹³

Collected AC Condensate is stored in the same cistern.

The library uses a 10,000 gallon day use tank to hold treated water.

The library saves 1.5 million gallons of potable water a year.



LAKEWAY MUNICIPAL UTILITY DISTRICT, LAKEWAY (Mixed Use)


Lakeway captures and reclaims 100% of their wastewater, the key to their compliance with statutory prohibitions from discharging wastewater into the Highland Lakes. The District’s two water recycling permits allow for a total average annual flow of 1.21 million gallons per day.¹⁴

Reuse water is subjected to tertiary polishing before distribution through the reclaimed water system.

The District’s Chapter 210 Reclaimed Water Authorization permit allows for use across the greater Lakeway area, including irrigating the landscaping on rights-of-way and medians as well as the common areas for homeowner associations, businesses, golf courses, parks, and other irrigable areas. The District has 37 commercial customers.

As of February 2024, the District had 17 single family home residential customers purchasing reclaimed water for irrigation use, and is seeking additional residential customers. During drought restrictions, reclaimed water customers are able to water their lawns twice as frequently as neighbors who only purchase potable water.¹⁵


Usage limits are set to ensure adequate storage in reuse effluent storage facilities. As a result, irrigation limits for reclaimed water customers are driven by wet weather statistics, whereas customers using potable water for irrigation are limited based on water storage in the Highland Lakes.

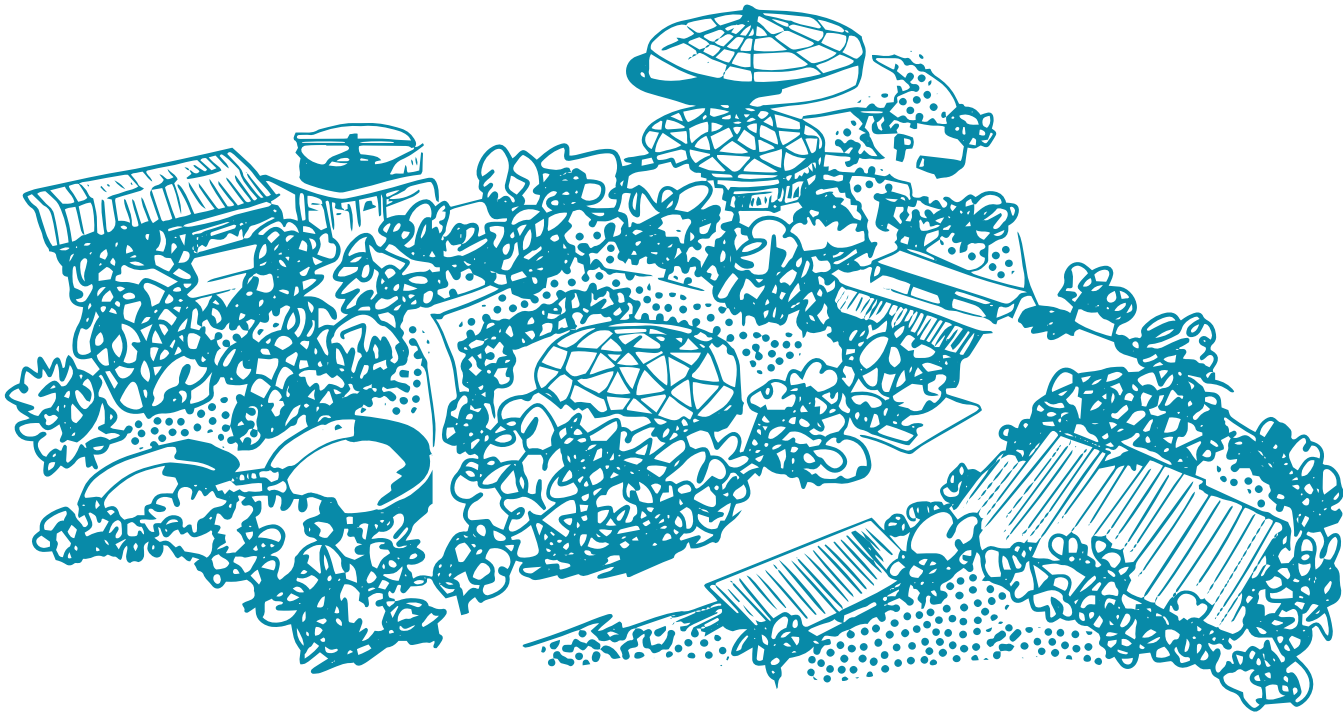

Lakeway MUD uses bond financing for reclaimed water infrastructure for in-district customers and cash financing for out-of-district customers.

Thanks to Lakeway’s water reuse programs, the District was able to sell off 82 acres of cedar tract that had been set aside for wastewater disposal. This sale garnered the District at least \$12 million.¹⁵



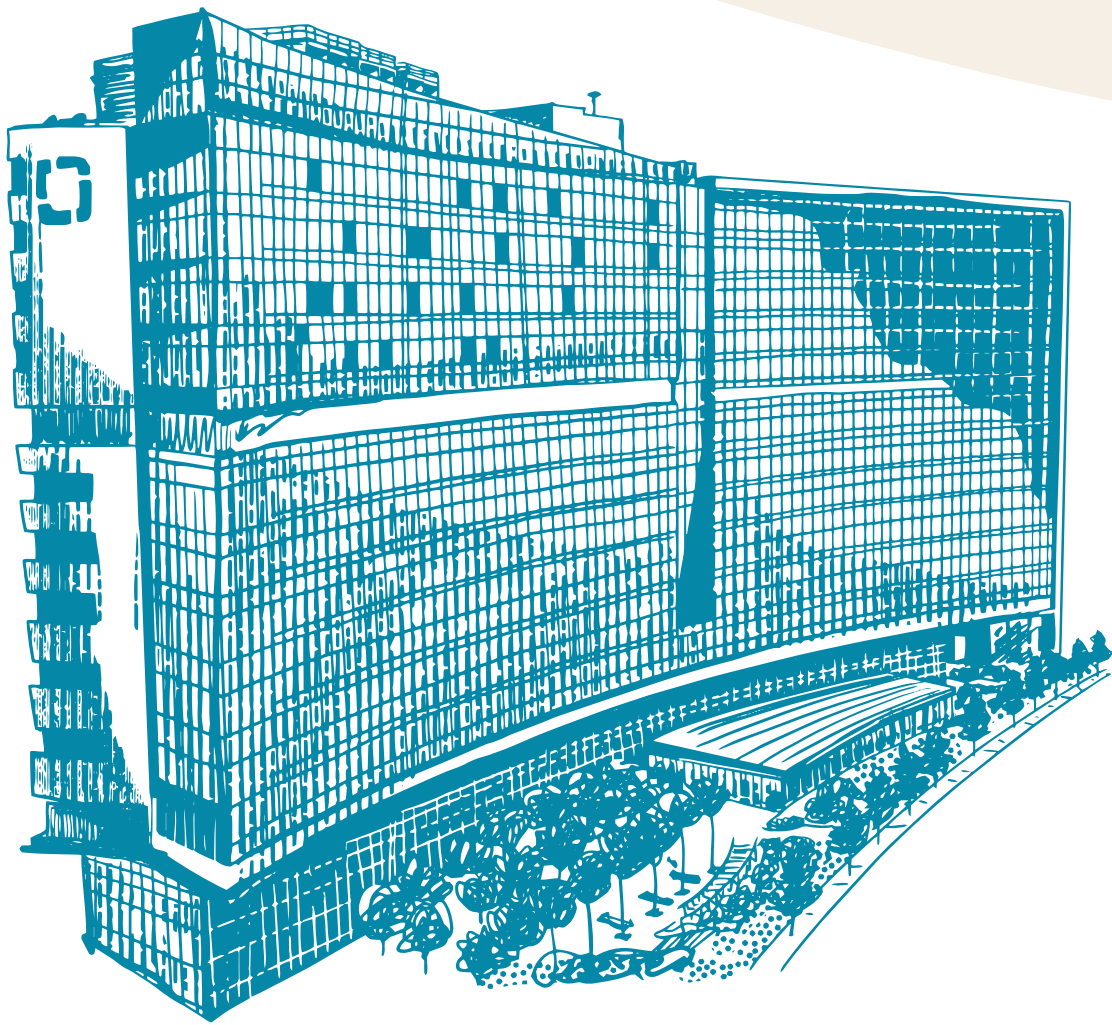


PIEDMONT HOSPITAL, ATLANTA

(Institutional)(Outside Texas)

Motivated by the desire to increase operational resiliency in the event of service disruption, Piedmont deploys its processed water to feed its cooling towers and boilers.

Piedmont's onsite water reuse system is a campus scale project intercepting nearly all hospital wastewater.

The hospital will reduce its water footprint by over 40%, saving an estimated 750 million gallons of potable water in the next decade.¹⁶

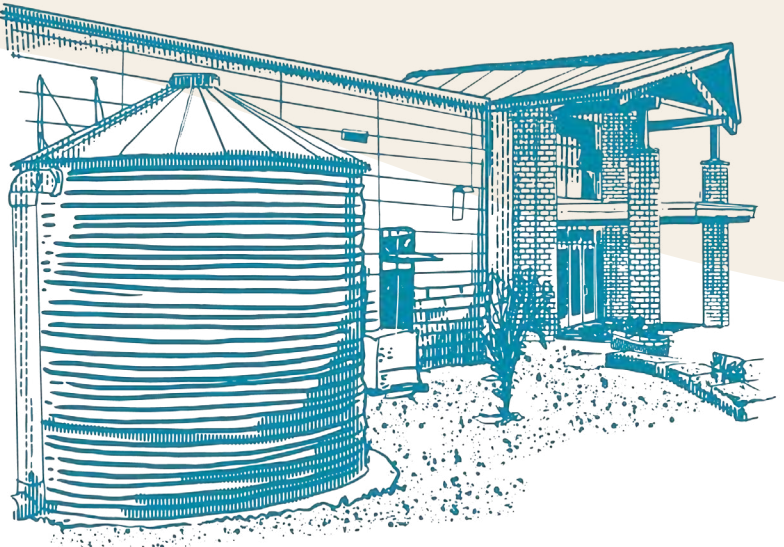

BLUE HOLE PRIMARY SCHOOL,

WIMBERLEY *(Institutional)*

System designed to contribute 2,800 gallons per week for non-potable needs during AC operation.

Utilizes UV-treated effluent for subsurface drip irrigation, including a 1.27-acre athletic field behind the school.

Average daily wastewater flow: <5,000 gallons

Average daily interior non-potable water demand: 2,280 gallons (2.85 gallons per person)

Expected annual potable water savings: Projected at 90%

Actual first-year savings: 554,800 gallons (49.4% less water use than a comparable school)

Projected 30-year cost savings: \$724,500.¹⁸



RESIDENTIAL MASTER PLANNED COMMUNITY, NEW SOUTH WALES, AUSTRALIA

(Master Planned Community - Single Family)(Outside Texas)

Infrastructure constraints in Australia led to the pursuit of single family scale water reuse for denser development. Through the delivery of package plants, one New South Wales development increased its maximum developable lots from 8 to 35.

The higher cost of water reuse can be more than offset by the increase in buildable units, increasing developer profit while meeting water supply and quality standards.¹⁹ In the case of the New South Wales development, the increased density due to onsite water reuse led to an \$11 million increase in profit.

Wastewater reuse for landscape irrigation on common elements and residential landscapes should be considered as an alternative to traditional land application wastewater discharge (which dedicates large acreages to non-marketable uses) and direct discharge permits (which frequently spur costly litigation over environmental concerns). Stormwater and wastewater reuse infrastructure can be funded through traditional vehicles like municipal utility districts.

Onsite reuse has yet to hit the single family residential planned community market in Texas. Outdoor irrigation from reuse water is the most logical place to start as it does not require dual plumbing of residences.



PERMITTING AND DEVELOPMENT CENTER (PDC), AUSTIN

(Institutional)

Onsite rainwater capture, condensate capture, and wastewater reuse are expected to reduce potable water usage by 75% compared to similar buildings.

Footprint: 800-sq ft for treatment system, housed in green space between the building and parking structure.

The PDC building is equipped with two subsurface water storage tanks, capable of storing 40,000 gallons of onsite harvested water supplies.

Sustainability Certification: WELL Certification at the Gold Level

BUILDING DATA:

Building Size: 264,000 square feet


Average daily wastewater (blackwater and graywater) flow: <5000 gallons

Average daily interior non-potable water demand: 2,280 gallons (2.85 gallons per person)

Onsite storage capacity: 40,000 gallons

Peak rainwater treatment design flows: 1,500 gallons per minute

Total annual non-potable water supply capacity: 1,500,000 gallons

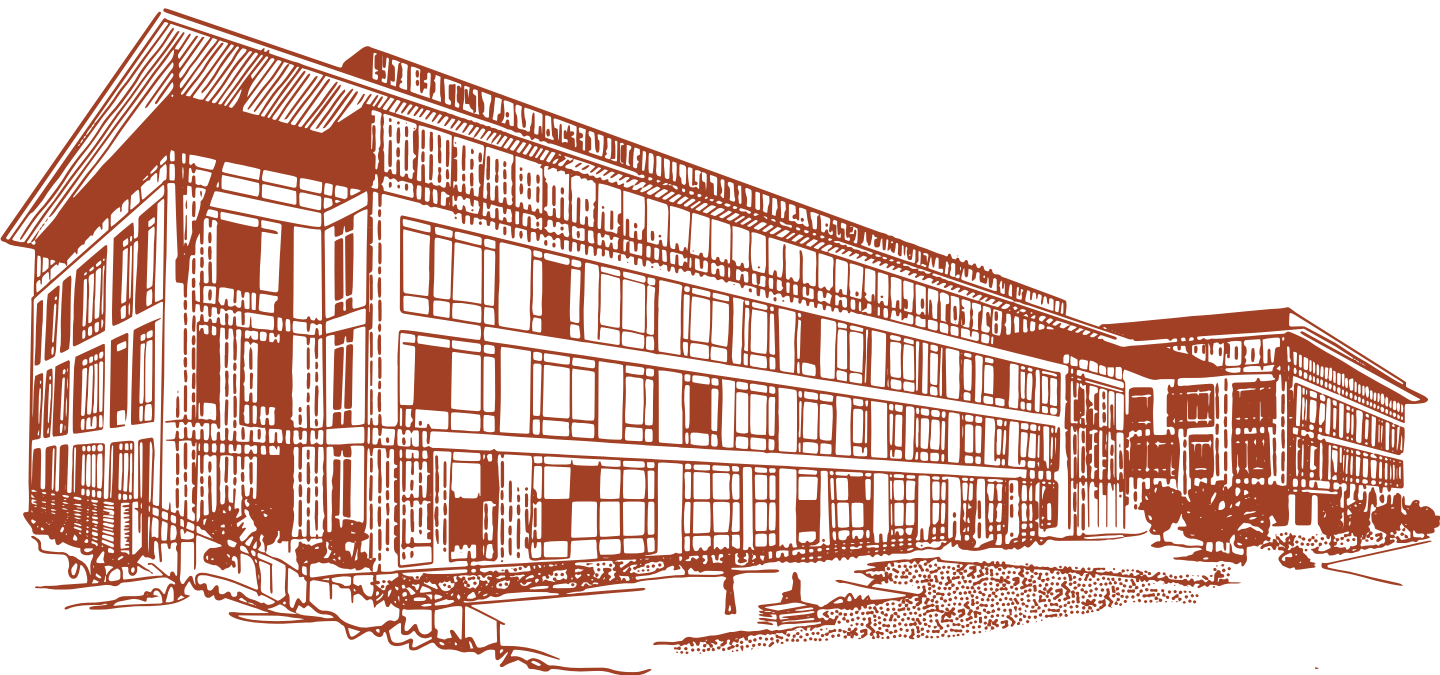

COST DATA:

\$1,700,000 for blackwater system (\$145,000 for dual plumbing)

\$625,000 for rainwater and condensate storage

Total System Capital Cost: \$2,325,000.¹⁷



RETROFIT

Water reuse retrofits do not require dual plumbing existing buildings—a practice that is cost prohibitive for most retrofits. Retrofits can tap into foundation drainage water and/or AC condensate, which already have dedicated plumbing systems. Without extensive additional plumbing, these sources can meet certain cooling tower and irrigation water demands.²⁰

ZURICH INSURANCE HQ, ILLINOIS


(Commercial, Outside Texas)

Zurich Insurance retrofitted its cooling towers to use foundation drainage water as an alternative to potable water purchased from its local water utility.

Potable water was replaced with foundation drainage water that was already being pumped and discharged into the stormwater system, approximately 25,000 gallons a day.

High mineral content of foundation drainage is managed through reverse osmosis to prevent cooling tower scaling.

Estimated daily savings of 14,400 gallons of potable water—equivalent to 45 households.

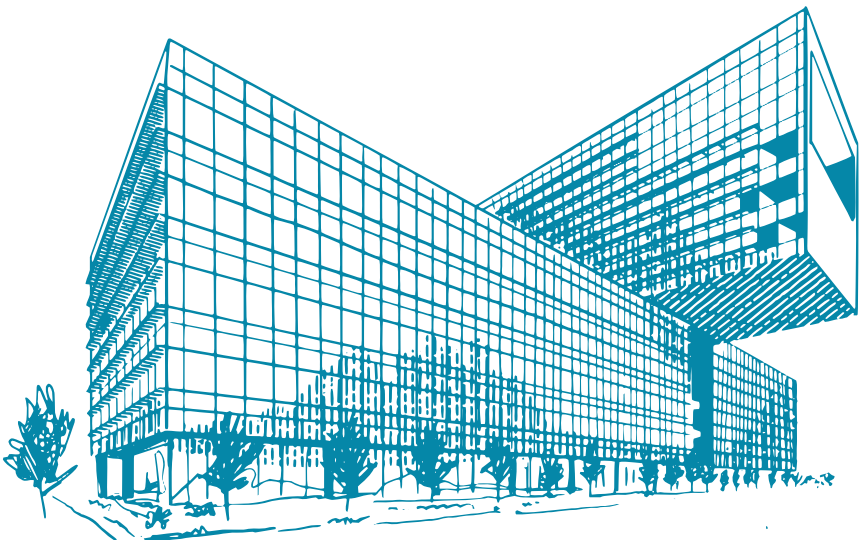

HOW WATER TREATMENT WORKS

Water reuse treatment systems deploy sequential stages of treatment to ensure water quality. The degree of treatment depends on the quality of the source water and the way that the treated reuse water will be used. The lower the water quality of the source water and the more likely that users may inadvertently inhale or ingest the water, the more extensive the treatment process.


Systems that require the water to be treated for use should be designed to include continuous remote monitoring at various stages in the treatment process. Those monitoring stages are represented in the diagrams using dotted lines.

To get a sense of these processes in action, here are a few example treatment trains for a variety of source waters.

Note: These treatment trains represent appropriate treatment for institutional, commercial, multifamily residential and district-scale single family home master planned communities. Treatment at the scale of individual single family homes is not being suggested due to economic inefficiencies for construction and maintenance.


RAINWATER

As a higher water quality source, rainwater treatment systems require relatively simple treatment.

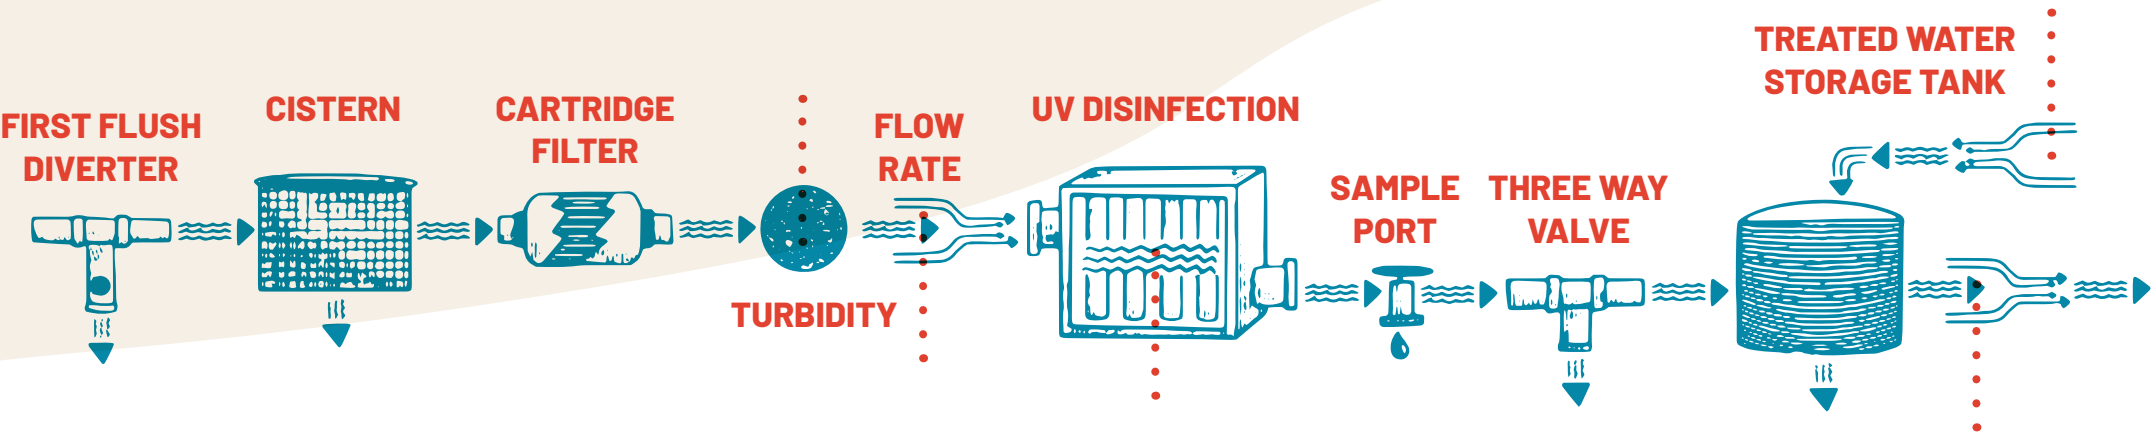

- Screens on the gutters keep out leaves and larger detritus.
- The first flush diverter filters out dust and debris.
- The cistern holds rainwater in storage until use is required.
- The cartridge filter strains out smaller particles and some pathogens before further treatment takes place.
- UV light kills microorganisms and prevents any reproduction through the UV radiation effect on genetic material.
- The sample port acts as a quality checkpoint for operators to take samples and ensure water standards.
- The three way valve is a key tool for directing water flow based on system need-be that adjusting flow distribution, facilitating maintenance, diverting flow, or adapting to process changes.
- The treated water is stored in a tank until sent to end users.


CONDENSATE TO COOLING TOWER SYSTEM

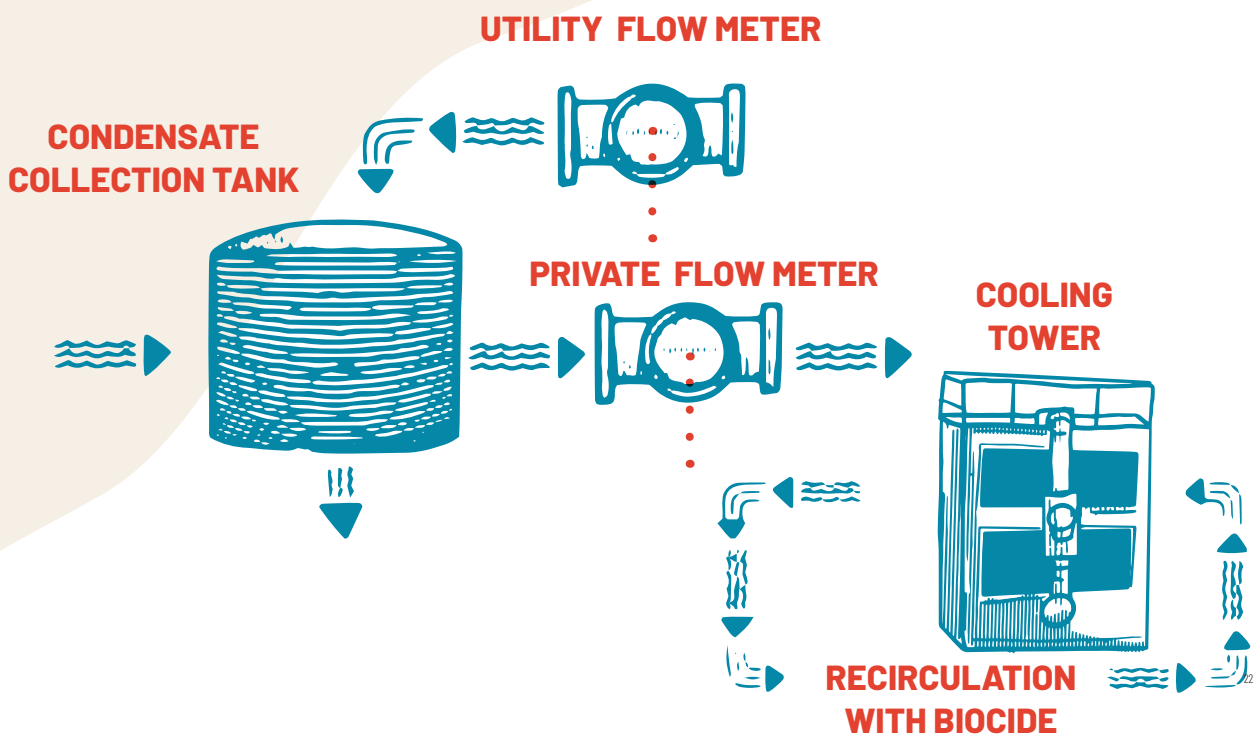

- Condensate water from various sources such as air conditioning units, dehumidifiers, or other equipment are gathered in the condensate collection tank for storage.
- Connection to potable water source provides for makeup quantity if needed.
- Flow meter measures water's movement through the system.
- Water cycles through the cooling tower. Biocides control microbial growth and prevent biofouling in the cooling tower.

CONDENSATE AND RAINWATER TO SPRAY IRRIGATION SYSTEM


Like rainwater, condensate's higher starting water quality makes treating it more simple.

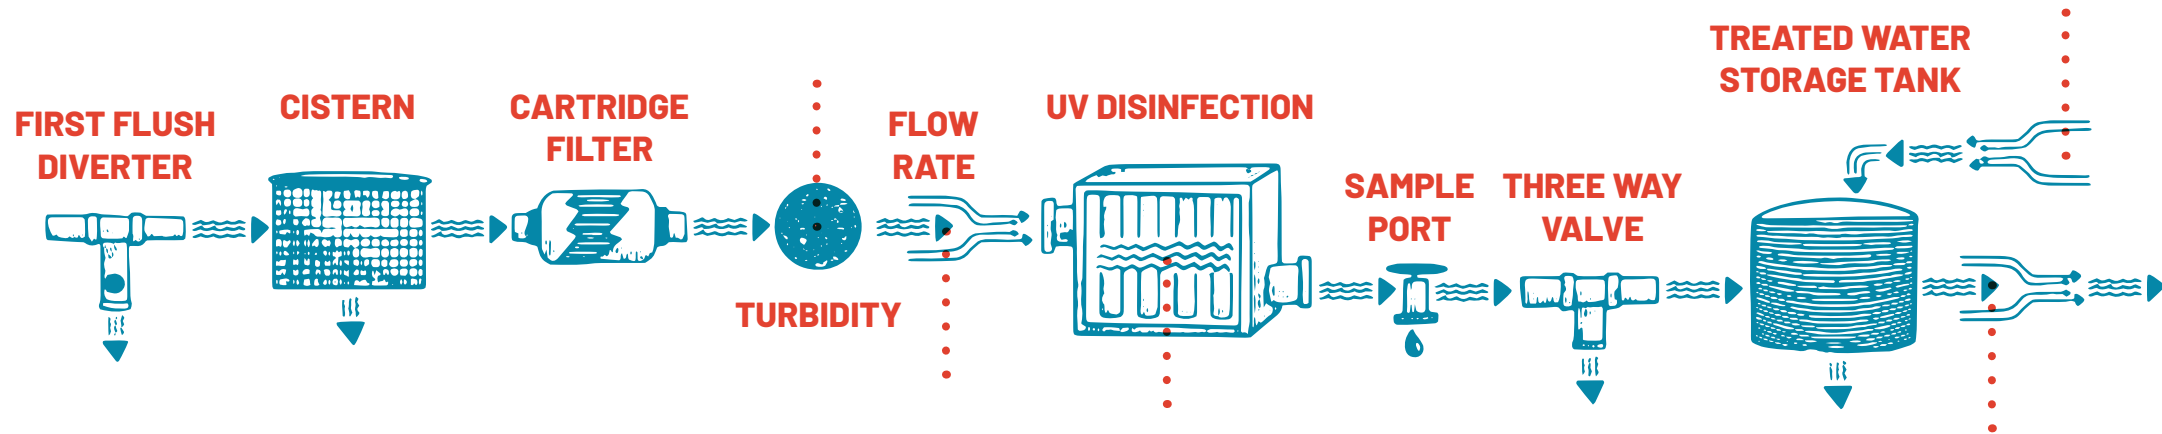

- The prescreen performs the initial filtration for debris.
- The flush diverter filters out dust and debris to ensure the storage of clean water.
- The cistern holds captured water in storage until use is required.
- The cartridge filter strains out smaller particles and some pathogens before further treatment takes place.
- UV light kills microorganisms and prevents any reproduction through the UV radiation effect on genetic material.
- The sample port acts as a quality checkpoint for operators to take samples and ensure water standards.
- The three way valve directs water flow based on system need-be that adjusting flow distribution, facilitating maintenance, diverting flow, or adapting to process changes.
- Condensate water and treated water gathers in the collection tank for storage until sent to end users.
- Connection to potable water source provides for makeup quantity if needed.

STORMWATER AND FOUNDATION DRAINAGE


In terms of treatment trains, stormwater shares many of the components and steps required by rainwater capture.

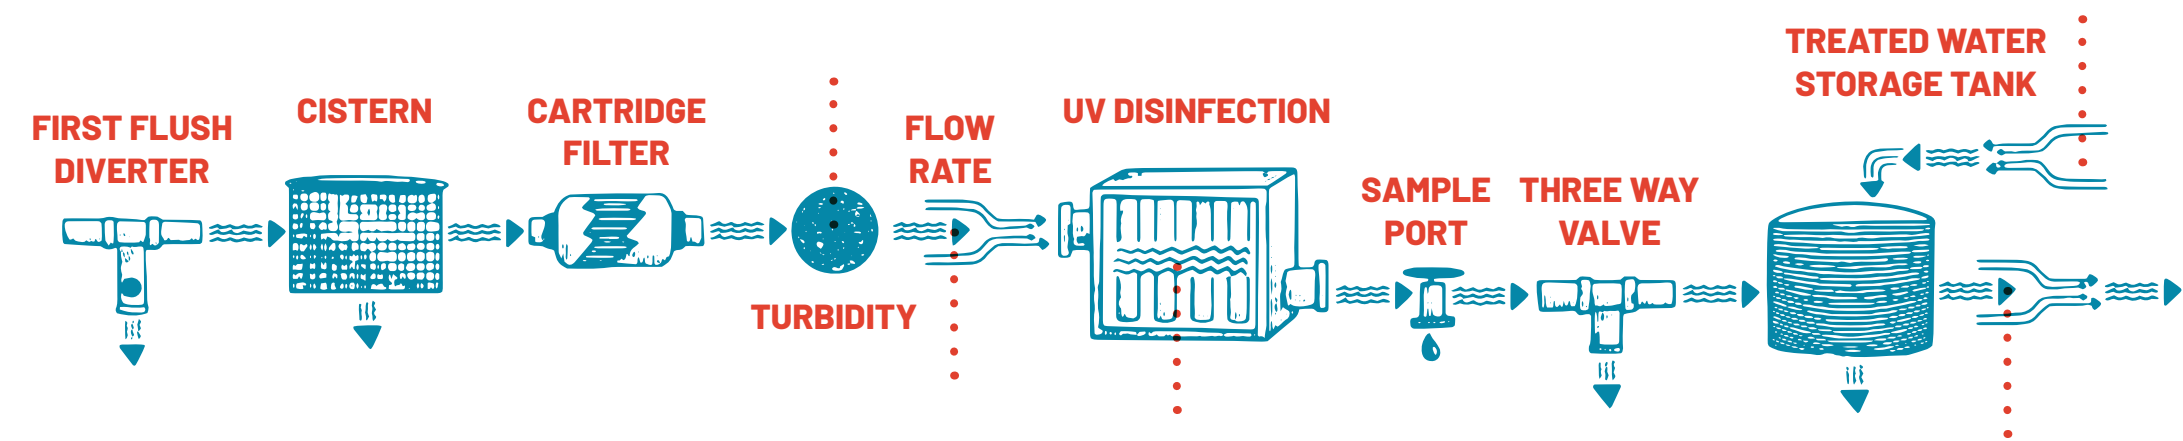

- The prescreen performs the initial filtration for debris.
- The flush diverter filters out dust and debris to ensure the storage of clean water.
- The cistern holds captured water in storage until use is required.
- The cartridge filter strains out smaller particles and some pathogens before further treatment takes place.
- UV light kills microorganisms and prevents any reproduction through the UV radiation effect on genetic material.
- The three way valve directs water flow based on system need-be that adjusting flow distribution, facilitating maintenance, diverting flow, or adapting to process changes.
- The treated water is stored in a tank until sent to end users.

GRAYWATER


Wastewater is more likely to have higher pathogen counts and higher concentrations of organic compounds than other alternative water sources, requiring an additional stage of treatment using beneficial microorganisms.

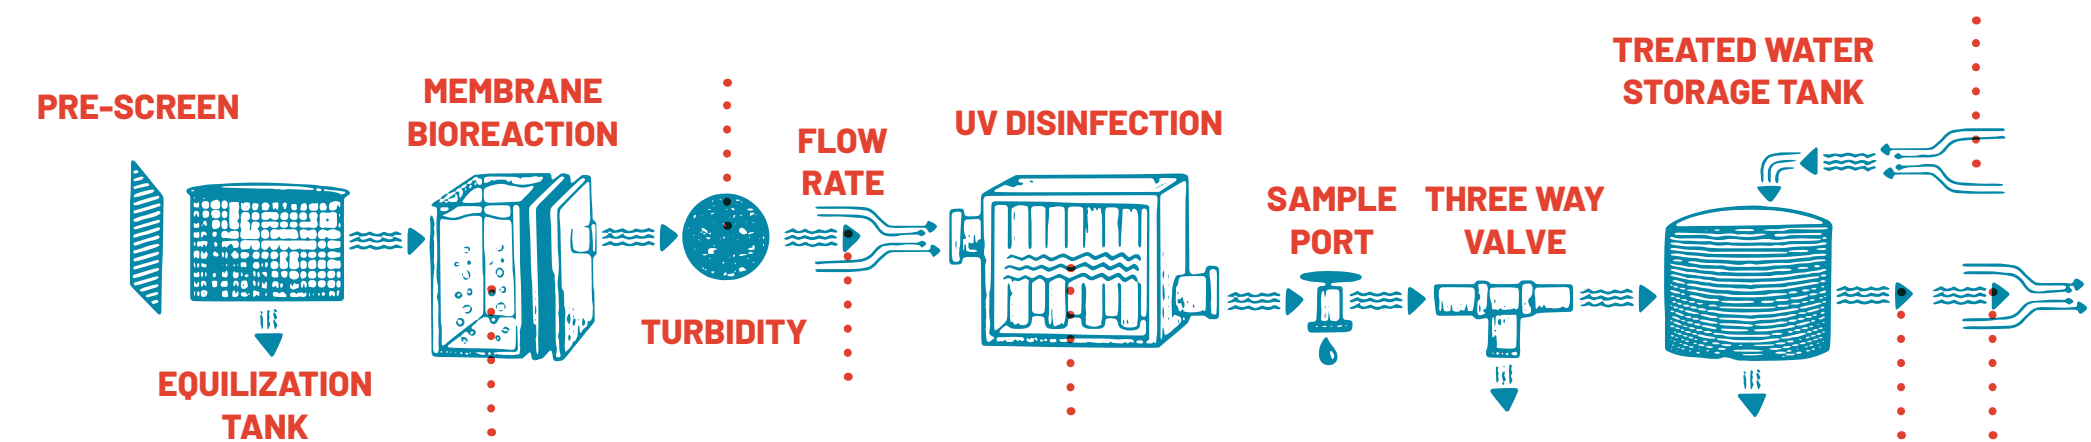

- The prescreen performs the initial filtration for debris.
- The equalization tank ensures consistent flow across the system.
- Microorganisms serve to break down organic pollutants while the membrane allows treated water to pass through. Ultrafiltration takes place in the membrane bioreactor as well, a pressure-driven barrier to suspended solids, bacteria, viruses, and other pathogens.
- After biological treatment, the water is treated with UV light to kill any remaining microorganisms.
- The sample port acts as a quality checkpoint for operators to take samples and ensure water standards.
- The three way valve is a key tool for directing water flow based on system need-be that adjusting flow distribution, facilitating maintenance, diverting flow, or adapting to process changes.
- A small dose of chlorine acts as a secondary disinfection agent, killing any remaining bacteria, viruses, or residual microorganisms. It also serves an oxidizing role to ensure acceptable water color.
- The treated water is stored in a tank until sent to end users.

BLACKWATER

Given the lower water quality of the source, blackwater treatment systems have greater degrees of treatment than graywater systems, though they can use similar processes.

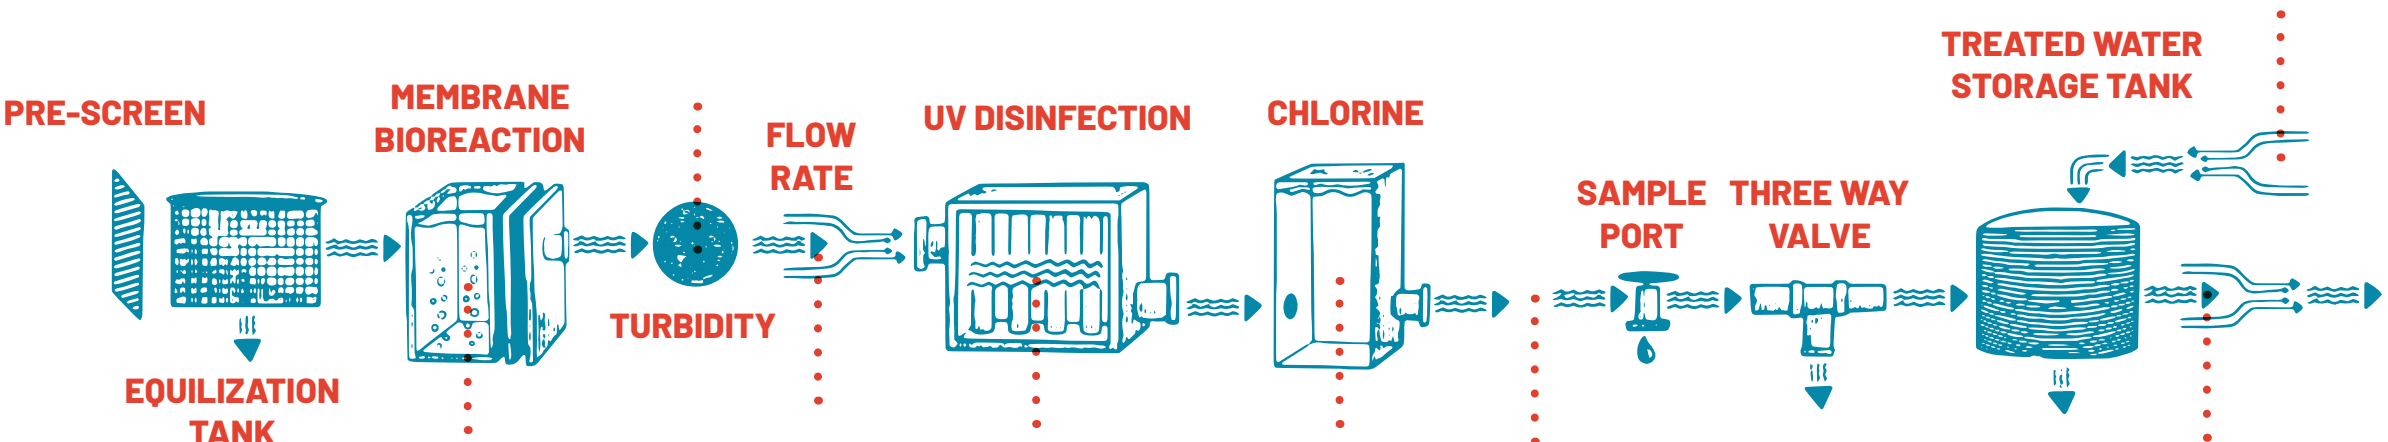

- The prescreen performs the initial filtration for debris.
- The equalization tank ensures consistent flow across the system.
- Microorganisms serve to break down organic pollutants while the membrane allows treated water to pass through. Ultrafiltration takes place in the membrane bioreactor as well, a pressure-driven barrier to suspended solids, bacteria, viruses, and other pathogens.
- After biological treatment, the water is treated with UV light and chlorine to kill any remaining microorganisms.
- A small additional dose of chlorine acts as a secondary disinfection agent, killing any remaining bacteria, viruses, or residual microorganisms. It also serves an oxidizing role to ensure acceptable water color and odor.
- The sample port acts as a quality checkpoint for operators to take samples and ensure water standards.
- The three way valve is a key tool for directing water flow based on system need-be that adjusting flow distribution, facilitating maintenance, diverting flow, or adapting to process changes.
- The treated water is stored in a tank until sent to end users.

While these are popular treatment trains, onsite water reuse systems can vary widely. Prominent approaches include ultrafiltration, reverse osmosis, disinfection including ozone & advanced oxidation, electrodialysis reversal, and thermal evaporation and crystallization. Specifics on how each of these treatment processes work can be found [here](#).²³

Onsite water reuse systems require proactive investment, dedicated planning, and regular maintenance. What are the benefits driving so many Texas developers to invest in these kinds of projects? As the next section demonstrates, early adopters of Net Zero Water have realized advantages across categories—from resilience to PR to sustainability to increased developable acreage.

WHY NET ZERO

Developments with Net Zero Water provide financial benefits beyond merely decreasing potable water use. Building with Net Zero Water provides advantages across the board, from reducing cost to avoiding operational disruptions to gaining competitive market advantage.

1. GAIN DEVELOPMENT UPSIDE

LIMIT UNMARKETABLE SPACE

Land application of wastewater and stormwater detention occupy valuable acreage. Water reuse can reduce the amount of land that must be dedicated to these purposes.

STRETCH LIMITED WATER TO MORE UNITS

Development permits require evidence of sufficient water to support the number of planned units. Those calculations assume that all water demands will be met with potable water and then discharged as wastewater. Water reuse can be used to negotiate greater intensity of development by stretching water supplies further.

EARN DENSITY BONUSES

Developers can negotiate additional entitlements such as greater density or height in exchange for reducing pressure on sensitive water resources.

2. PROTECT AGAINST DEVELOPMENT IMPEDIMENTS & OPERATIONAL DISRUPTIONS

PREVENT LITIGATION

Net Zero Water solutions provide an alternative to permit processes for direct discharge of treated wastewater into creeks and streams, which are increasingly fraught with costly litigation that delays projects.

PROTECT GREENSPACE DURING DROUGHT RESTRICTIONS


As drought restrictions become increasingly common ([527 for Texas in 2023 alone](#)),²⁴ developments using onsite water reuse systems for irrigation often have exemptions from watering restrictions, protecting their landscape investments and boosting curb appeal.

PREVENT CONSTRUCTION MORATORIUMS

Building with a Net Zero approach secures both a present and future water supply that can support development even in extremely resource-constrained regions. Building without water in mind produces the opposite effect:

In 2021, [Dripping Springs, TX](#) enacted a year-long moratorium on new construction largely due to the city's limited wastewater capacity.²⁵

In 2023, [Magnolia, TX](#) extended its moratorium on new building permits for a third time as the city struggled to address a water supply shortage.²⁶

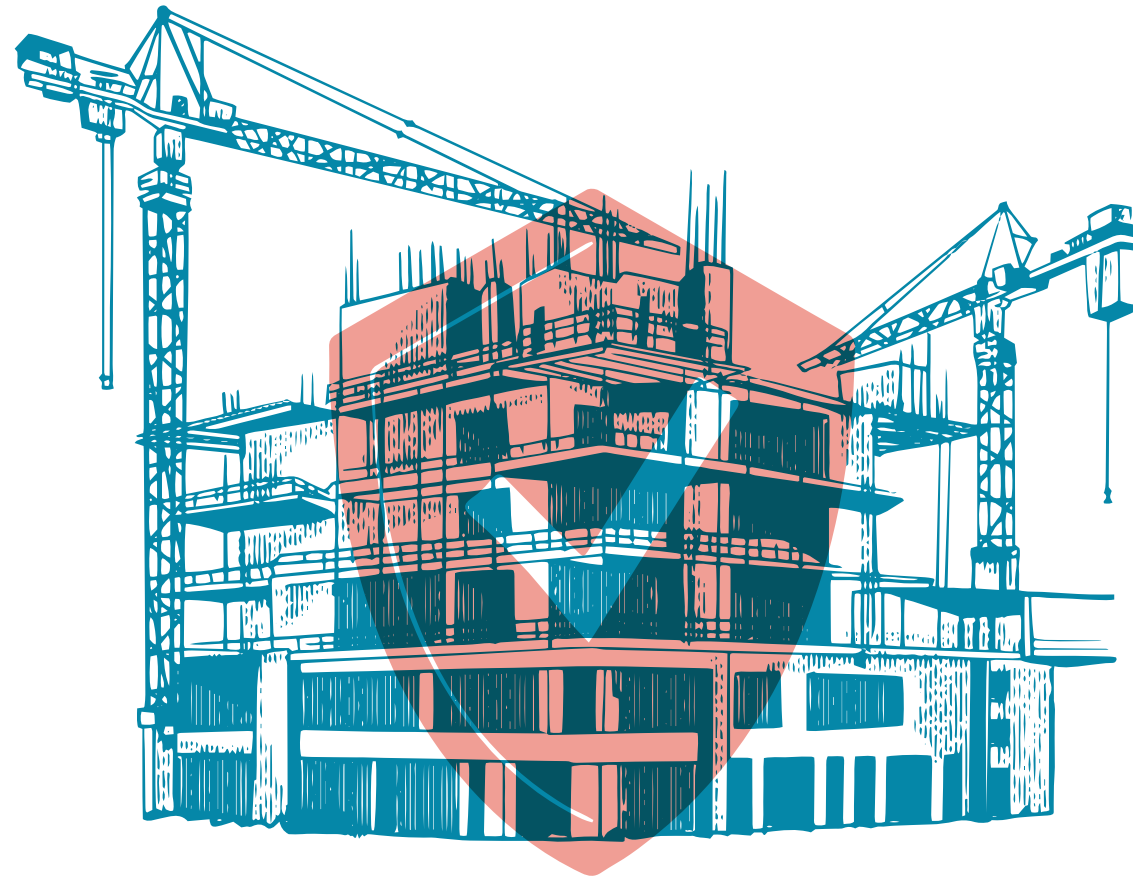

INCREASED RESILIENCE TO GRID FAILURES

In recent years, water service in a variety of Texas cities has been disrupted from a wide variety of extreme events, including hurricanes, extreme temperatures and floods. In such events, onsite water systems can continue to function as designed—as long as they are fed with electrical power—allowing buildings to maintain supply for toilet flushing, cooling towers or other needs met by reuse water.

In 2021, hospitals across Texas lost their access to water from utilities in the aftermath of Winter Storm Uri, compromising boilers and medical equipment and forcing hospital staff to scramble for temporary solutions.²⁷ Moving forward, hospitals can avoid these disruptions with a secondary water supply provided by a Net Zero Water system.

[Piedmont Atlanta Hospital](#) already deploys a campus wide wastewater reclamation and reuse system providing approximately 75 million gallons of water a year for non-potable demands. In the face of a water utility service disruption, Piedmont will be able to maintain resilient water access for its cooling towers and boiler systems.

3. REDUCE ONGOING COSTS

AVOID INCREASING WATER COST

Water and sewer rates have increased by [2.5 times](#) the Consumer Price Index over the last 20 years.²⁸ Developments equipped to reuse water use 10–30% of the potable water required by status quo developments. By reducing potable water demand, developments will have lower water bills over time. By reusing water that would otherwise go into the city's sewer or stormwater infrastructure, a project can reduce its burden on the potable water, wastewater and drainage utilities. That can justify considerably lower impact and connection fees to utility infrastructure. We'll go into more detail on these reduced fees in our FINANCIAL VEHICLES section.



4. GAIN MARKET ADVANTAGE & APPEAL TO CONSUMERS

PROMOTIONAL ASSET

Onsite water reuse systems can be a market differentiator with consumer appeal, as demonstrated by high-end apartments that offer prospective renters a [case of beer](#) brewed with reuse water captured onsite by [EpicCleantec](#).²⁹

EARN CREDIT WITH GREEN BUILDING CERTIFICATIONS

Net Zero Water helps set up developments for success with green building certifications including LEED, BREEAM, WELL, Living Building, and [others](#).³⁰ Many of these programs complement one another and have tangible benefits.

[CBRE analysis](#) of 20,000 US office buildings found on average a 31% higher rent among the LEED certified buildings vs. uncertified buildings.³¹

[Cushman & Wakefield](#) found LEED certified buildings' sales prices averaged 9.4% above non-certified sales.³²

COMMON MISCONCEPTIONS

Not everyone is sold on Net Zero Water yet due to some lingering myths and misconceptions. We've gathered them below and linked the toolkit sections that set the record straight.

"Too expensive." There are so many tools to help with capital investment, and in certain cases, water reuse is actually more cost effective than traditional builds. [GO TO FINANCING VEHICLES](#)

"I don't know which type of system works for my property." Learn how to conduct a water balance. [GO TO PLANNING](#)

"I have to do this all by myself." Utilities and regulators want reuse systems to succeed, and have built tools to make the process easier. [GO TO PERMITTING](#)

"People will think it's gross." 95% of Americans accept some use of recycled water. ³³ [GO TO WHY NET ZERO WATER](#)

"That's interesting, but I'm in a dense urban area with adequate water or an ex-urban area without water services." Water reuse can save costs and overcome development impediments in a range of contexts. [GO TO NET ZERO WATER IN MY BACKYARD](#)

"It will take up too much space on my site." Water treatment systems often occupy no more space than a few parking spaces. Storage cisterns for constant sources of water (condensate and wastewater) require minimal space, and rainwater cisterns may offset the total acreage required for stormwater detention. [GO TO NET ZERO WATER IN MY BACKYARD](#)

"You build it, then you're done." Water reuse systems require ongoing maintenance. Depending on the system, that can be provided by facility staff or third-party operators. [GO TO MAINTENANCE](#)

Next, let's talk about how to find the right onsite water reuse approach for your project.

PLANNING

For greatest success and ease of implementation, Net Zero Water planning needs to start at the earliest stages of development. The planning process is most successful when onsite water reuse is discussed early and consistently throughout the development process, involving the land attorney; design team; planners; architects; mechanical, electrical, and plumbing engineers; civil engineers; and landscape architects. While every project has unique specifications, requirements, and limits, the following guidance can serve as general best practice.

STEPS

1. WHAT ARE YOU BUILDING?

Identify all system water needs including drinking water, water for cooling, irrigation, laundry, cleaning, toilets, and kitchens. Who’s going to be using this water? What times of day? What days of the week?

2. WHAT WATER DO YOU HAVE?

Identify all sources of water entering the system. This can include rainwater, AC condensate, treated municipal water, stormwater, foundation drainage, and any other water sources, including a nearby reclaimed water system (purple pipe).

3. CONDUCT A WATER BALANCE

A water balance is a systematic analysis of the total water available and the total water demanded. Though there is not “one” answer to a water balance calculation, it will give you a sense of whether you have sufficient onsite water to meet all of the non-potable needs you would like to self-supply. It will also help you think through which options are most in line with your construction and ongoing maintenance budgets. Furthermore, it will be a key starting point in navigating the permitting pathway.

4. CONSIDER YOUR LOCAL CLIMATE

Certain types of onsite water will be more or less reliable based on local climate conditions. Rainfall patterns vary dramatically across Texas, as do AC condensate yields. Good Net Zero Water planning will take into account current and projected weather patterns and seasonal variability, and work to match the most prolific local water sources to the development’s water needs.

REGIONAL CLIMATE TOOLS


- [Rainfall by Region](#)– Statewide view into different regional precipitation levels
- [AC Condensate by Region](#)– broad guide matching temperature and humidity to potential condensate yield
- [Condensate Flow Calculator](#)
- [Detailed Weather within Texas](#): TexMesoNet-includes dew point, humidity, soil moisture levels
- [Water Risk Atlas](#)– Assesses an area’s water stress

SAME SYSTEM + DIFFERENT CLIMATES = DIFFERENT YIELDS

Research by The Meadows Center for Water and the Environment compared rainwater catchment and condensate catchment across the state and found wide variety in firm yields: The drier the area, the more square feet of catchment required to yield 30,000 gallons of rainwater.


RELIABLE RAINWATER HARVESTING

Firm yields (gallons per day reliable over the period of record) for 3,000 square feet of catchment and 30,000 gallons of storage. In most cases, larger yields can be attained with more catchment and storage.

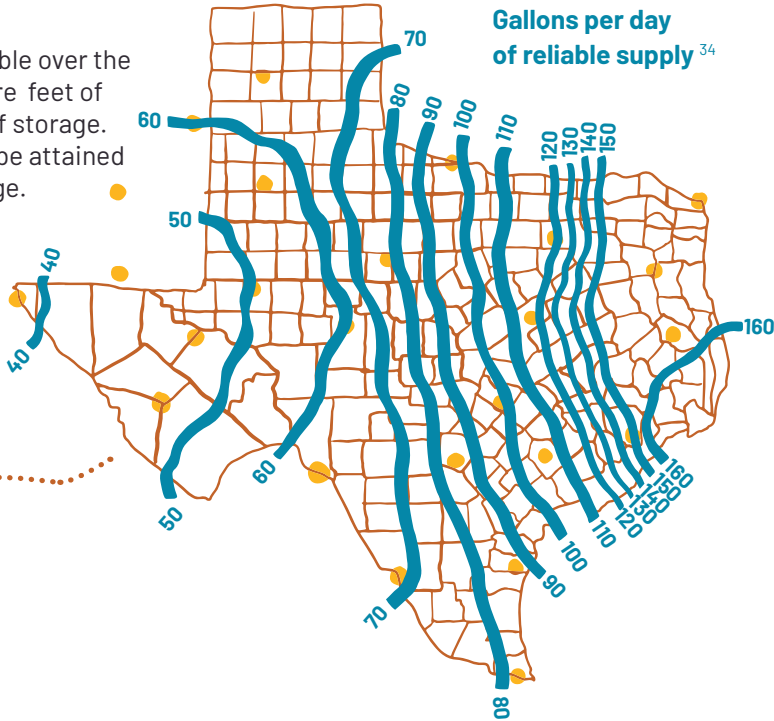


CONDENSATE HARVESTING POTENTIAL

Gallons per year per ton of air conditioning³⁵

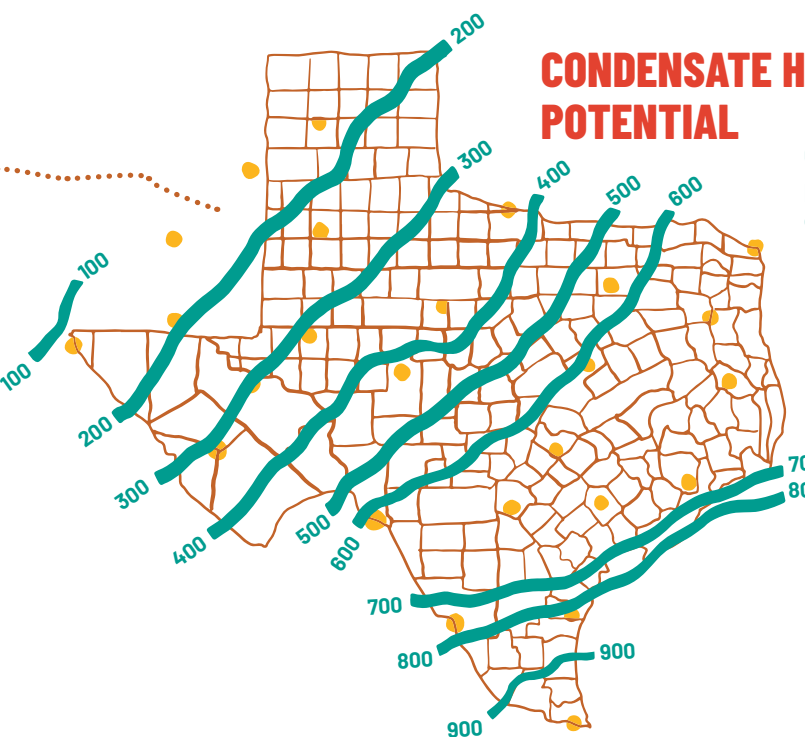


TOOLS FOR CALCULATING WATER BALANCE

- [CITY OF AUSTIN WATER BALANCE CALCULATOR](#)
- [BUILDING CALCULATORS CONDENSATE FLOW CALCULATOR](#)
- [EPA NATIONAL STORM CALCULATOR](#)

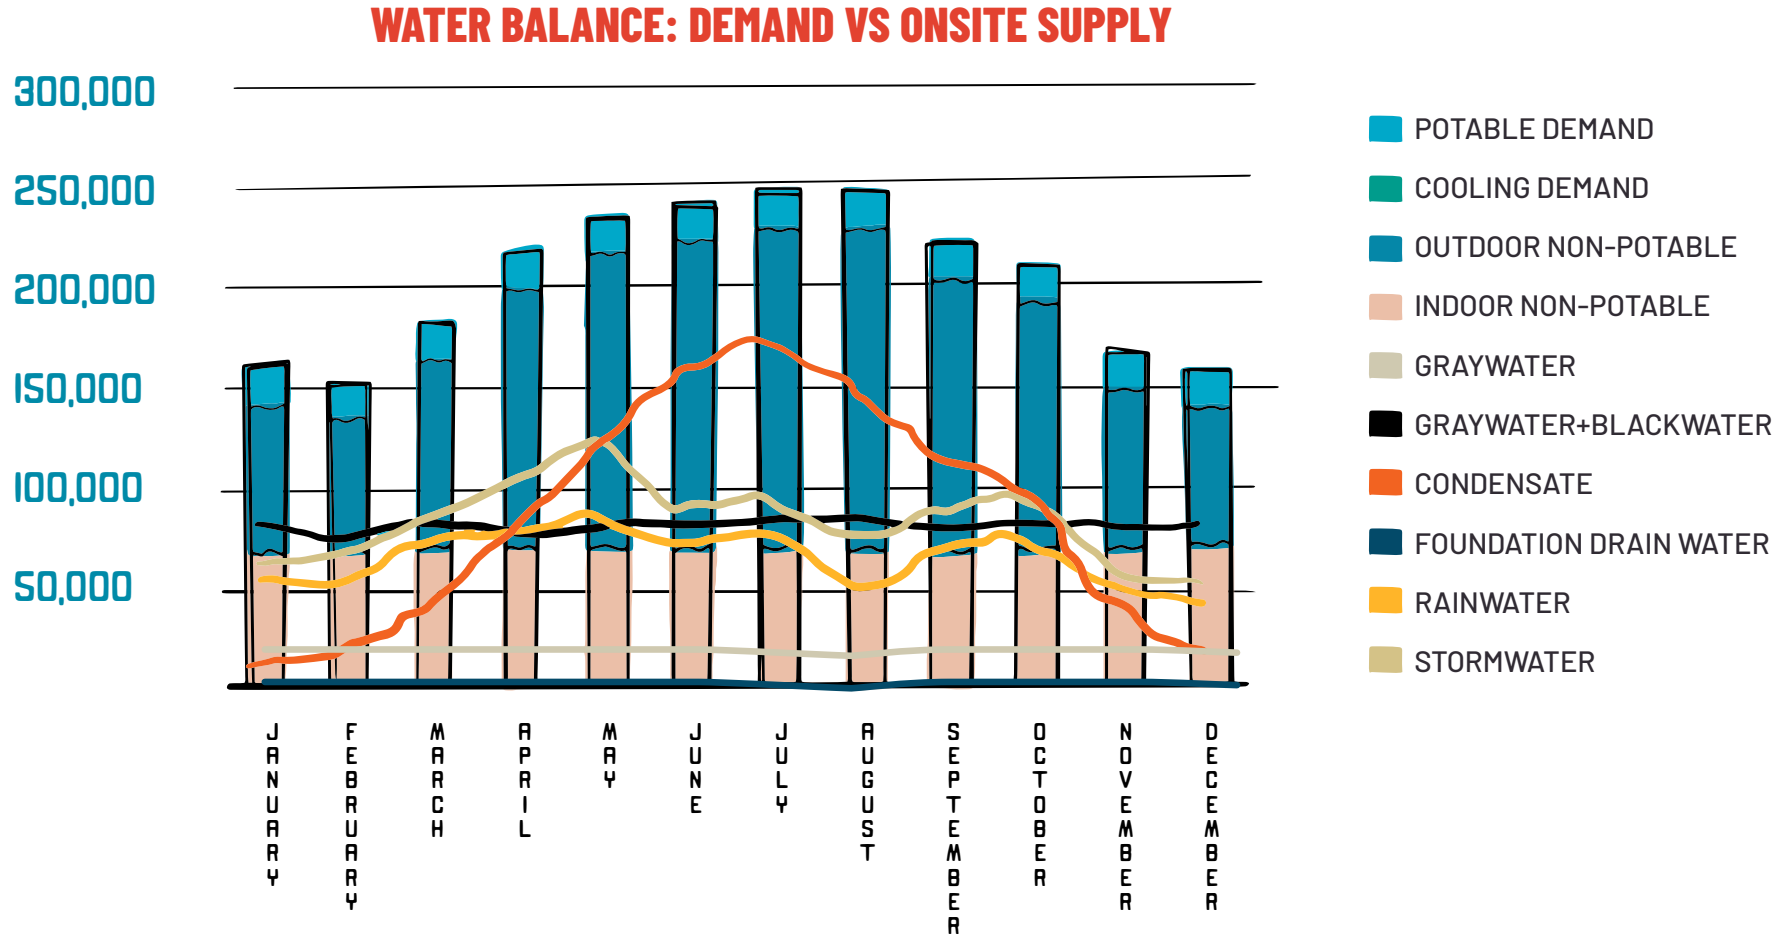

This tool visualizes demand and source variability over the seasons to ensure all water needs are adequately met. Example Water Balance Output using City of Austin Water Balance Calculator.

PROJECTED TEMPERATURES IN TEXAS³⁶

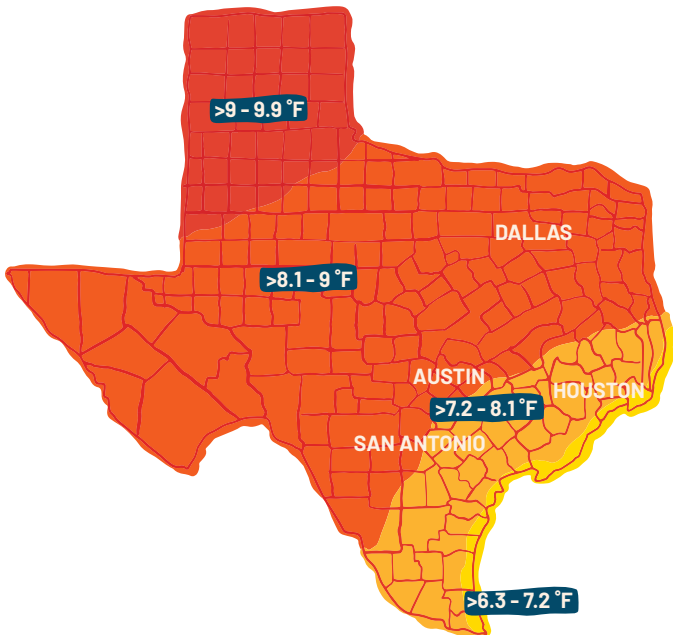

PROJECTED PRECIPITATION IN TEXAS



CLIMATE CHANGE

Due to changing precipitation patterns and increasing drought frequency, resilient onsite water reuse systems in arid zones should consider water sources beyond solely rainwater and stormwater. Given projected temperature and precipitation changes projected for Texas, water reuse planners should make sure to build a diversified water source portfolio.

S. MATCH DEVELOPMENT TYPE TO ONSITE WATER

Once you have an idea of how you would like to match onsite water with non-potable demands, it's time to find the water reuse system(s) best suited to your project.

While each project is unique, there are some general rules of thumb that can guide your planning.

- **HOTEL HIGH RISE**- Given frequent and consistent water use, hotels are a great fit for graywater collection for use in toilets, laundry, and irrigation.
- **MID RISE OFFICE**- Large catchment areas and outdoor common spaces make mid-rise offices a good fit for rainwater harvesting and AC condensate collection for irrigation use.
- **HIGH RISE APARTMENT**- Similar to high rise hotels, high rise apartment complexes are often a good fit for graywater collection for toilet, laundry, and irrigation use.

QUESTIONS FOR POTENTIAL VENDORS:

When interviewing vendors or considering technology options, leverage third party reviews, historical case studies, and technology-specific questions to figure out which is a good fit for your project. Potential vendors should be able to produce a Statement of Qualifications with a list of water reuse installations to determine if the vendor has experience with the development's preferred water reuse approach. The William J. Worthen Foundation's Onsite Non-Potable Reuse Practice Guide recommends asking vendors for the following information:

- **Wastewater treatment process description and quality of treated water produced**
- **Integrated monitoring and controls system description**
- **Energy usage for technology provided (kWh/1,000 gallons produced)**
- **Anticipated annual maintenance cost, including asset replacements**
- **Footprint required for technology**

GENERAL PLANNING GUIDANCE:

- Bioreactor systems need to be fed due to biotic nature. These systems do better with consistent use.
- Plan the distribution network to optimize efficiency in the delivery of treated water to end points, using gravity instead of pumps where applicable.
- AC condensate recovery is generally viable economically in buildings larger than 100,000 sq-ft, based on San Antonio climate and water pricing.³⁷
- To plan in a technically supportive way, go beyond the minimums of what a zoning permit demands. Plan for maximums of production and demand, not just likely estimates.

- **MIXED USE**- Similar to mid-rise offices, mixed use buildings can be a good fit for rainwater harvesting and AC condensate collection for irrigation use.
- **SINGLE FAMILY SUBDIVISION**- Irrigation on common elements and residential landscapes present an attractive alternative to the expense of traditional land application wastewater discharge and direct discharge permits.

6. DECISION MAKING GUIDE: WHAT'S YOUR BUDGET?

- Pick the system that works for your budget and your development's water needs. The more complex the water treatment required, the more costly the system.
- Time is money: pick the system whose estimated permitting timeline works for your construction timeline.
- Pick the system with the level of complexity that works for your team.

Furthermore, the following information should be gathered for treatment technology under consideration:

- **Designed treatment capacity (e.g., 15,000 gal/day)**
- **Reuse applications (e.g., toilet flushing and irrigation)**
- **Years projects were commissioned**
- **Third-party laboratory data from installations where the treated water performance requirements have been met or exceeded**
- **References for projects listed**
- **Standard terms and conditions of sale**


The City of Austin has compiled this list of [Onsite Water Reuse System Designers, Builders, and O&M Vendors](#)

- Ensure reliability through incorporating redundancy in system designs. This may involve duplicating critical components or systems.
- Minimize disruptions by establishing backup measures in case of system failures.
- Plan to site the onsite water reuse system in a space with climate control to create a more hospitable operator workplace.
- The replacement frequency and warranty on the membranes should be considered for estimating operating and maintenance costs and requirements.

Once the Net Zero Water plan is ready, it will become a key to identifying the financial tools available to implement the project.

FINANCING VEHICLES

Despite all the benefits that onsite water reuse systems create, there are relatively few projects online in Texas. One of the primary reasons is upfront construction cost, often borne by developers whose ownership of the site may end within a few years of project delivery.

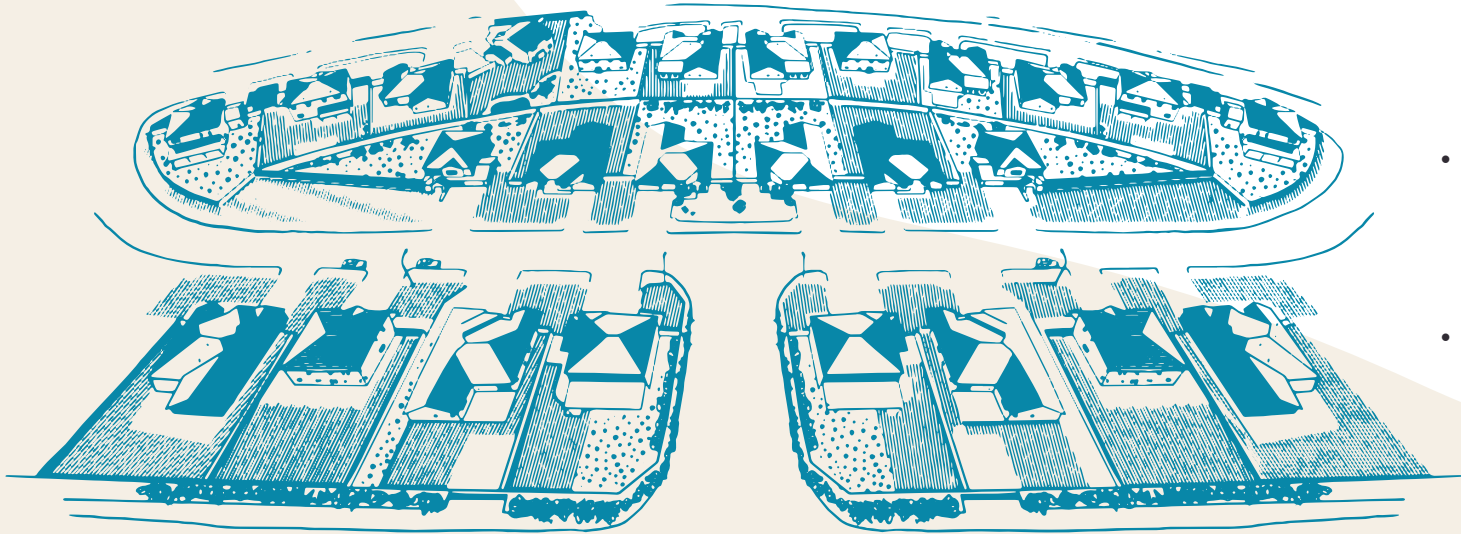

2. PUBLIC IMPROVEMENT DISTRICTS –PIDs

- While far less common than MUDs, PIDs have been used to great extent in certain areas of the state, especially the [DFW](#) area.³⁸ In general, the use of PIDs is increasing across the state due to their ability to provide a win/win/win for jurisdictions/developers/property owners. PIDs allow developers to finance at an affordable cost of capital community amenities like landscaping and parks, along with basic infrastructure like roads and water systems.
 - Because PIDs can be established by cities and counties to enable public improvements within a specified boundary, PIDs can be used to finance water reuse infrastructure in a wide array of scenarios—from dense urban areas within a water utility's boundaries to unincorporated areas with no existing (waste)water services or service provider.
 - In PID financing, public improvements are funded through revenue generated by assessments levied on the property supporting bonds sold by the sponsoring entity, which can be a city or county. The bonds sold are non-recourse revenue bonds, so the sponsoring entity bears no responsibility for repaying bond investors if the PID fails to generate the revenues from the assessments needed to repay the debt.³⁹
 - PIDs must finance public improvements, so the water infrastructure they support must be publicly owned, though private water operators can manage the systems. The water infrastructure a PID finances could be owned by a Special Utility District created for that purpose, a MUD, a city, county or public utility. This makes it an interesting vehicle for financing water reuse infrastructure in multiple scenarios:
1. **In the case of a greenfield residential development within a utility service territory but beyond the reach of its existing wastewater lines, a developer could petition for a PID to be created by the county to finance development of a package plant for wastewater reclamation. Reclaimed wastewater is disposed of on landscaping throughout the community, thereby reducing the cost for irrigation water and the size of potable water lines required to serve the development. Beyond the**

SUBURBAN AND EXURBAN GROWTH

I. MUNICIPALITY UTILITY DISTRICTS –MUDs

- MUDs enable the financing, construction and maintenance of infrastructure in areas that are not served by local governments. Water and wastewater infrastructure is routinely funded by MUDs created specifically for the planned community. MUD bonds are repaid with taxes paid by MUD customers (typically homeowners).
 - While MUD financing typically funds traditional water and wastewater services, there is no statutory impediment to using MUDs to fund water reuse infrastructure, including treatment, storage and conveyance systems.
 - At least one MUD in Texas has funded extensive water reuse infrastructure. Due to prohibitions against discharging treated wastewater into Austin's Highland Lakes, Lakeway MUD has been reclaiming wastewater for beneficial reuse since its inception in 1972. For more than two decades, Lakeway MUD has been treating its reclaimed wastewater to TCEQ's Type 1 standard, safe for unrestricted dispersal across Lakeway. Reclaimed water is sold to customers including the City of Lakeway, commercial and 7 residential customers
- savings created by obviating a wastewater line or land disposal field, the PID's assessment obligations could be offset by reduced or negated impact fees that would otherwise be assessed to provide water and wastewater services of typical capacity.
2. **A multi use greenfield master planned community would have more end uses to satisfy with reuse water, and could use a PID to finance water reuse infrastructure for indoor commercial uses as well as community-wide irrigation.**
 3. **Unincorporated areas without water services could similarly use PIDs to finance low-intensity groundwater development for potable needs, supplemented by reclaimed water for non-potable demands.**
- PID financing allows private developers to finance the cost of new infrastructure at tax-exempt municipal bond interest rates instead of cost-prohibitive mezzanine capital rates. This can lower the cost of capital by 10% or more, creating savings that can go into enhanced amenities. In addition, PID bonds are long-term in nature (typically 30 years), spreading infrastructure costs over the typical useful life of the improvements.
 - PID bonds are repaid through assessments or other pledged revenues such as tax increment, fees and parking. PID assessments are collected by the sponsoring taxing authority as part of the annual property tax process. PID assessments are collected on top of county or city tax bills, creating a higher effective tax rate for the district benefiting from the financing. This additional tax burden may be justified and even offset by the reduced relative cost of delivering water services.
 - So far, there are no examples of PIDs that have financed water reuse infrastructure in Texas, but PIDs could be used for this purpose. For counties with limited regulatory tools, PIDs create a powerful incentive to drive improved water management.




2. DESIGN BUILD OPERATE FINANCE –DBOF

- DBOF models allow the project developer to benefit from water reuse while avoiding the upfront soft costs and construction costs or the ongoing maintenance responsibility. In the DBOF model, a developer contracts with a team for the design, construction, long-term operations and maintenance, and financing of a project. The arrangement may encompass either the entire project where the fees paid to the DBOF team cover all construction costs, or a long-term financing structure where the financing costs are repaid over the contract period for long-term operations.
- Large corporate customers have used DBOF tools to build Net Zero Water campuses. [Microsoft's Silicon Valley](#) campus incorporates water reuse for indoor and outdoor non-potable uses, harnessing blackwater and other onsite waters to ensure 100% of the site's non-potable water comes from onsite recycled sources. The campus saves approximately 4.3 million gallons of potable water each year.⁴¹
- DBOF arrangements give project sponsors the chance to annualize the cost of their water reuse system rather than swallowing the whole construction cost upfront. Typically, the costs eligible to be paid annually are the treatment system design, buildout and maintenance. Relevant facilities such as irrigation or internal piping would be the responsibility of the building owner. Besides the obvious benefit of externalizing the treatment system cost to the third party, DBOF models also allow the property owner to shed performance risk.

I. WATER CONTROL AND IMPROVEMENT DISTRICTS –WCIDs

- Water Control and Improvement Districts are special purpose districts that are created to purchase, construct, and maintain water, wastewater and drainage infrastructure within its boundaries. WCIDs are often created in areas where municipal services may not be readily available.
- WCIDs have the authority to issue bonds to finance infrastructure projects such as constructing water treatment plants, managing drainage systems, and building water reuse systems. They are governed by an elected board of directors who are responsible for making decisions regarding the operation, maintenance, and expansion of the district's water and wastewater services.
- WCIDs [operate across the state](#)⁴⁰ and differ from MUDs. While both MUDs and WCIDs can incur debts and levy taxes, MUDs can only finance the construction of non-existent water facilities, while WCIDs have the authority to purchase existing water facilities.

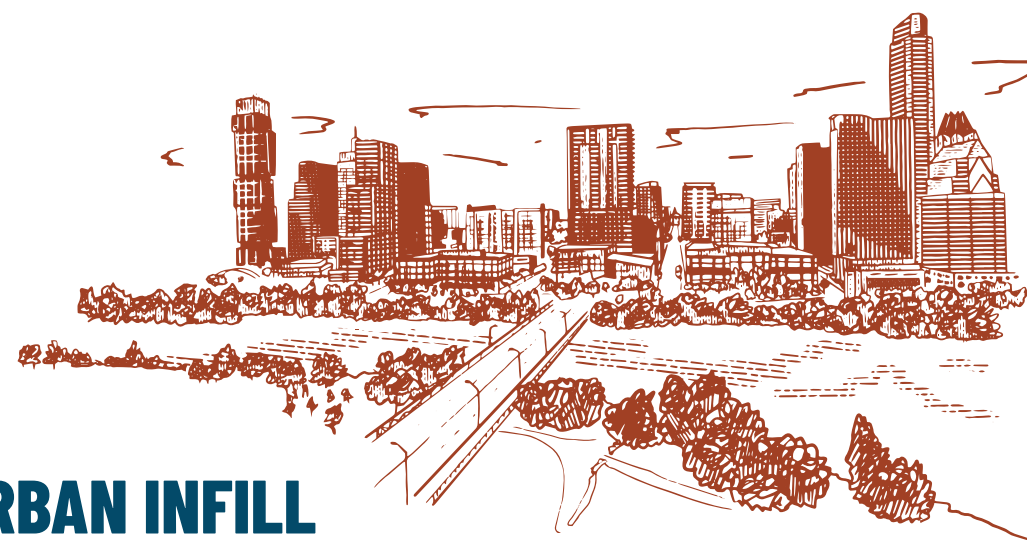

I. URBAN INFILL

UTILITY INCENTIVES

REDUCED IMPACT OR METER FEES

- The cost of extending water services to new developments is rising. Water utilities can incentivize the cost of onsite reuse by scaling down or waiving fees typically associated with potable water services. Austin Water is introducing this sort of fee reduction program: new Austin development that taps into onsite reuse for non-potable needs will not pay a monthly meter fee for their non-potable capacity. Austin Water estimates up to a \$122,000 reduction in these monthly fees over a 30 year period for some developments.
- Impact or connection fees are on the rise as well, driven by the rising cost of water services. Given the benefit onsite water reuse systems provide to utilities through their limiting of potable demand and wastewater load, utilities can offer reduced connection fees in recognition of this fact. Austin Water's studies have found onsite water reuse systems can save developments up to \$392,000 in these upfront fees. San Antonio Water Utility charges no impact or connection fees for recycled water other than the monthly meter charge.⁴²

- Accountability mechanisms ensure that developments receiving these incentives actually generate the water reuse potential the incentives are designed to enable. Utilities can use volumetric pricing triggers to this effect.
- [The Austin Water Metering Fee Tool](#) calculates potential savings from reuse.

COST SHARE FOR RECLAIMED WATER PIPELINE EXTENSION (PURPLE PIPE)

- Utilities can also share the cost of extending reclaimed water pipelines to serve customers beyond the system's. In the case of an interested project a mile away from the system, the utility can bond finance the extension of the purple pipe several years before schedule, as long as the project that will benefit from the extension agrees to refund their proportional capacity in the new extension through a temporary surcharge on their water bill.
- The customer and utility both benefit by cost-sharing the purple pipe, while the customer realizes the savings of a substantially reduced potable water bill in perpetuity.

2. CITY INCENTIVES

- Cities have an even broader set of tools for incentivizing water reuse. For instance, the higher construction cost for a dual-plumbed building could be netted out with a density bonus, increasing the marketable square footage.
- Other available incentives may reward other benefits afforded for onsite water reuse. For example, a development designed to reuse stormwater does not need the same detention capacity as a development only utilizing passive infiltration. See the Brodie Oaks case study in [NET ZERO WATER IN MY BACKYARD](#).

3. TAX INCREMENT REINVESTMENT ZONES –TIRZs

- A TIRZ helps attract new investment in an area and finance the costs of redevelopment, allowing developers to pay for infrastructure in the short term by pledging a portion of the future additional tax revenues that the infrastructure will facilitate. As opposed to traditional infrastructure funding, TIRZ infrastructure is not funded by ad valorem taxes recouped across the city's entire taxable district, but rather from the specific area where the funds are put to work.
- Since TIRZs are frequently used to fund district-scale infrastructure, they are an interesting tool for building out water reuse infrastructure. A TIRZ allows for a new area to connect to a utility's reclaimed water service, or even for the construction of district-scale storage, treatment and distribution systems.
- The Waller Creek TIRZ is one example of such a vehicle that funded significant water management infrastructure to enable development. The TIRZ was created around an urban creek in downtown Austin that was subject to continual flooding, preventing development. The TIRZ funded the construction of the Waller Creek Tunnel, which significantly expanded stormwater storage capacity during high rainfall events. While stormwater reuse was not part of the district infrastructure design, this example illustrates how TIRZs have already played a successful role in solving water-related challenges to development.

4. CHEAPER ALTERNATIVES TO MEZZANINE CAPITAL: PACE AND LOANSTAR

- Property Assessed Clean Energy (PACE) financing was enabled by the Texas Legislature in 2013 to overcome the high upfront cost of energy efficiency and water conservation investments. Since then, more than \$469 million has been mobilized for energy and water efficiency PACE projects in Texas.
- The core strength of PACE financing is that it allows property owners to invest in energy and water improvements with little to none of their own upfront capital. PACE is essentially long-term financing covering up to 100 percent of the cost of allowed projects and can be used for a term as long as the projected useful life of the improvements, typically 20 years. This results in utility cost savings that exceed the amount of the repayment—meaning that PACE programs help property owners save more than they spend to implement energy and water projects.
- The loan is repaid overtime through the assessment district. If the property sells before the loan is defeased, the remaining loan amount is conveyed to the next owner via the lien securing the assessment.
- LoanSTAR is the PACE equivalent for projects sponsored by political subdivisions, and is administered by the State Comptroller's Office.
- A study Texas Water Trade performed in 2021 showed that water reuse projects can qualify for the stringent cash flow positive requirements of PACE, but typically only if co-financed with energy efficiency measures. For new builds, this co-financing allows project developers to bundle a significant proportion of construction costs into the PACE loan at considerably lower cost than developers' mezzanine capital.⁴³

5. SCHOOL AND SPECIAL PURPOSE BONDS

- School, revenue and tax district bonds used to finance facilities like airports and hospitals can finance water reuse infrastructure. These bonds also can be paired with utility incentives to defray the costs of reuse capacity construction.
- Existing public school campuses are eligible for using LoanSTAR funding from the Comptroller's Office for retrofits.

6. TEXAS WATER FUND PROGRAMS


- In 2023, the 88th Texas Legislature passed Senate Bill 28 and Senate Joint Resolution 75 providing for the creation of the Texas Water Fund and the one time appropriation of \$1 billion to support the Texas Water Fund. The Fund is managed by the Texas Water Development Board (TWDB).
- Within the Fund are six different programs⁴⁴ that provide low-cost financial assistance for water infrastructure projects, including water reuse projects.
- Eligible applicants include special purpose districts– MUDs, PIDs, WCIDs, TIRZs, and others– as well as private entities and public-private partnerships.

Identifying and leveraging all relevant financial tools is key for a successful Net Zero Water implementation. The next section will outline the steps of an equally critical process–permitting.

PERMITTING

One of the biggest challenges developers face in implementing Net Zero Water is understanding how to navigate the permitting process. The source of reuse water and location of the project are the primary factors that will influence which regulatory entities need to be involved in the permitting process. To help demystify this process, we created a permitting roadmap to help identify which permits and authorities a project might need to work with for approvals. Before beginning to look at permitting requirements, projects should first conduct their project water balance. Since the regulatory environment changes frequently, always check with the relevant authorities for current permitting rules.

PERMITTING PT 1: STATE LEVEL

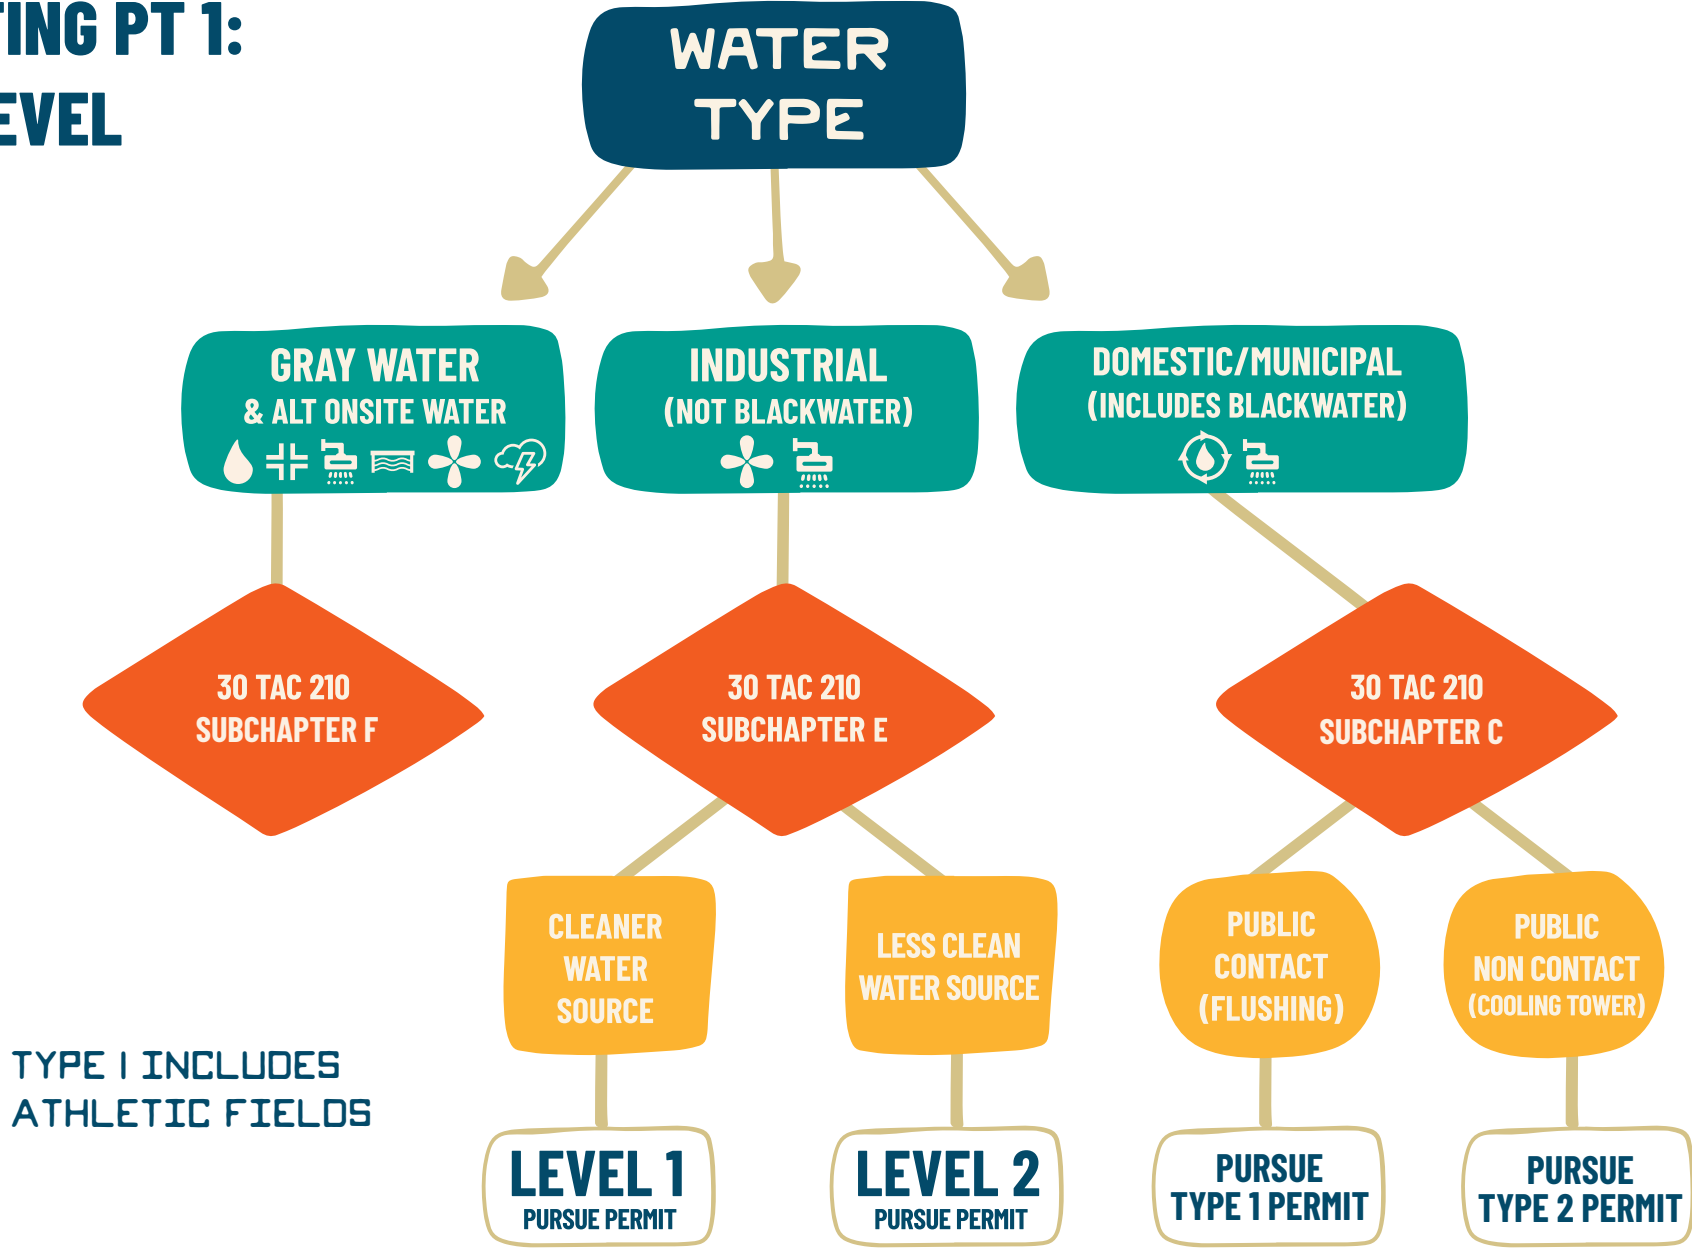

LEGEND

WATER SOURCES


- RAIN WATER
- STORMWATER
- CENTRALIZED PURPLE PIPE
- CONDENSATE
- BLACKWATER
- FOUNDATION
- GRAYWATER

WATER USES

- TOILETS
- LAUNDRY
- IRRIGATION
- COOLING TOWERS
- FIRE PROTECTION
- CONSTRUCTION DUST CONTROL

PERMITTING PT 2: LOCAL LEVEL

Local jurisdictions might not all have permitting requirements, but they may have ordinances or rules that impact how onsite water reuse systems should be implemented. For instance, the Highland Lakes Watershed Ordinances prohibits any wastewater discharge into the Highland Lakes, which led the Lakeway Municipal Utility District to turn to centralized water reuse. Another example is Austin Water, which has more stringent requirements for onsite water reuse design than many other Texas jurisdictions.

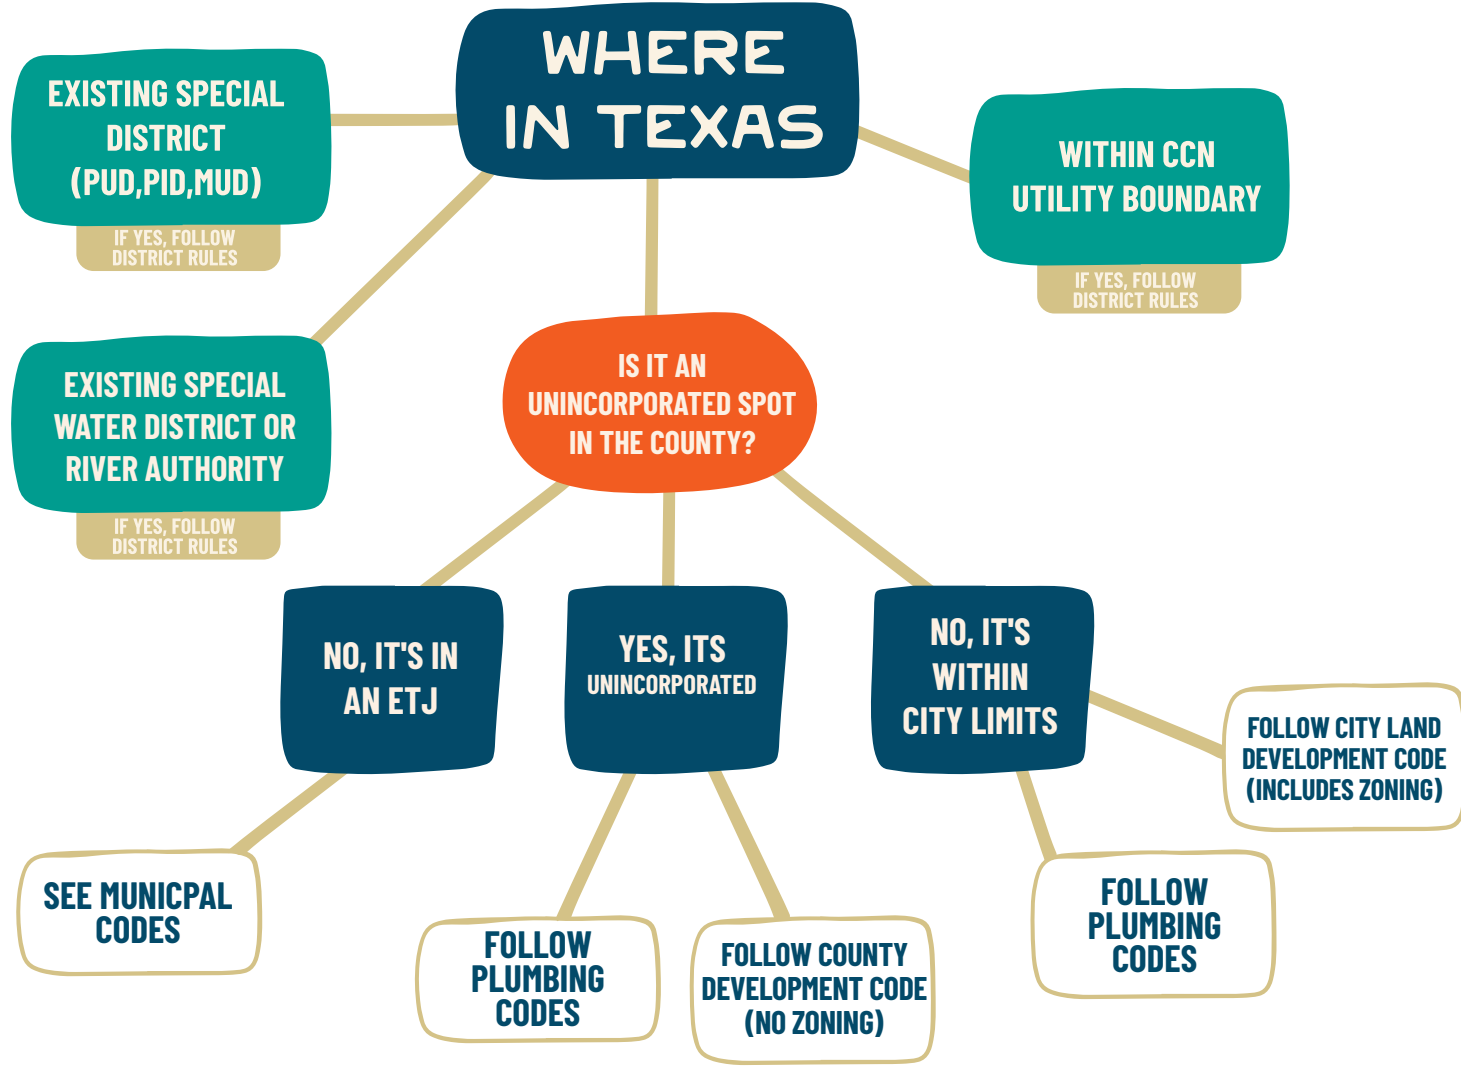

ADDITIONAL CONSIDERATIONS -IPC/UPC

Texas has adopted both the International Plumbing Code (IPC) and the Universal Plumbing Code (UPC). Some cities have adopted one or the other with their own amendments, but many counties have not made such determinations. As such, plumbing contractors in those areas can comply with one or the other.

On the whole, UPC is generally more comprehensive & detailed than IPC. There are multiple minor differences between the codes on onsite reuse, most of them likely out of omission rather than contradiction.

Some of the major differences include:

- Differing signage requirements (visual differences).
- UPC provides requirements & detailed Standard of Operation (S00) for cross-connection testing (required every four years); IPC prohibits cross-connection, but doesn't mention specific testing requirements.
- IPC specifically prohibits blackwater sources for onsite systems, while UPC does not specify sources.
- UPC provides a section for untreated graywater systems serving subsurface irrigation; IPC does not.

- UPC requires the non-potable reuse equipment to meet the NSF 350 standard, or otherwise approved by Authority Having Jurisdiction (AHJ); IPC does not mention this.
- IPC specifies that untreated graywater cannot be retained longer than 24 hours; UPC does not mention this.
- Major similarities (not comprehensive):
- Both mention NSF 350 as the standard for water quality & system testing, but defer to the AHJ Public Health for water quality requirements for each specific end use.
- Both mention filtration not greater than 100 microns.

FUN FACT

HOAs legally cannot prohibit rainwater capture.

REGULATORY UPDATES: SENATE BILL 1289

In 2023, the Texas Legislature passed Senate Bill 1289, easing the permitting pathway for onsite water reuse systems. Before TCEQ completes the rulemaking, TCEQ will review projects on a case by case basis. [SB 1289](#) lets certain projects skip a special permit for disposing of treated wastewater if they meet these conditions: they use public wastewater systems and get approval from the receiving system and any system treating the water further. If a reclaimed water facility meets these rules, it doesn't have to own a linked wastewater facility, but the entity is still required to have an alternate means of disposal.

REGULATORY RESOURCES

Looking down the barrel of increased future demand and decreased future supply, water planners and utilities have started planning to augment their water supplies through onsite water reuse systems. Not only do they provide incentives for onsite water reuse investment, but they also provide resources to make planning and permitting more efficient.

TCEQ PERMITTING RESOURCES

- [TCEQ Requirements for Reclaimed Water, by water type](#)
- State Regulation on Use of Reclaimed Water: [30 TAC 210](#)
- [Past TCEQ Approved permits](#)
- [Beneficial Reuse Credit for Wastewater Facilities](#)

FAQS/GUIDES

- [TCEQ: Graywater and Alternative Onsite Water: A Guide for Industrial, Commercial, and Institutional users](#)
- [Austin Onsite Water Reuse Systems\(OWRS\) Program Guidebook-pg 9 has step by step](#)
- [Blue Ribbon Commission's Onsite Non-Potable Water System Guidance Manual](#)
- [TWDB: Water Reuse FAQ](#)
- [El Paso Water's Reclaimed Water Forms](#)
- [San Antonio Water System's Recycled Water User Handbook- Chapter 3](#)

CONTACTS

Texas Water Development [Board Conservation & Innovative Water Technologies](#) facilitates the state's conservation and alternative water supply implementation, including water reuse

[TCEQ Water Quality Division](#), responsible for issuing permits for blackwater reuse

[Austin Water Onsite Water Reuse Program](#) Oversees review, approval, and ongoing operation of Onsite Water Reuse Systems.

Once everything is permitted, it's time to build!



INSTALLATION, OPERATION & MAINTENANCE

Net Zero Water system installation will vary from project to project, but every Net Zero Water installation should build in the following components:

COLLECTION SYSTEM

To collect source water and transport it to pre-treatment storage.

TREATMENT SYSTEM

Such as filters, UV sterilization, and chemical disinfection.

DISTRIBUTION NETWORK

To deliver treated water to intended end uses through color-coded purple pipes.

OPERATION AND MAINTENANCE

Once established and running, onsite water reuse systems require regular, skilled maintenance to ensure the health of the public and proper function of the systems. A successful Net Zero Water project will have an operations plan, trained operators, regular record keeping, and consistent community engagement.

OPERATIONS PLAN

- A successful operations plan will outline the required personnel, training, funds, information, infrastructure, and timing required to keep things running smoothly. The National Blue Ribbon Commission's [Onsite Non-Potable Water System Guidance Manual](#) provides a great template for building a new plan on page 72.
- [Alternate Water Source System O&M Manual Template](#) includes info on equipment repair, replacement, frequency for different maintenance activities, compliance reporting, and health and safety info.

ROLE OF LICENSED AND CERTIFIED OPERATORS

Operators will put the operations plan into effect, monitoring water quality, sending mandatory reporting, and checking for any repairs. However, not every water reuse system monitor needs to be a licensed wastewater operator. Operator training and licensure depends on the water reuse system at play:

NON-BLACKWATER SYSTEMS

Non-blackwater systems do not require any specific certification by TCEQ. However, Austin Water is developing an optional training manual and certification exam for non-blackwater systems for release in 2025 to ensure operators have the knowledge they need. Whether or not a certified operator is required in your area, you should ensure proper training of facilities managers or retain a certified third-party operator.

The onsite water systems at Austin's main library is managed by facilities staff. Lee Butler, Building Services Manager with Austin Public Libraries, describes his experience with Austin Central Library's onsite water reuse maintenance schedule: "The mechanics of a rainwater and A/C condensation collection system are fairly simple. Glad we did it." ⁴⁵

BLACKWATER SYSTEMS

Blackwater systems require a licensed operator for maintenance.

TCEQ's guide to different license requirements by project types can be found [here](#).




FINDING OPERATORS

A growing number of companies serve as third-party operators for onsite water systems. Some of them will also design, build and finance systems (see the Financing section on DBOF models). Once you have undertaken a Water Balance and know what types of water reuse sources and end uses you may pursue, you may opt to explore which operators in your region are right for your project. Onsite water reuse service companies will provide free consultations and offer operational best practices and history without commitment. Said one VP of Operations: “I don’t know why people are so afraid to talk to us—we’re giving free answers.”

As with vendor selection for treatment technology, the choice of a third-party operator should be informed by questions and conversations with property owners provided as references.

QUESTIONS FOR POTENTIAL OPERATORS:

- Anticipated annual contract payment
- A list of similar projects they operate in Texas and beyond
- Lessons learned from similar projects
- Project design recommendations to ensure long-term performance

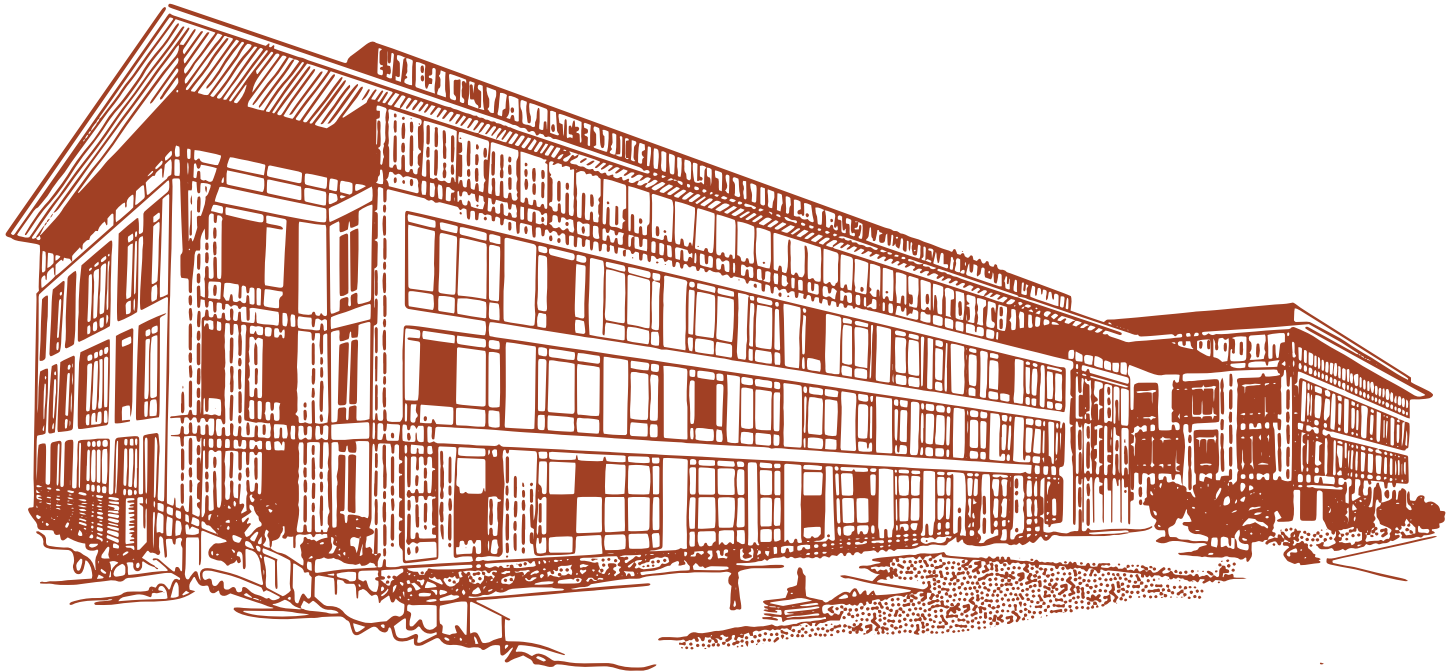

COMMISSIONING

Monitoring the onsite water reuse system around installation and in the days and weeks immediately after is critical to help debug any unforeseen developments. The system adjustments and maintenance required for onsite water reuse systems depend on both the source water type and the planned end use for the treated water.

INSTALLATION LESSONS: AUSTIN PERMITTING AND DEVELOPMENT CENTER

- Austin Water is the state’s leading utility in the field of onsite water management. To better understand the maintenance requirements for onsite water, the utility assumed management of water treatment at the city’s new Permitting and Development Center.
- OSCAR–Austin’s On-site Collection and Reuse is the site’s rainwater harvesting and air-conditioning condensate collection system. Shortly after installation, OSCAR’s tank would get low, and the automated valve would trigger the backup supply and fill up the tank. Then when it rained the tank would overflow. The team recalibrated the valve’s fill level to avoid future overflow.
- CLARA– Austin’s Closed-loop Advanced Reclaimed Assembly is the on-site blackwater reuse system. The system was installed during the COVID-19 pandemic, so the equipment sat unused for longer than the team would have wanted. Furthermore, after start-up, the system compressor went out and supply chain complications made replacement a longer process than anticipated.⁴⁶

INSTALLATION LESSONS: THE LOWER COLORADO RIVER AUTHORITY’S REDBUD CENTER, AUSTIN

After installing a non-potable onsite water reuse system with captured rainwater, LCRA noticed that the tannins from surrounding Live Oak trees were impacting water appearance and chemical makeup.

LCRA shifted the use of the captured rainwater to outside irrigation only.⁴⁷

These examples generously shared by Austin Water and the Lower Colorado River Authority demonstrate the hiccups that might be expected during the commissioning process.



Maintenance at Austin Central Library

“Maintenance activities typically involve filter replacements, inspections for leaks and pump testing and repairs. To facilitate maintenance and ensure continuous system functionality, the onsite water reuse system is connected to the overall Building Management System (a computer based control system installed in buildings that controls and monitors the building’s mechanical and electrical equipment) which allows the building maintenance staff to remotely monitor system components, easily locate and diagnose issues, and receive automatic alerts for any system malfunction.”–Austin Central Library

In addition to regular maintenance, keeping track of the system’s health is key in order to meet mandatory reporting requirements (where relevant) and to be able to build trust with stakeholders and end-users.

REGULAR INSPECTIONS

The project’s operations plan should outline the timing required for periodic inspection of the entire system for leaks, blockages, or other issues.

REPORTING

Ensure compliance with any reporting requirements to local authorities.

RECORD KEEPING

Successful projects will keep detailed records of system installation, maintenance activities, water quality tests, and any upgrades or modifications.

USER COMMUNICATIONS

Fixed signage informing building users of the use of onsite non-potable water is just one component of user communication. If site occupancy includes long-term users (such as office workers, residents or retail renters), periodic communications on best practices and the savings they have enabled are also important.

For example, the integrity of graywater systems will depend to some degree on user behaviors (dumping chemicals down bathroom sinks, for example, may affect the performance of the treatment system), so users need to know what can and cannot be disposed of down sinks. This will have an impact on the integrity of the onsite treatment system.

Building occupants can share a sense of water stewardship by understanding how much water they have saved over time as users of onsite water systems. An annual report to building occupants on the savings they have enabled can help them feel shared ownership over system success– and perhaps inspire longer occupancy and lower turnover for property managers.

Through intentional planning, regular monitoring, and standard maintenance, onsite water systems will provide safe, reliable water for years to come.

CONCLUSION

There’s no “one way” to implement onsite water reuse. Net Zero Water case studies across Texas and beyond demonstrate how water reuse projects can adapt to meet budgetary, jurisdictional, climatic, and developmental demands.

Onsite water reuse is not a fad but a much-needed supply resource. Across Texas, there are signs that our water demand has already begun to outstrip our available supply, so tapping into onsite water constitutes a crucial tool for closing the gap. With the state projecting another 63% increase in municipal water demand alone over the next 50 years, the prosperity of Texas depends on the widespread adoption of a new approach to water management.⁴⁸

While some communities may choose to mandate onsite water reuse, most will need to find ways of easing the path to water reuse by the private sector. Developers have the opportunity to demonstrate what onsite water can enable, from enhanced water conservation to greater profitability.

With onsite water reuse, growth can help Texas grow its water supplies–a win for developers and for Texas.

TOOLS AND REFERENCES

TOOLS

- [NSF's Water Reuse Systems Standards](#)
- [City of Austin Water Balance Calculator](#)
- [Building Calculators Condensate Flow Calculator](#)
- [EPA Non-Potable Environmental and Economic Water Reuse \(NEWRE\) Calculator](#)
- [EPA National Stormwater Calculator](#)
- [Rainfall by Region- Statewide view into different regional precipitation levels](#)
- [AC Condensate by Region- broad guide matching temperature and humidity to potential condensate yield](#)
- [Detailed Weather within Texas: TexMesoNet-includes dew point, humidity, soil moisture levels](#)
- [Water Risk Atlas-Assesses an area's water stress](#)
- [LCRA: Commercial, Institutional and Industrial Rebates](#)
- [LCRA: Firm Water Conservation Cost-Share Program](#)
- [City of Austin's Onsite Water Reuse System Designers, Builders, and O&M Vendors](#)
- [2021 IPC](#)
- [2021 UPC \(Ch 13\)](#)
- [Texas Water Development Board Conservation & Innovative Water Technologies, facilitates the state's conservation and alternative water supply implementation, including water](#)
- [TCEQ Water Quality Division, responsible for issuing permits for blackwater reuse](#)
- [Austin Water Onsite Water Reuse Program Oversees review, approval, and ongoing operation of Onsite Water Reuse Systems](#)
- [Austin Water Incentives for Onsite Water Reuse Systems, page 35 in the Onsite Water Reuse Systems Guidebook](#)
- [TCEQ: Occupational Licenses: Wastewater Treatment Plant and Collection System Operators](#)

GUIDES


- [William J Worthen Foundation's ONSITE NON-POTABLE WATER REUSE PRACTICE GUIDE](#)
- [San Francisco Utility's Onsite Water Reuse Program Guidebook](#)
- [Austin Water's Onsite Water Reuse Program Guidebook](#)
- [San Antonio Water System's Recycled Water User Handbook](#)
- [WaterReuse Association's Guide to Water Reuse Treatments](#)
- [TCEQ Requirements for Reclaimed Water](#)
- [TCEQ Beneficial Reuse Credit for Wastewater Facilities](#)
- [TCEQ: Graywater and Alternative Onsite Water: A Guide for Industrial, Commercial, and Institutional users](#)
- [Blue Ribbon Commission's Onsite Non-Potable Water System Guidance Manual](#)
- [San Francisco Water Systems' Alternate Water Source System O&M Manual Template](#)
- [San Francisco Water Systems' Onsite Water Recycling: An Innovative Approach to Solving an Old Problem](#)

USE CASES:

- [Austin Central Library Operations and Management Case Study](#)
- [Brodie Oaks Climate Background](#)
- [One Water in Action: Credit Human's Light, Beautiful Footprint on San Antonio's Pearl District](#)
- [Toyota's new headquarters plants roots in Plano](#)
- [One Water in action: Austin Central Library uses rainwater to flush toilets](#)
- [Lakeway Municipal Utility District Water Conservation Plan](#)
- [Austin Permitting and Development Center Case Study](#)
- [Wimberley ISD Blue Hole One Water Primary School](#)
- [Zurich makes a sustainability splash with water harvesting system](#)
- [Piedmont Atlanta's New WaterHub\(sm\) Can Reclaim 250,000 Gallons of Wastewater Daily, Power Some Hospital Utilities](#)
- [Aquacell Off-Grid Developments in New South Wales, Australia](#)
- [University of Texas, Irrigation and Water Conservation](#)

MAPS

- [TWDB: Rainwater volumes from roof runoff](#)
- [National Parks Service: Historical and projected climate change trends for the United States and U.S. national parks](#)
- [Department of Energy: Condensate Capture Potential Map](#)
- [State of Texas: TexMesoNet for detailed Weather within Texas includes dew point, humidity, soil moisture levels](#)
- [TCEQ: Water Districts Viewer](#)
- [Aqueduct: Water Risk Atlas](#)

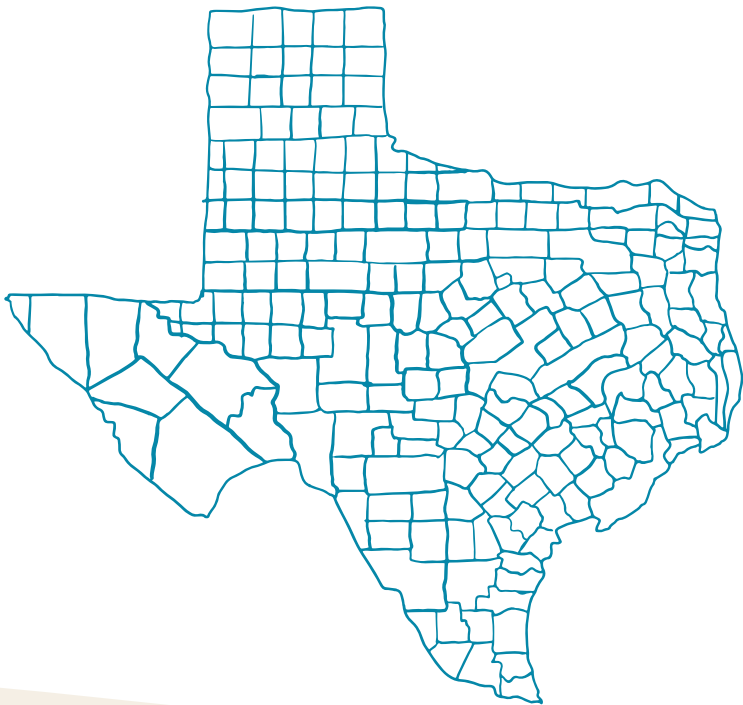

CITATIONS:

1 Texas Water Development Board. (n.d.). Future population and water demand. Retrieved January 21, 2024, from https://www.twdb.texas.gov/waterplanning/swp/2022/docs/04-SWP22_Future-Population.pdf

2 Romans, K., Walker, J., & Faust, S. B. (n.d.). One Water in the Texas Hill Country. In Hill Country Alliance. Retrieved February 19, 2024, from https://hillcountryalliance.org/wp-content/uploads/2021/09/HCA_NWF_One_Water_Report_FINAL_SinglePage.pdf

3 Bryant, M. (2022, September 21). Shield Ranch Celebrates Grand Opening of New Sustainably Designed Campsite. Shield Ranch. <https://www.shieldranch.com/shield-ranch-celebrates-grand-opening-for-the-campsite-at-shield-ranch/>

4 Onsite non-potable water reuse practice guide. (n.d.). William J. Worthen Foundation.page Retrieved January 21, 2024, from https://www.pankowfoundation.org/site/assets/files/1879/waterreuseguide_final.pdf

5 Onsite non-potable water reuse practice guide. (n.d.). William J. Worthen Foundation. Retrieved January 21, 2024, from [worthenfoundation.org](https://www.pankowfoundation.org/site/assets/files/1879/waterreuseguide_final.pdf)

6 Water Reuse Systems Certification: NSF/ANSI 350. (n.d.). Www.nsf.org. Retrieved January 21, 2024, from <https://www.nsf.org/water-systems/onsite-wastewater-water-reuse-systems/water-reuse>

7 Resources for Onsite Non-Potable Water Programs. (n.d.). US Water Alliance. Retrieved January 26, 2024, from <https://uswateralliance.org/programs/other-initiatives/national-blue-ribbon-commission-for-onsite-non-potable-water-systems/resources-for-onsite-non-potable-water-programs/>

8 Leonard, R. (2023, September 1). Brodie Oaks water reuse interview (G. Gilker, Interviewer) [Personal communication].

9 UT Utilities & Energy Management. (n.d.). Water Conservation Efforts . Utilities.utexas.edu. <https://utilities.utexas.edu/efficiency/water-conservation-efforts>

10 UT Facilities Services. (n.d.). Irrigation & Water Conservation . Facilities Services.utexas.edu. Retrieved February 16, 2024, from <https://facilitieservices.utexas.edu/programs/irrigation-water-conservation>

11 Epp, K. (2022, December 2). Credit Human Headquarters Building Case Study (S. Leurig, Interviewer) [Personal communication].

12 Jacques, K. (2018, March 20). Toyota’s new headquarters plants roots in Plano | U.S. Green Building Council. Www.usgbc.org. <https://www.usgbc.org/articles/toyota-s-new-headquarters-plants-roots-plano>

13 Walker, J. (2019, April 18). One Water in action: Austin Central Library uses rainwater to flush toilets – Texas Living Waters Project. Texas Living Waters. <https://texaslivingwaters.org/one-water-austin-central-library/>

14 LAKEWAY MUNICIPAL UTILITY DISTRICT WATER CONSERVATION PLAN. (2020, March). <https://lakewaymud.org/wp-content/uploads/conservationplan.pdf>

15 Foster, E. (2024, February 5). Lakeway MUD water reuse interview (G. Gilker and S. Leurig, Interviewers) [Personal communication].

16 Piedmont Atlanta’s New WaterHub(sm) Can Reclaim 250,000 Gallons of Wastewater Daily, Power Some Hospital Utilities. (2023, May 3). Www.piedmont.org. <https://www.piedmont.org/about-piedmont-healthcare/media-room/stories/news-article?story=4813&type=1>

17 AUSTIN PERMITTING AND DEVELOPMENT CENTER. See https://www.austintexas.gov/sites/default/files/files/Water/AlternativeWater/Reclaimed/AW_CaseStudies_PDC.pdf

18 Gary, R., Baker, D., Dornak, N., & Davison, T. (2023). One Water Implementation: A Case Study of Blue Hole Primary School, Wimberley ISD, Hays County, Texas. https://watershedassociation.org/wp-content/uploads/2023/07/OneWaterSchoolCaseStudy2023_final.pdf

19 Arnold, B. (2024, January 12). Aquacell Off-Grid Developments [Email to Grace Gilker]. In <https://drive.google.com/file/d/1vqKloN6vsVky4dkuNK5hfgx0iK9h4ymT/view>

20 Chemsearch FE – Facility Resource Management. (n.d.). <https://www.chemsearchfe.com/solutions-water-reuse.html>

21 Onsite Water Reuse Program Guidebook A Guide for Implementing Onsite Water Reuse Systems in San Francisco. (2022). In San Francisco Water Power Sewer. <https://sfpuc.org/sites/default/files/documents/OnsiteWaterReuseGuideAugust2022.pdf>

22 Onsite Water Reuse Program Guidebook. (n.d.). Austin Water. https://www.austintexas.gov/sites/default/files/files/Water/Onsite%20Water%20Reuse%20System/AW_OnsiteWaterReuse_Guidebook.pdf

23 How Reuse Works . (2015, August 20). WaterReuse Association. <https://watereuse.org/educate/water-reuse-101/how-reuse-works/>

24 List of Texas PWSs Limiting Water Use to Avoid Shortages. (n.d.). Texas Commission on Environmental Quality. Retrieved January 21, 2024, from <https://www.tceq.texas.gov/drinkingwater/trot/droughtw.html>

25 Gravois, D., & Al-Shaikh, S. (2022, September 14). Dripping Springs to end development moratorium. KXAN Austin. <https://www.kxan.com/news/local/hays/dripping-springs-to-end-development-moratorium/>

26 Garcia, M. (2023, August 10). Magnolia extends building permit delay for third time to address water supply issues. Houston Chronicle. <https://www.houstonchronicle.com/neighborhood/moco/news/article/magnolia-stops-issuing-new-building-permits-18280035.php>

27 Harper, K. B. (2021, February 19). “An emergency on top of a pandemic”: Texas hospital workers scramble as winter storm hampered operations. The Texas Tribune. <https://www.texastribune.org/2021/02/18/texas-hospitals-power-outages-winter-storm/>

28 Affordability Assessment Tool for Federal Water Mandates. (n.d.). In American Water Works Association. Retrieved January 21, 2024, from <https://www.awwa.org/Portals/0/AWWA/ETS/Resources/AffordabilityAssessmentTool.pdf>

29 Simon, M. (n.d.). The City of Tomorrow Will Run on Your Toilet Water. Wired. <https://www.wired.com/story/the-city-of-tomorrow-will-run-on-your-toilet-water/>

30 Top 11 Green Building Certifications That Can Increase Your Property’s Marketability | SharpLaunch. (2019, October 3). SharpLaunch. <https://www.sharplaunch.com/blog/green-building-certifications/>

31 Green Is Good: The Enduring Rent Premium of LEED-Certified U.S. Office Buildings. (2022, October 26). Www.cbre.com. <https://www.cbre.com/insights/viewpoints/green-is-good-the-endurance-of-the-rent-premium-in-leed-certified-us-office-buildings>

32 Albers, J. (2022, March). Green is Good Part 3: Sustainability’s Impact on Multifamily Performance. Cushman & Wakefield. <https://www.cushmanwakefield.com/en/united-states/insights/green-is-good-series>

33 SUEZ Survey Finds Majority of Americans Agree Water Scarcity is a Major Concern | Veolia. (2020, April 21). <https://www.watertechnologies.com/about-us/newsroom/suez-survey-finds-majority-americans-agree-water-scarcity-major-concern>

34 Briones, R.O., and Mace, R.E., in preparation, Reliable rainwater is only a roof away—The firm yield of rainwater harvesting in Texas: The Meadows Center for Water and the Environment, Texas State University.

35 Mace and Briones (in preparation), The Meadows Center for Water and the Environment at Texas State University.

36 Historical and projected climate change trends for the United States and U.S. national parks. (2018). Nps.gov. <https://irma.nps.gov/DataStore/Reference/Profile/2266988>

37 Glawe, D. D. (2013). San Antonio Condensate Collection and Use Manual for Commercial Buildings. San Antonio Water System. https://apps.saws.org/Conservation/commercial/Condensate/docs/SACCUManual_20131021.pdf

38 Public Improvement Districts (PIDs). (2020). Fortworthtexas.gov. <https://www.fortworthtexas.gov/departments/econdev/pid>

39 Davenport, R. R. (n.d.). Public Improvement Districts. fms Municipal Bond Specialists. Retrieved January 21, 2024, from <https://texascityattorneys.org/wp-content/uploads/2016/02/TML-PIDs-2-16.pdf>

40 ArcGIS Web Application: Water District Map. (n.d.). Tceq.maps.arcgis.com; TCEQ. <https://tceq.maps.arcgis.com/apps/webappviewer/index.html?id=04bbf8b322b34d8abaea7b06996d3775>

41 Smith, B. (2020, September 21). Microsoft will replenish more water than it consumes by 2030. The Official Microsoft Blog. <https://blogs.microsoft.com/blog/2020/09/21/>

42 Plants and Major Projects Department. (2020, December). SAWS RECYCLED WATER USER HANDBOOK. San Antonio Water System. https://apps.saws.org/your_water/Recycling/handbook/docs/RW%20User%20Handbook_draft_Jan%202020v1.pdf

43 Blackburn, J., Leurig, S., Jashinski, K., Walker, J., & Losoya, J. (n.d.). PACE Rapidly Scaling Water Reuse Across Texas Using Property Assessed Clean Energy (PACE) Financing National Wildlife Federation Texas Coast and Water Program. In Texas Water Trade. Retrieved January 21, 2024, from <https://texaswatertrade.org/wp-content/uploads/2021/09/Using-PACE-to-Rapidly-Scale-Water-Reuse-Across-Texas.pdf>

44 Proposition 6 and Texas Water Fund Frequently Asked Questions. (2023). Texas Water Development Board. https://www.twdb.texas.gov/home/tabs/doc/hot/SB_28-TexasWaterFund-FAQ.pdf

45 https://www.austintexas.gov/sites/default/files/files/Water/AlternativeWater/Reclaimed/AW_CaseStudies_CentralLibrary.pdf

46 Jashinski, K., & Batchelder, R. (2024, January 30). OSCAR/CLARA check for commissioning use (G. Gilker, Interviewer) [Personal communication].

47 Hegemier, T., Murphy, M., & Pandey, S. (2024, February 4). LCRA Feedback (G. Gilker & S. Leurig, Interviewers) [Personal communication].

48 Texas Water Development Board. (n.d.). Future population and water demand. Retrieved January 21, 2024, from https://www.twdb.texas.gov/waterplanning/swp/2022/docs/04-SWP22_Future-Population.pdf

ACKNOWLEDGEMENTS

First, a thanks to our sponsors, without whom this toolkit would not have been possible:

LOWER COLORADO RIVER AUTHORITY
AQUACELL

AUSTIN WATER
UNICORN SERVICE SOLUTIONS, LLC

We owe tremendous gratitude to the many experts who shaped, reviewed and refined this toolkit, including:

Alan Steinberg, West Houston Association

Beth Keel, Credit Human

Rick Rosenberg, Development Planning and Financing Group

Alex Fairhart, Personal Water Systems

Kristal Casey, Unicorn Service Solutions, LLC

Robert Mace, The Meadows Center for Water and the Environment

Ashley Harper, Environmental Protection Agency

Kyle Pickett, William J. Worthen Foundation

Tom Hegemier, Lower Colorado River Authority

Ben Arnold, Aquacell

Marisa Bruno, Hill Country Alliance

Tyler Wible, One Water Solutions Institute

Dave Anderson, Drenner Group

Marlene Gafrick, MetroNational

Vanessa Puig Williams, Environmental Defense Fund

David Jarvis, John Burns Research & Consulting

Megan Frey, Endeavor

Paula Kehoe, San Francisco Public Utilities Commission

Erika Crespo, Texas Commission on Environmental Quality

Megan Thomas, Epic Cleantec

Rahul Shah, ChemSearch

Jennifer Walker, National Wildlife Foundation

Rebecca Batchelder, Austin Water

Justin Stenkamp, PAE Engineering

Rebecca Leonard, Lionheart Places

Katherine Jashinski, Austin Water

Robert Stefani, Austin Water

