





OPTI-OA4A
OPTI-FLOAT® LEVEL DETECTOR
4 FLOAT OPEN ASSEMBLY

Cox Research and Technology, Inc.
PO Box 77808
Baton Rouge, LA. 70879
(225) 756-3271 Fax (225) 755-1030

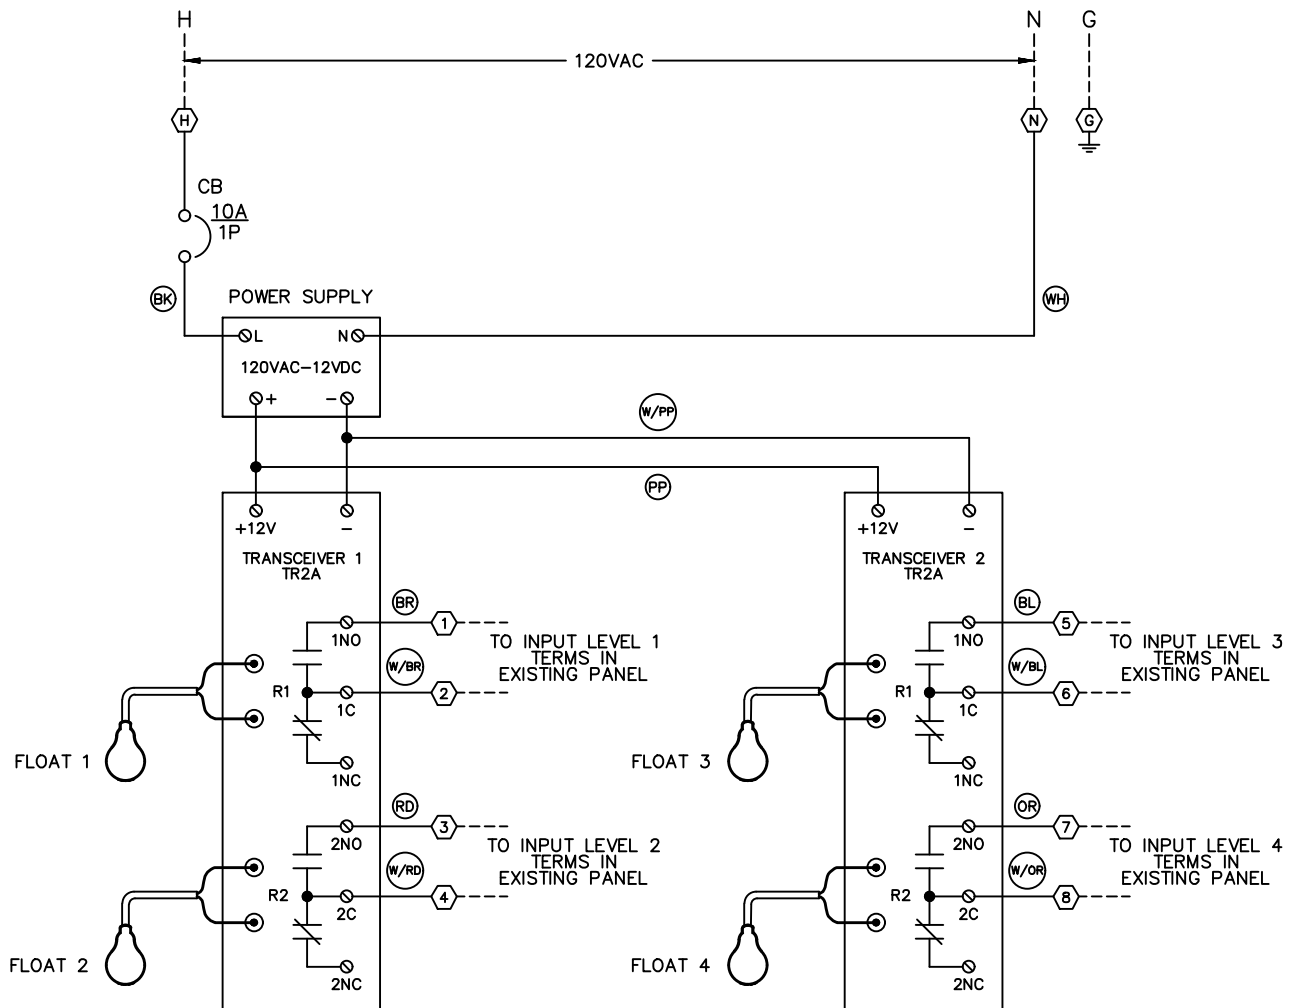

	Drawing Title <
--	--

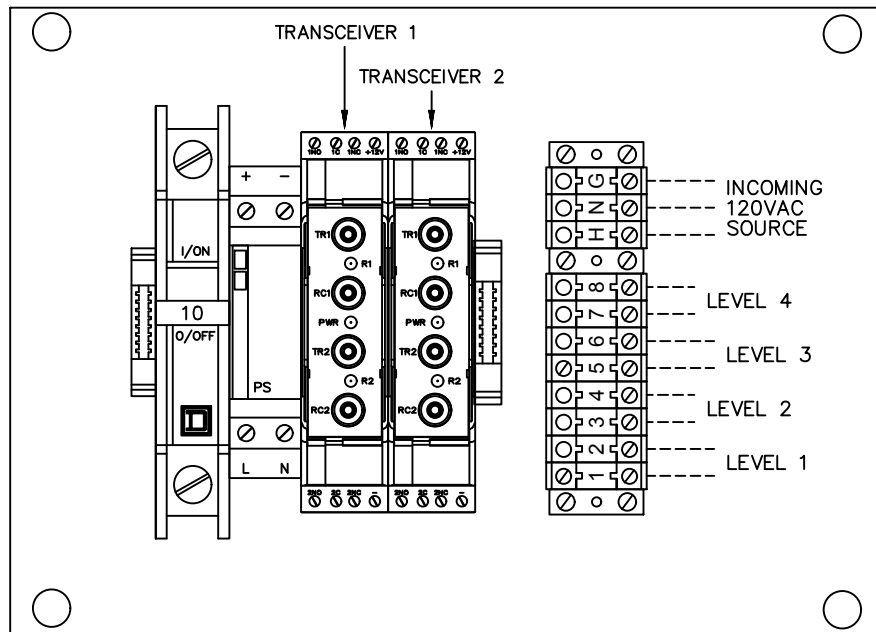

2 DUAL TRANSEIVERS (FOR 4 FLOATS) 6"W X 4.5"H X 4.75"D
 RECOMMENDED CLEARANCE FOR CABLE ENTRY IN FRONT OF TRANSCIEVER IS 1" MINIMUM.
 FOR PROPER OPERATION INCOMING GROUND REQUIRED
 KEEP PANEL POWERED OFF UNTIL OPTI-FLOAT ARE COMPLETELY CONNECTED

	Drawing Title									
	EXTERNAL CONNECTIONS									
		OPTI-OA4		TR2 REPLACE TO TR2A				02/26/19	C.C.	
		REFERENCE DRAWING		NO.	REVISION - LOCATION			ECN	DATE	BY
DATE: 08/14/26		S/N	Sales Engineer C.C.	Application Engineer C.C.		DRAWN BY: JCF		APPROVED BY: DATE:		
	Project Title				P.O. Box 77808 Baton Rouge, LA 70879 Ph. (225) 756-3271 Fax (225) 755-1030		PURCHASE ORDER NUMBER			
	OPTI-OA4A						DRAWING NUMBER OPTI-OA4A			
							SHEET NUMBER 2			
SCALE: N.T.S.										

Release Date
January 2019

